



View of Product-61




View of Product-62

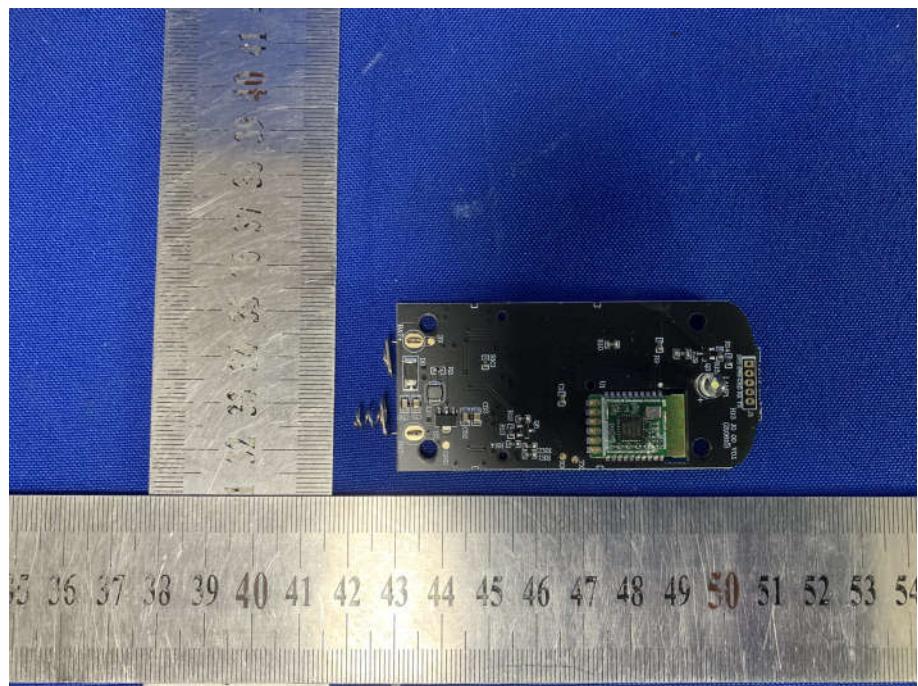


View of Product-63

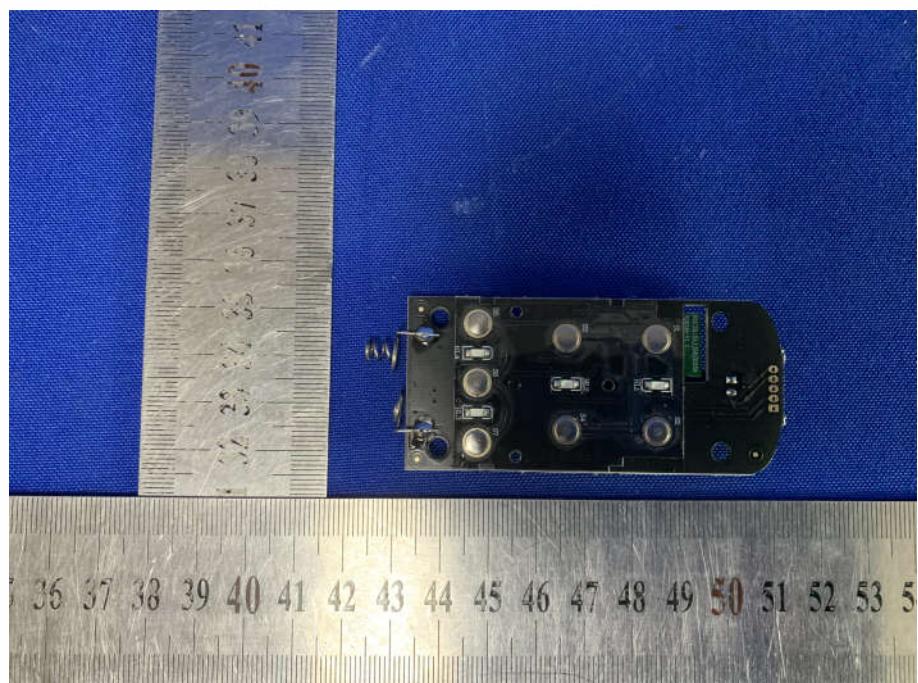

View of Product-64

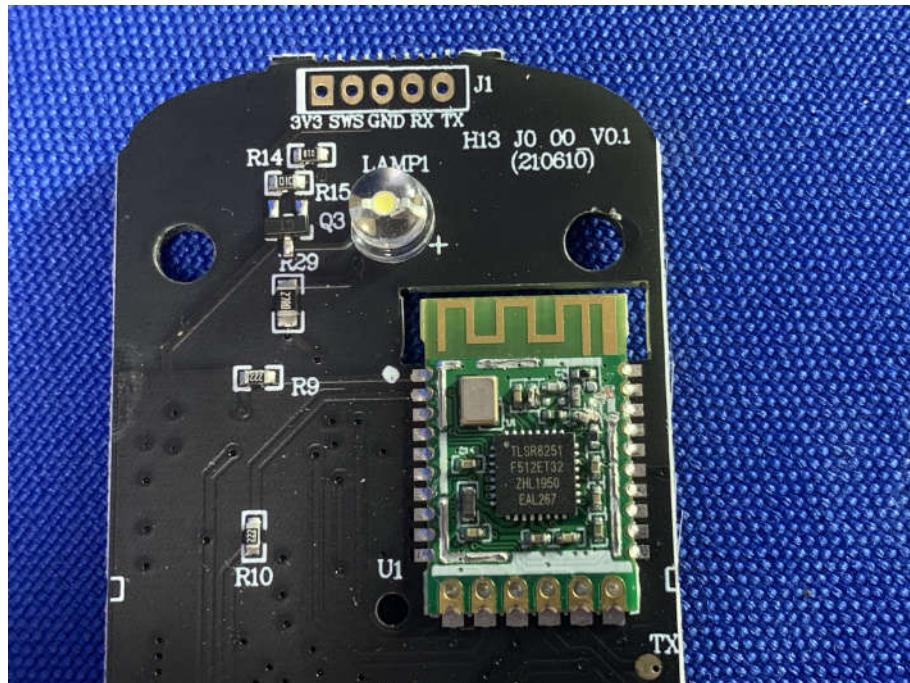

View of Product-65

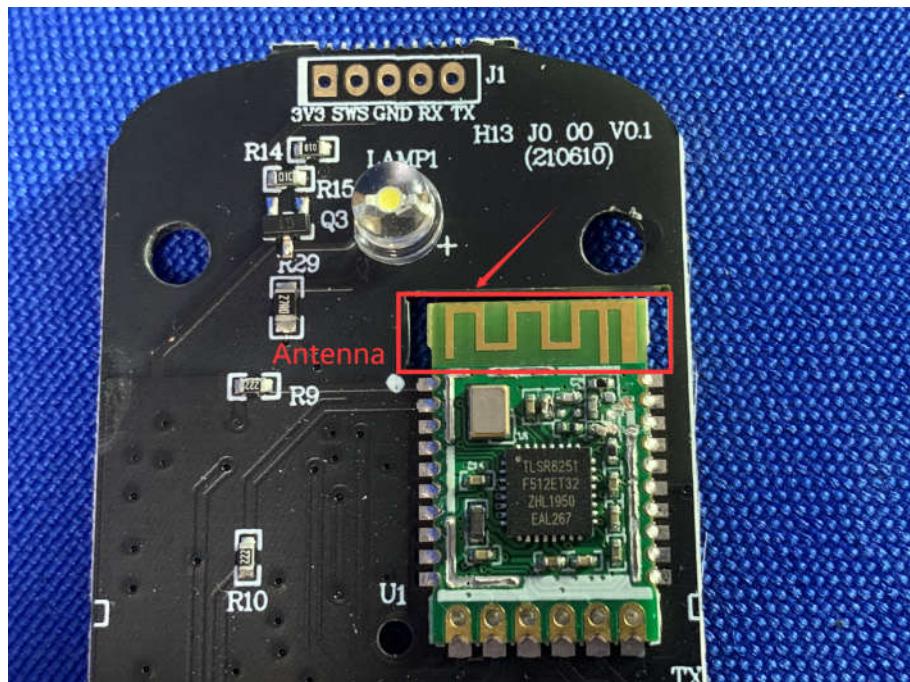

View of Product-66



View of Product-73




View of Product-74




View of Product-75




View of Product-76

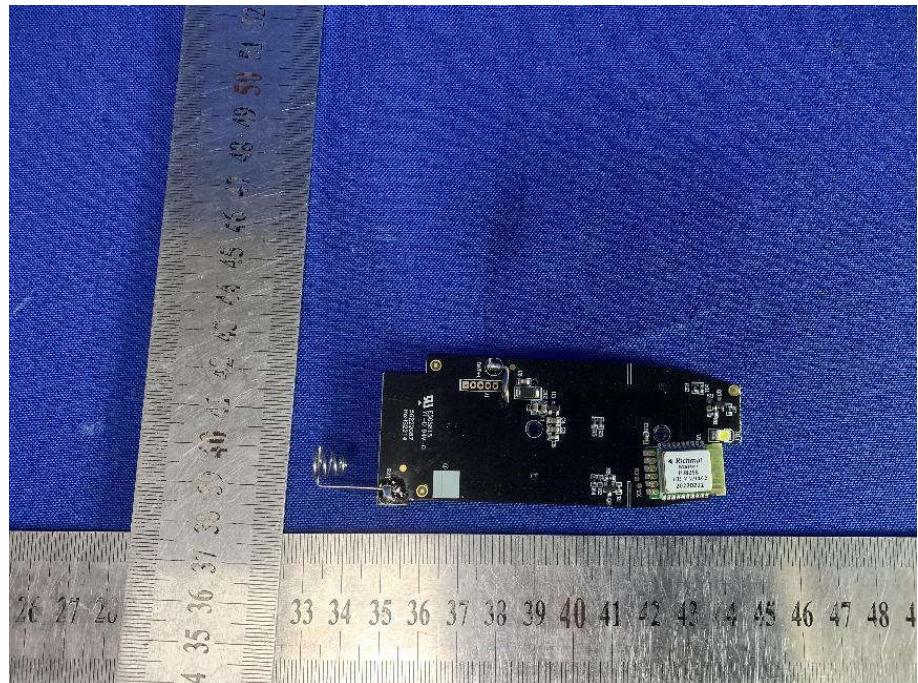


View of Product-77

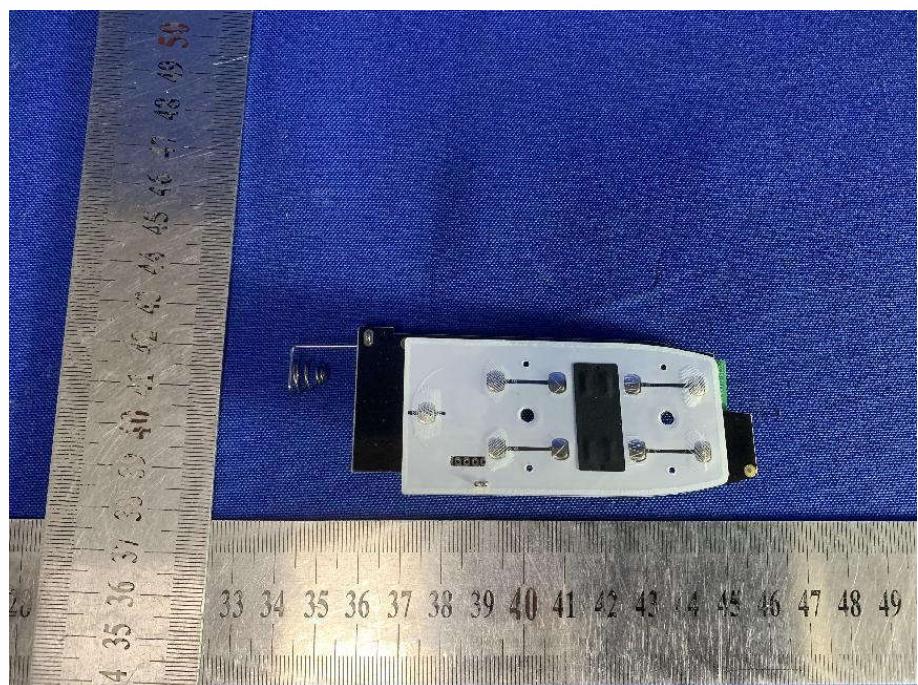


View of Product-78

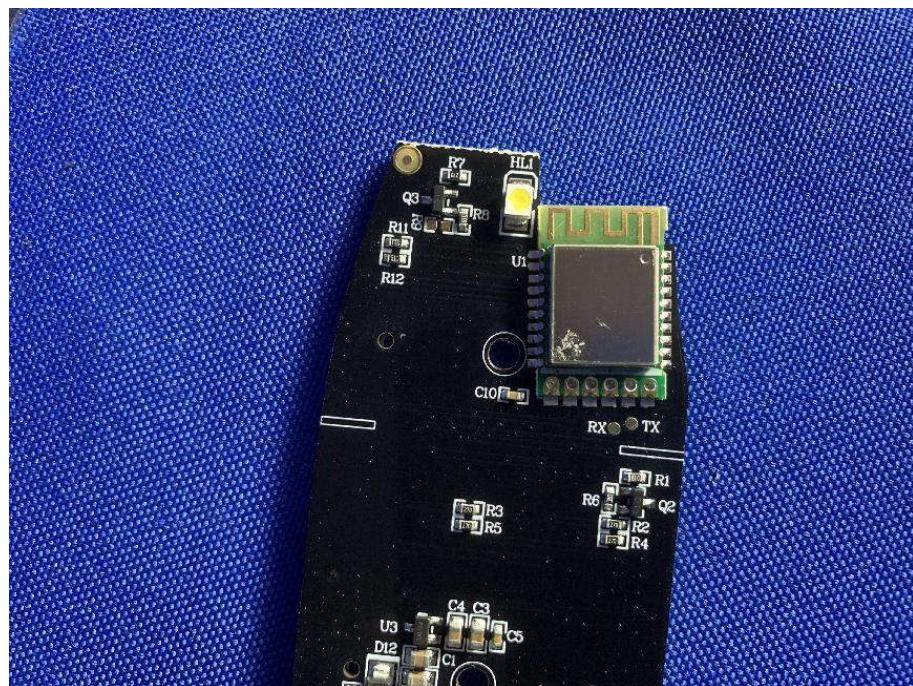

View of Product-79

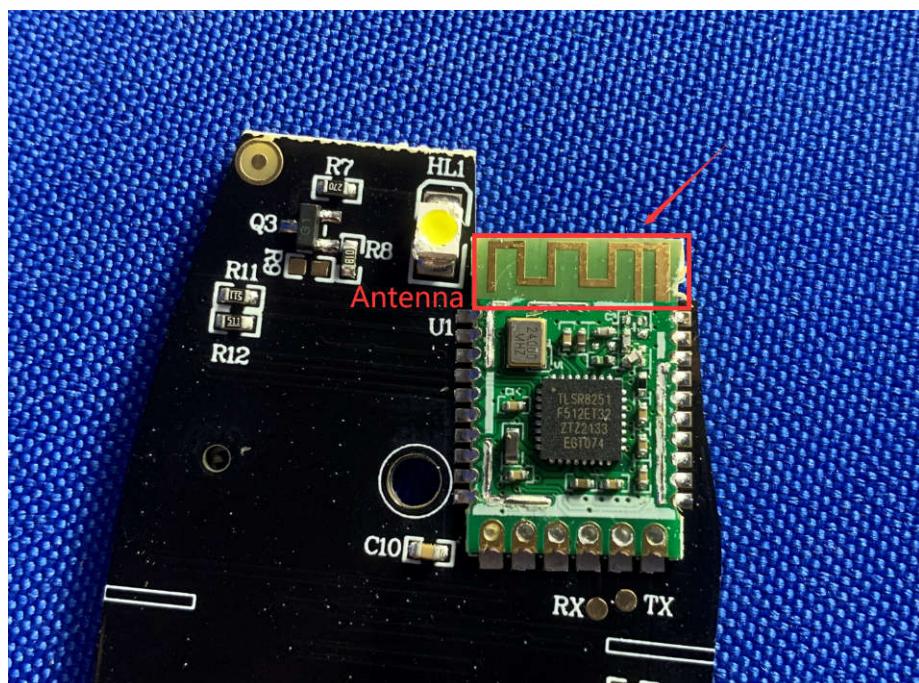


View of Product-80

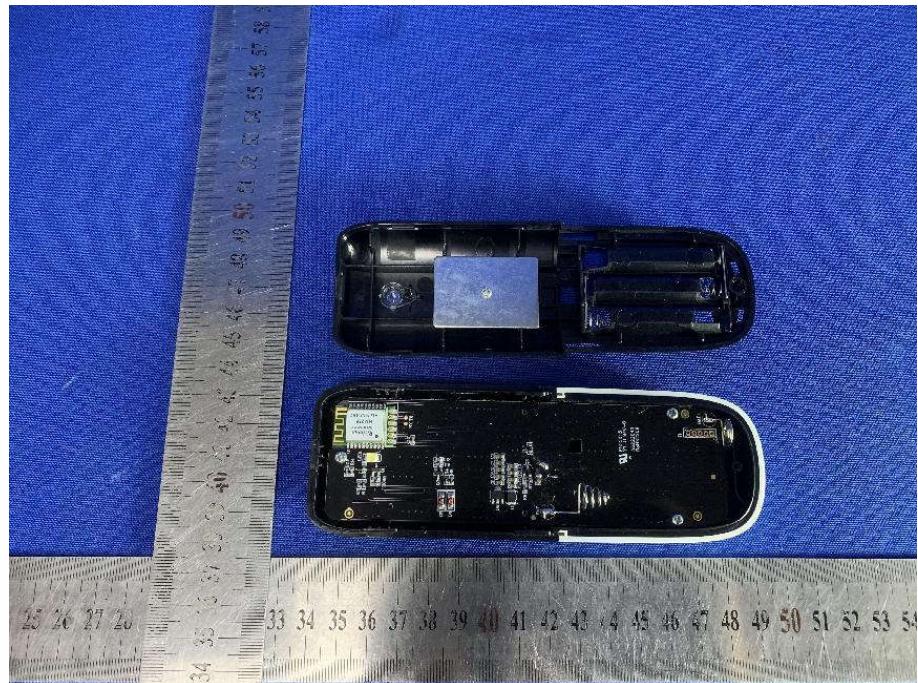


View of Product-87




View of Product-88

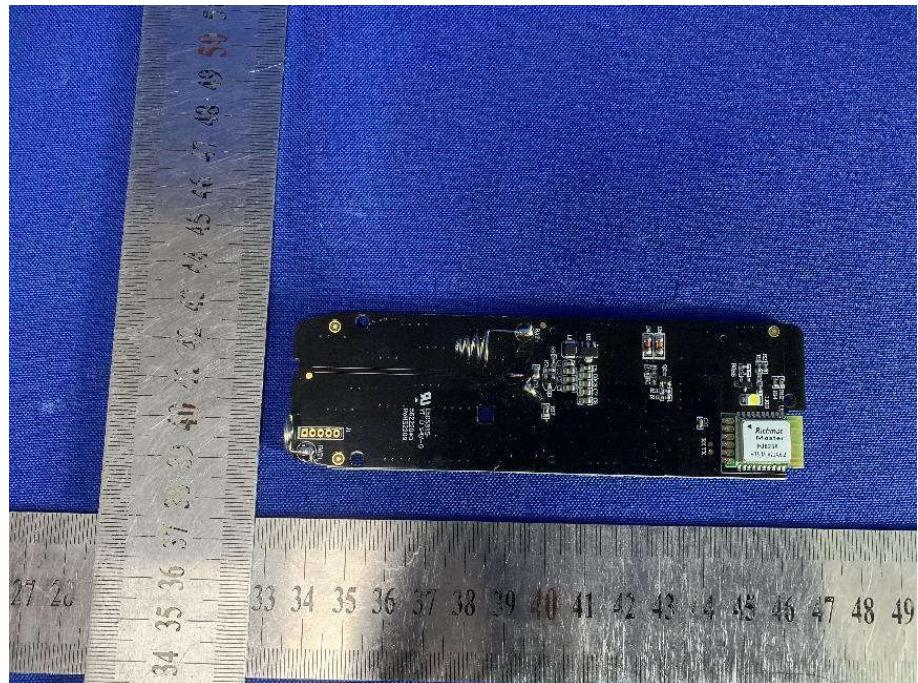


View of Product-89

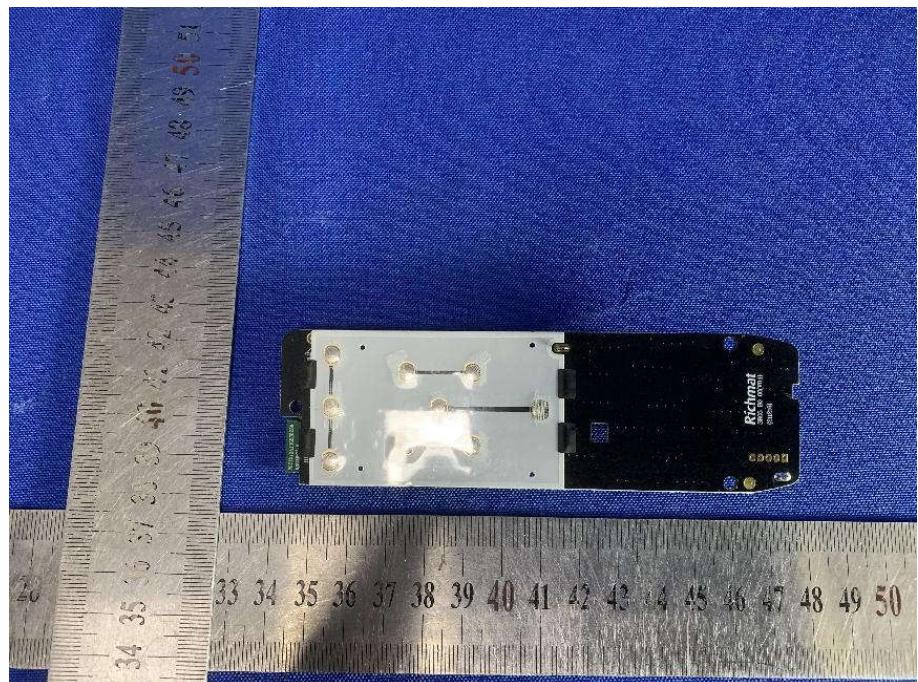

View of Product-90

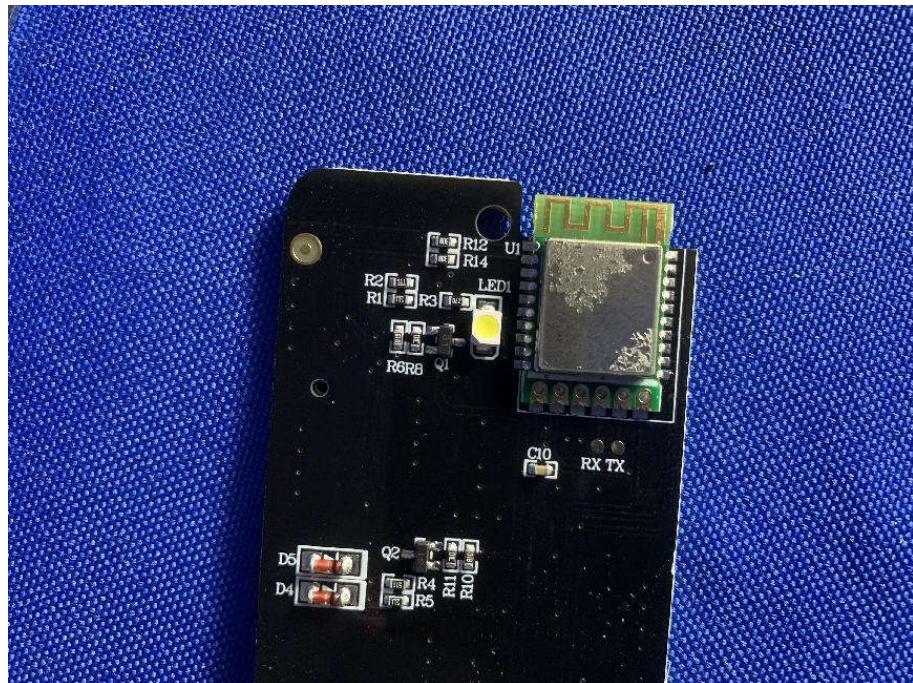

View of Product-91

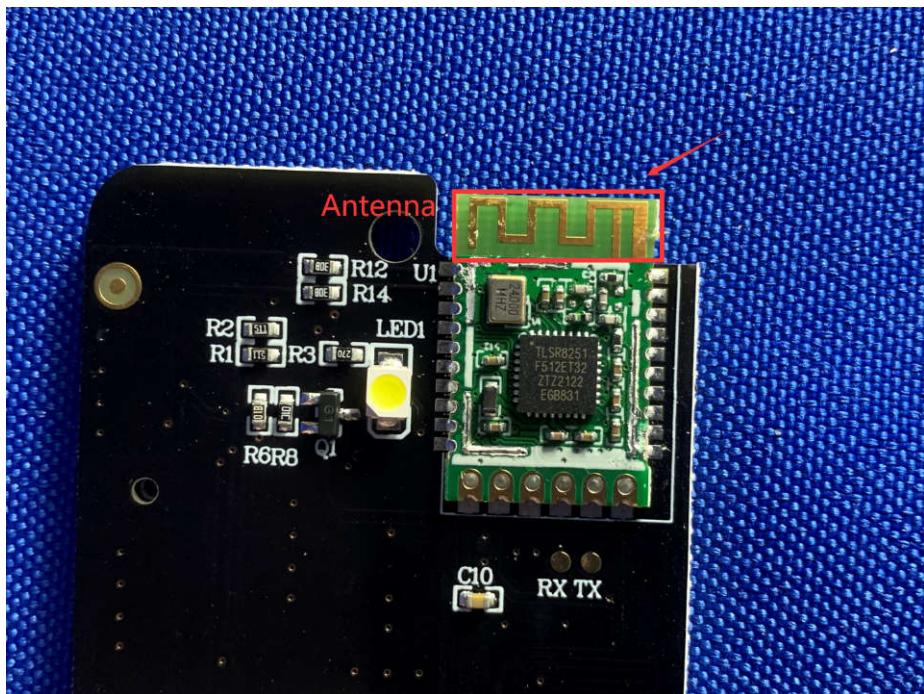


View of Product-92




View of Product-99




View of Product-100

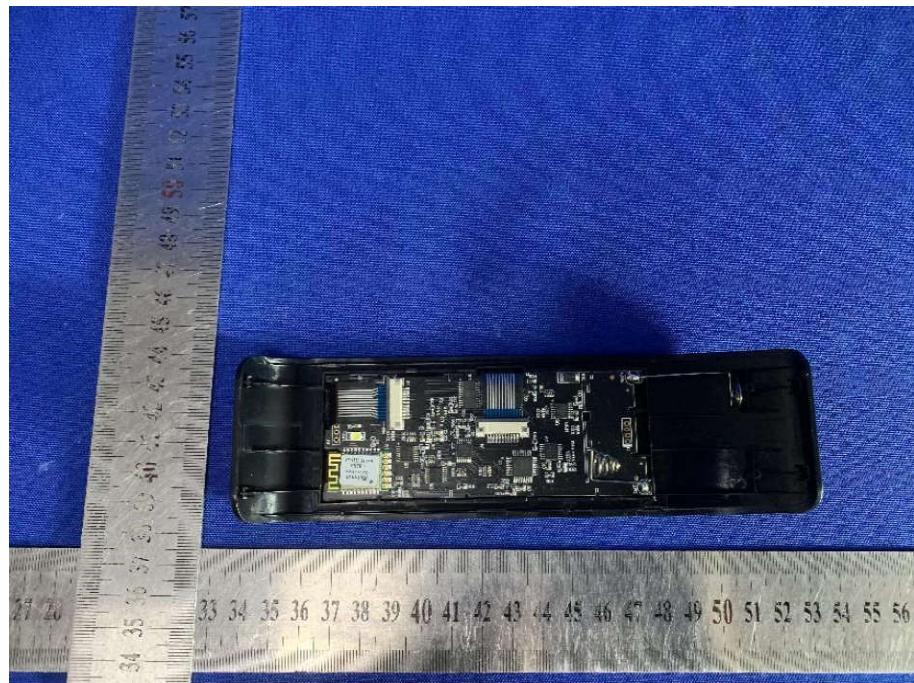


View of Product-101

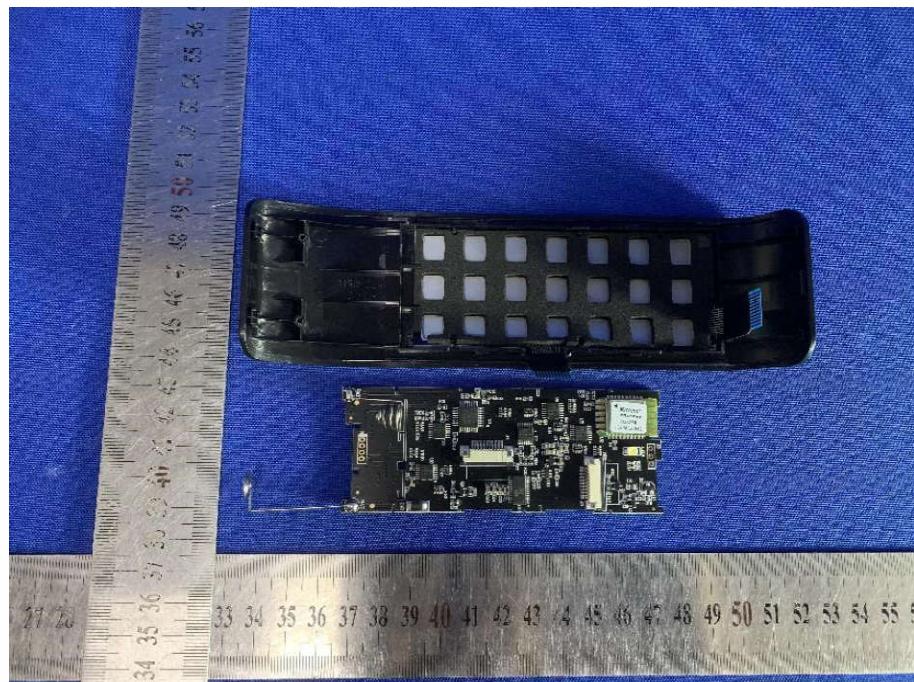

View of Product-102

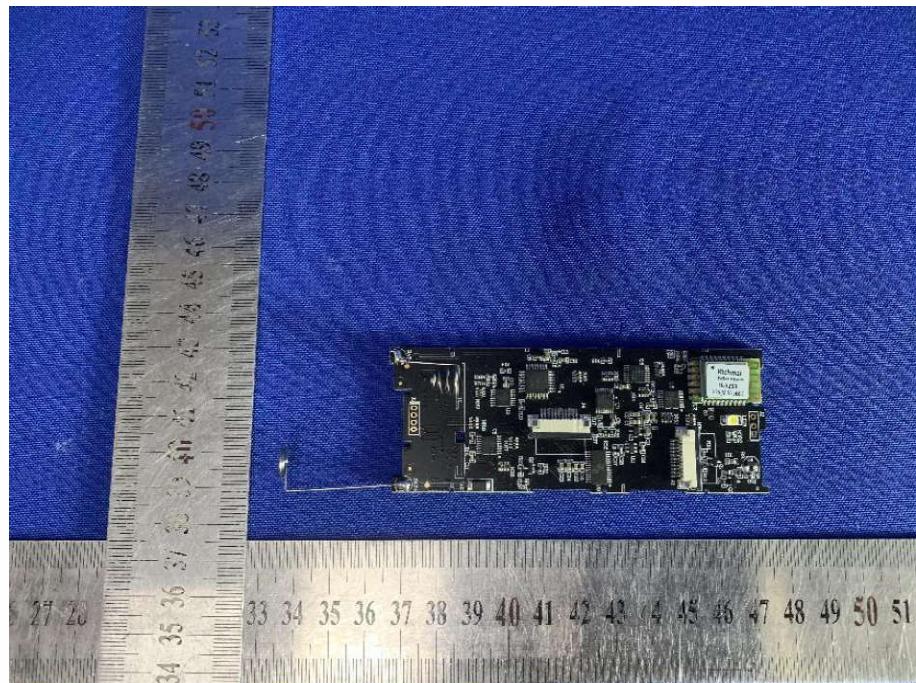


View of Product-103

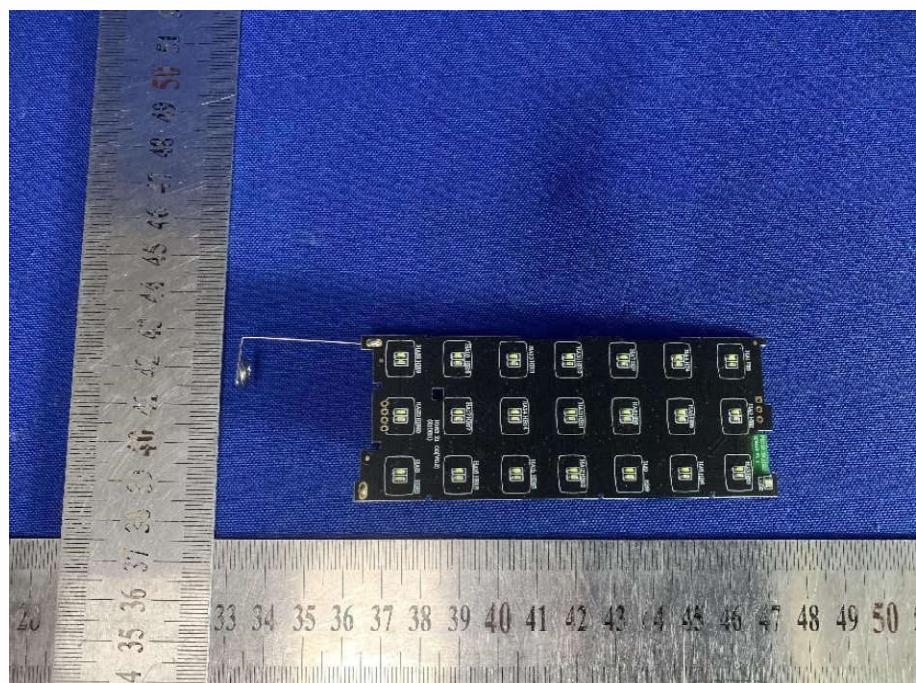

View of Product-104



View of Product-105

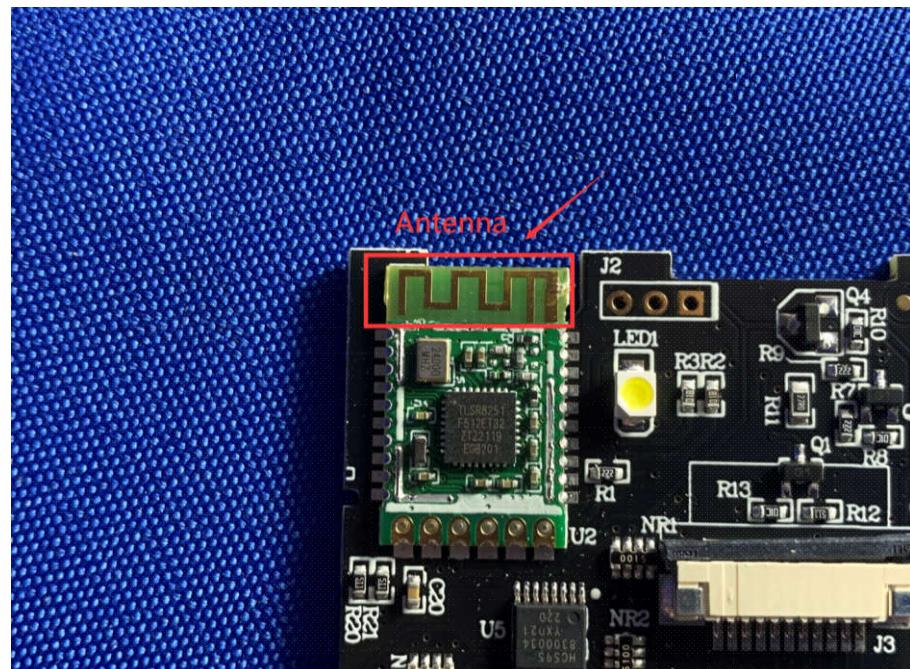

View of Product-106

The test report is effective only with both signature and specialized stamp, The result(s) shown in this report refer only to the sample(s) tested. Without written approval of CTI, this report can't be reproduced except in full.

*** End of Report ***