

Bluetooth Bone Conductor Pillow User's Manual



NOGOFLEX User's Manual

Model NO : NEC-B700

NOGNOFLEX 제품구성품


Model NO : NEC-B700



NOGNOFLEX Pillow



NOGNOFLEX-AMP

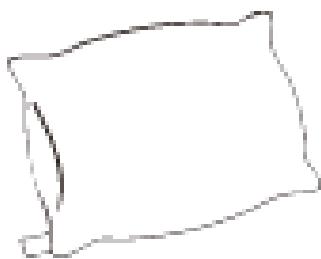


Pillow Cover



User's Guide

NOGNOFLEX Amplifier Designation

Model NO : NEC-B700

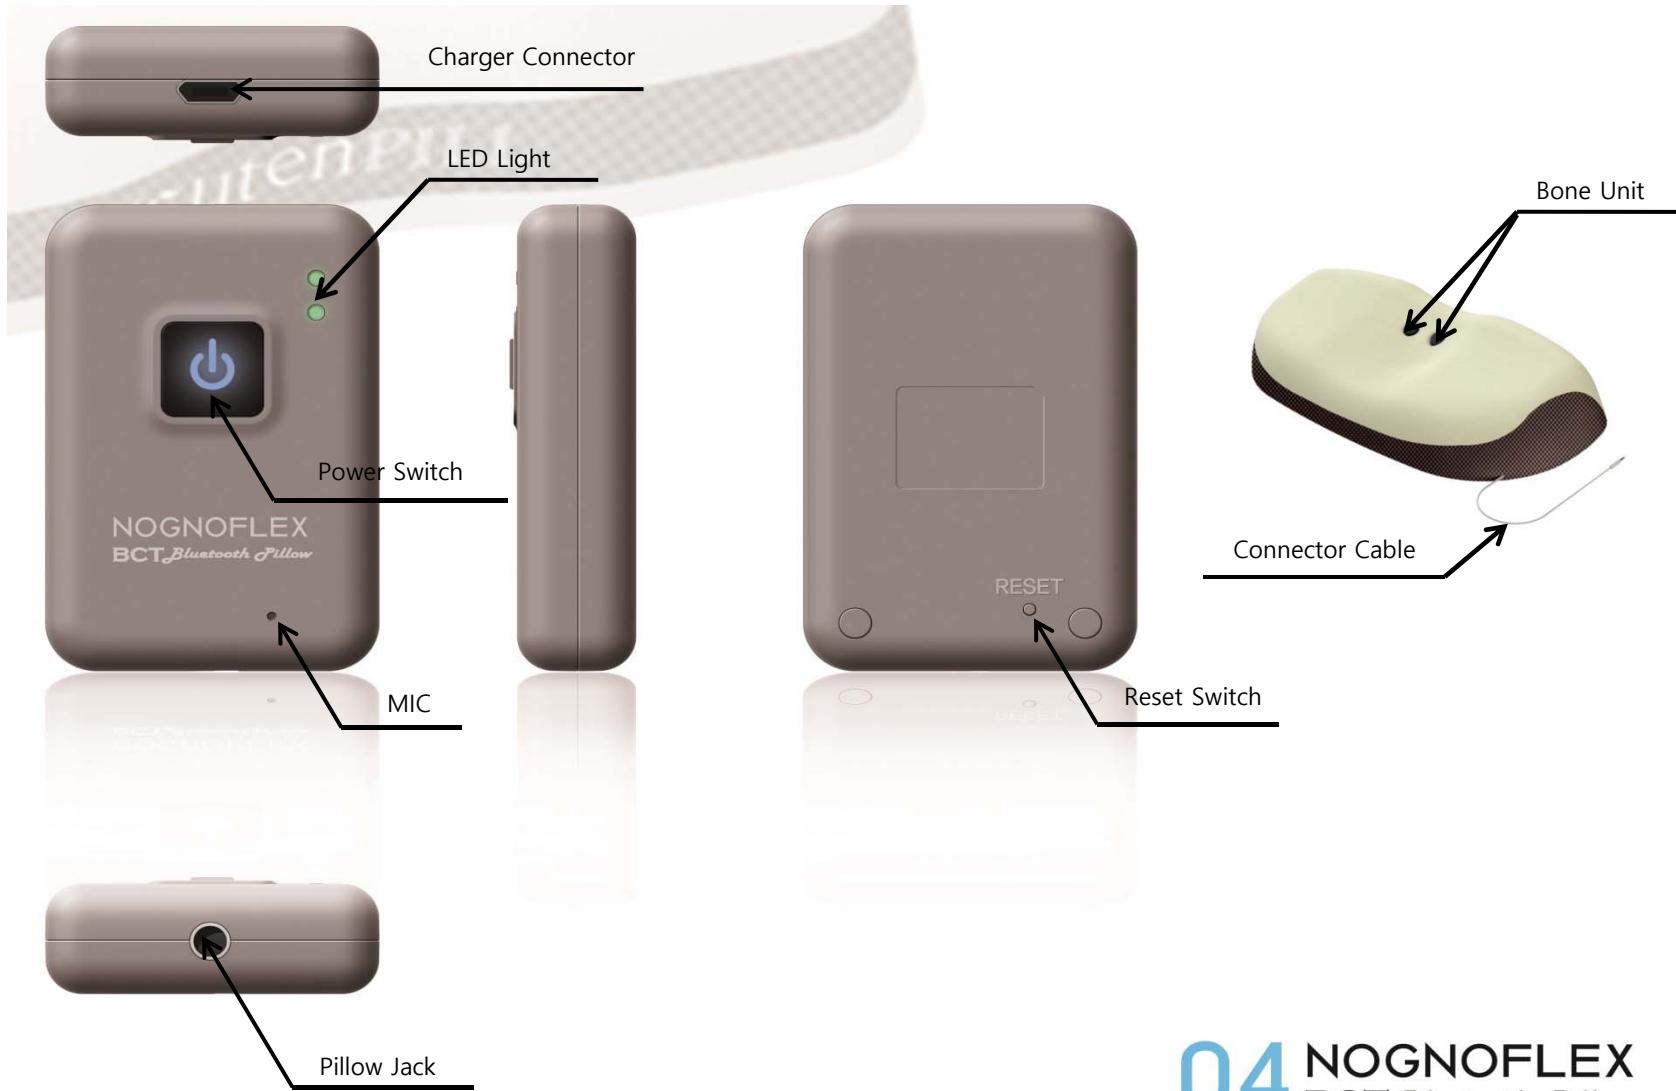

04 NOGNOFLEX
BCT Bluetooth Pillow

NOGNOFLEX (Action Description1)

Model NO : NEC-B700




Explain1

1. Power Switch On
2. Pressing the power switch and hold for 3 seconds.
3. Turn on bluetooth on your smartphone.
4. The name appers on a smartphone called NOGNOFLEX
5. It is connected to the amplifier.
6. You can music and song and phone calls.

04 NOGNOFLEX
BCT Bluetooth Pillow

NOGNOFLEX (Action Description2)

Model NO : NEC-B700

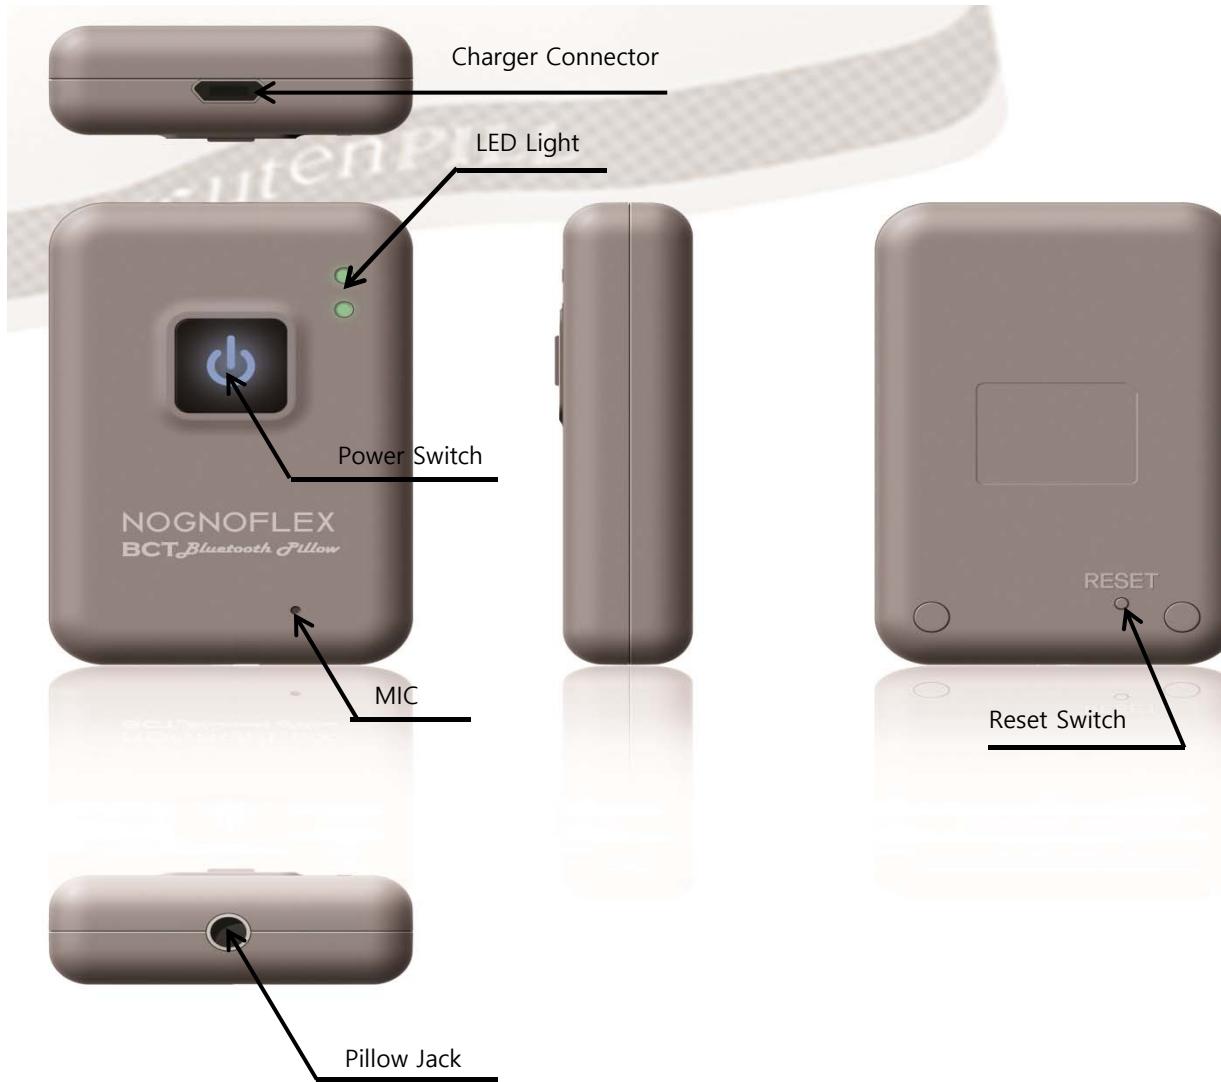

Explain2

7. When you receive a call while listening to music, press the power button.

04 NOGNOFLEX
BCT *Bluetooth Pillow*

NOGNOFLEX (Product Specification)

Model NO : NEC-B700

Amplifier Specification		NOGNOFlex Foam Specification		
◆ Amplifier		◆ NOGNOFlex Foam		
Power	3.7V Li-Polymer Battery	Size	(L)600(mm) X (D)300(mm) X (H)100(mm)	
Product of Size	68(mm)x45(mm)x16(mm)	Material	Soft Cover	Nognoflex Foam (Polyurethane(100%))
Product Weight	30g		Inner Cover	Cotton Fabric (65%) Polyester(35%)
Product Material	Plastic		Outer Cover	Cotton Fabric(80%) polyester(20%)
Max Operating Time	8Hr			
Operating Temperature	5°C ~ 40°C			
Manufactured	Shinhan NEC (Made in Korea)			

NOGNOFLEX (Adress)

Model NO : NEC-B700

FCC Statements

- NOTE: THE GRANTEE IS NOT RESPONSIBLE FOR ANY CHANGES OR MODIFICATIONS NOT EXPRESSLY APPROVED BY THE PARTY RESPONSIBLE FOR COMPLIANCE. SUCH MODIFICATIONS COULD VOID THE USER'S AUTHORITY TO OPERATE THE EQUIPMENT.

NOTE: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- - Reorient or relocate the receiving antenna.
- - Increase the separation between the equipment and receiver.
- - Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- - Consult the dealer or an experienced radio/TV technician for help.

This equipment complies with the FCC RF radiation exposure limits set forth for an uncontrolled environment.

This equipment should be installed and operated with a minimum distance of 20cm between the radiator and any part of your body.

Product Des.	Bluetooth Bone Conductor pillow	Model	NEC-B700
DATE		Serial No.	
Agent		Retail Price	

- Manufactured : Shihan NEC
- A/S : 1688-1220

