



11N40SISO_Ant1_5190

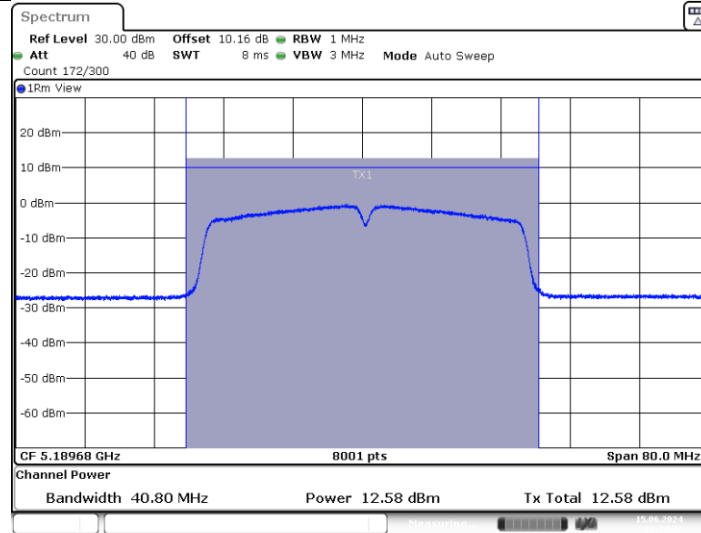


Date: 15.JUN.2024 12:34:07

11N40SISO_Ant1_5230

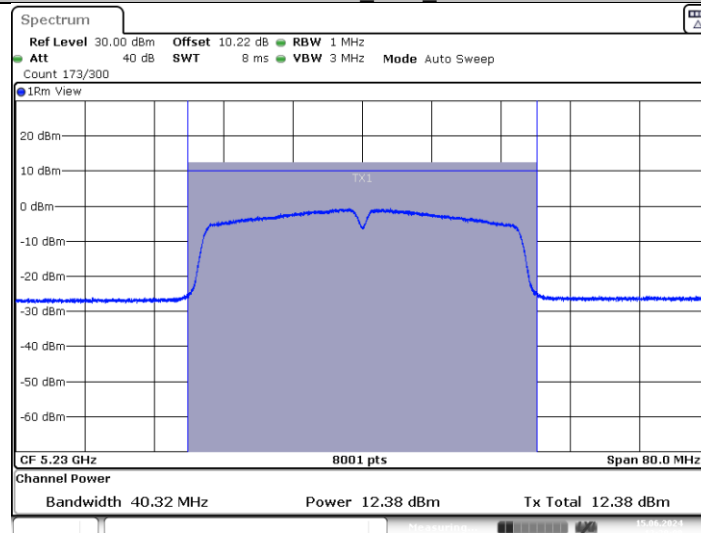


Date: 15.JUN.2024 12:39:10

11N40SISO_Ant1_5270

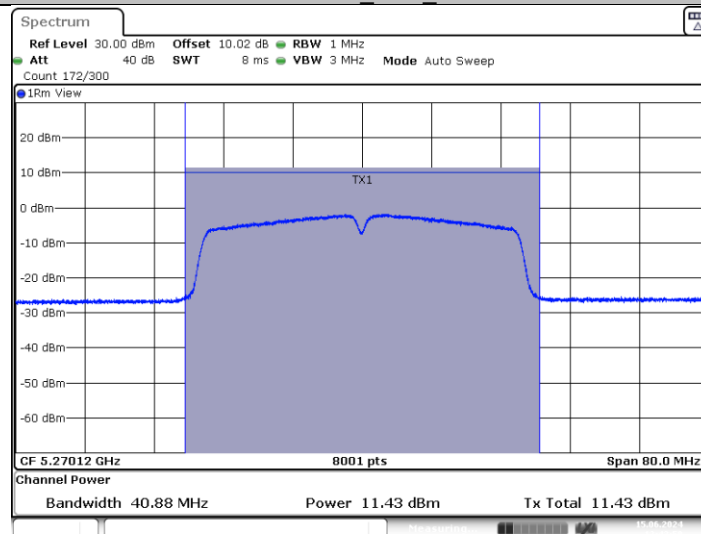


Date: 15.JUN.2024 12:43:51


11N40SISO_Ant1_5310

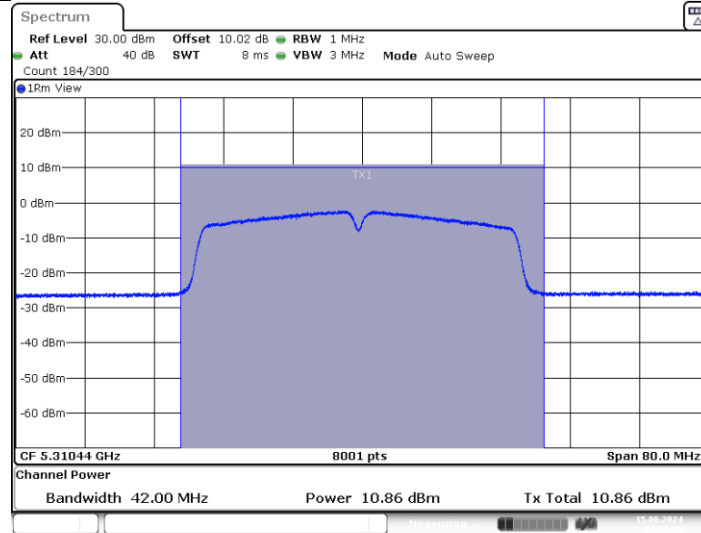


11N40SISO_Ant1_5510

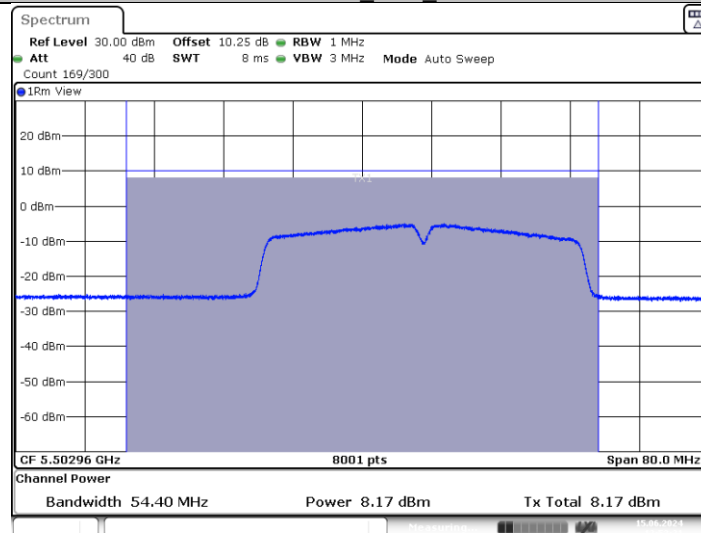


11N40SISO_Ant1_5590

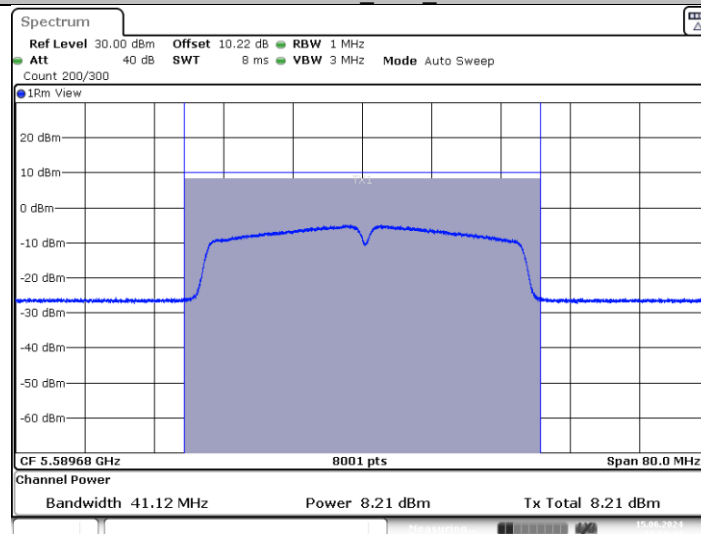


11N40SISO_Ant1_5670

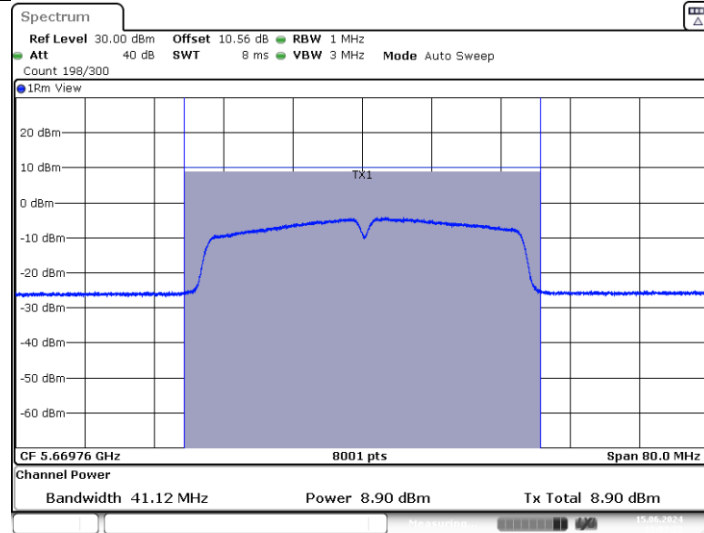


11N40SISO_Ant1_5755

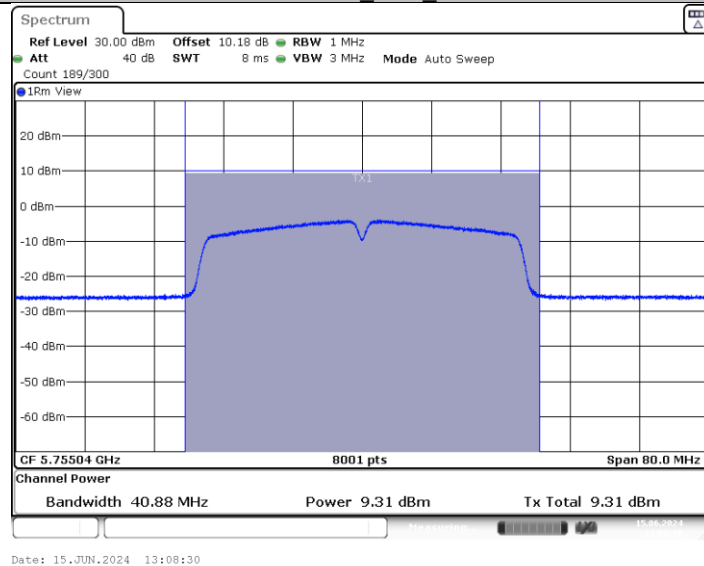

11N40SISO_Ant1_5795

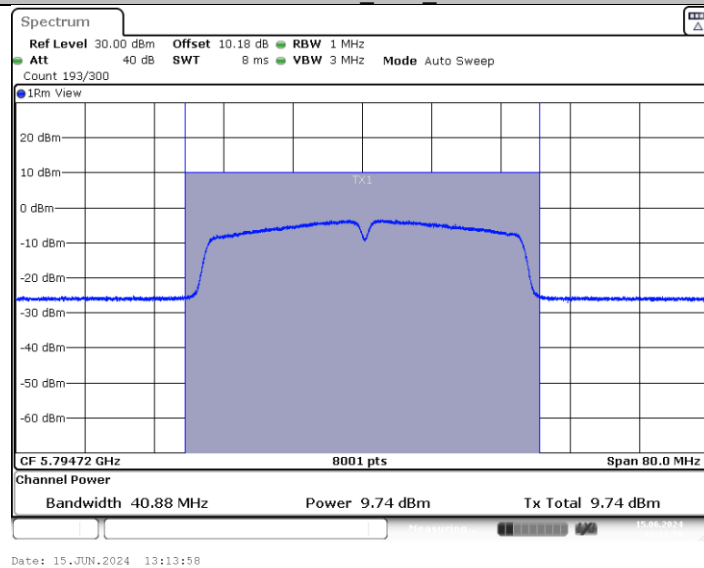


11AC20SISO_Ant1_5180

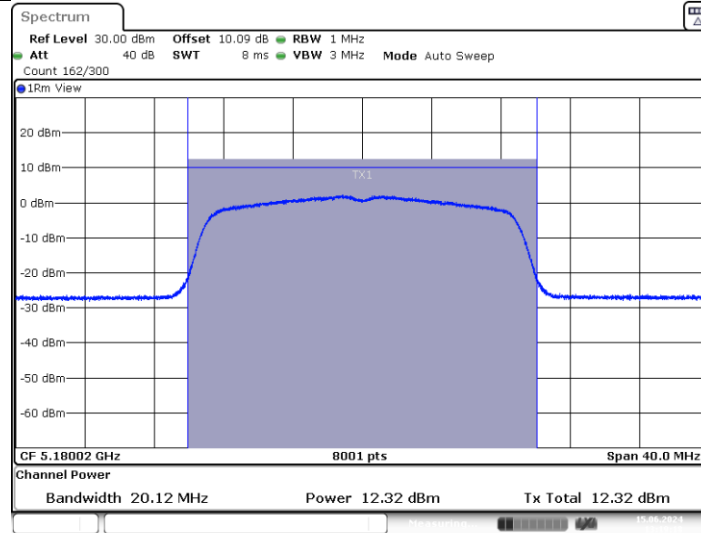


Date: 15.JUN.2024 13:19:18

11AC20SISO_Ant1_5200

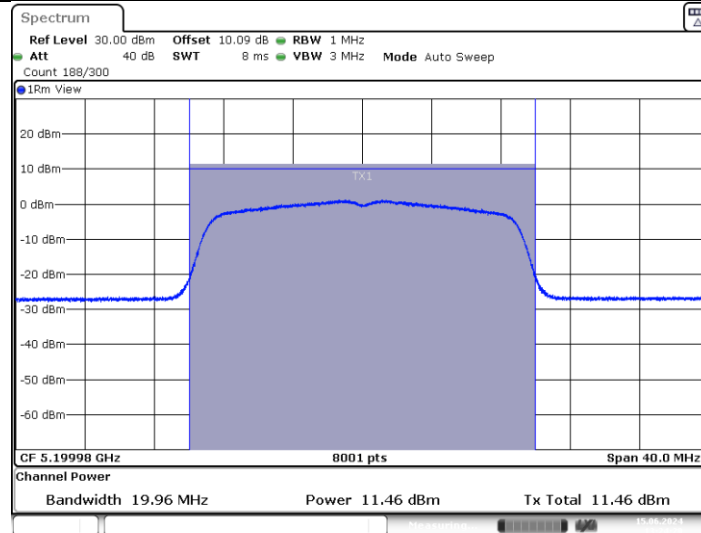


Date: 15.JUN.2024 13:24:21

11AC20SISO_Ant1_5240

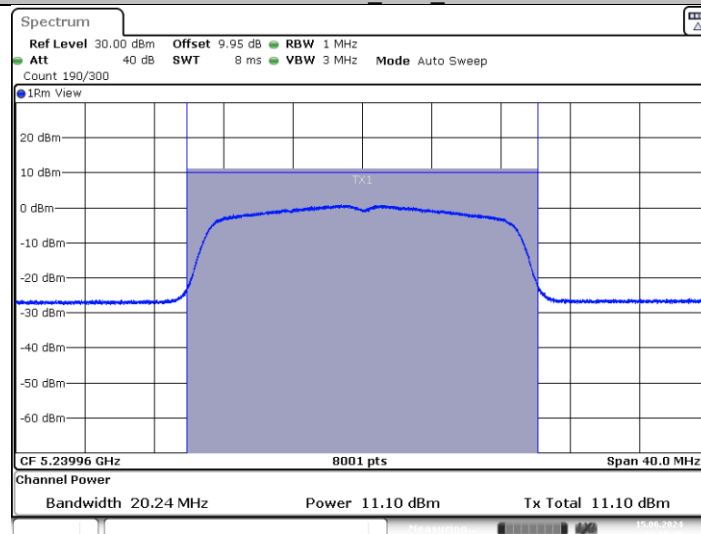


Date: 15.JUN.2024 13:29:20

11AC20SISO_Ant1_5260

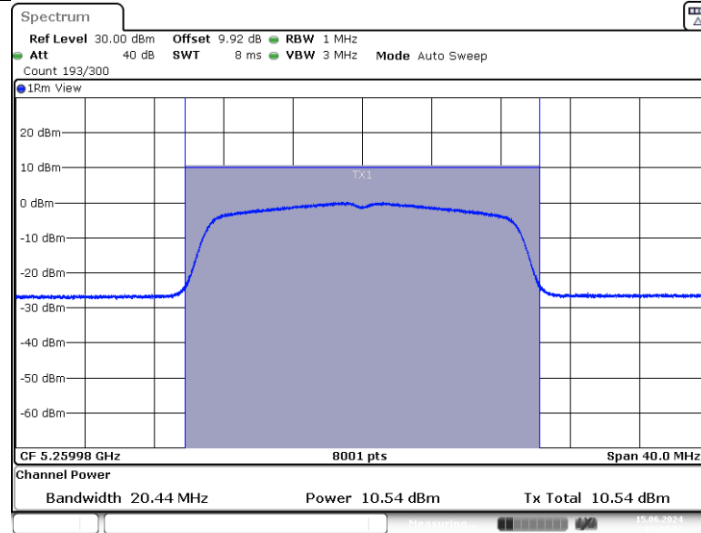


Date: 15.JUN.2024 13:34:01

11AC20SISO_Ant1_5300

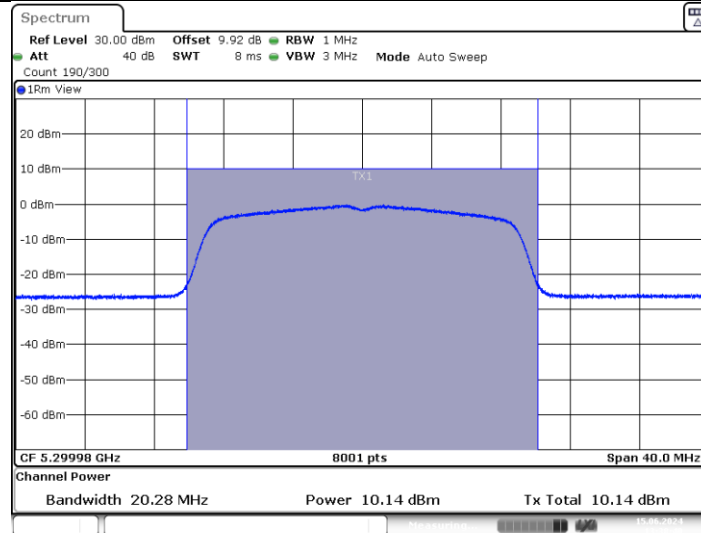


Date: 15.JUN.2024 13:38:40

11AC20SISO_Ant1_5320

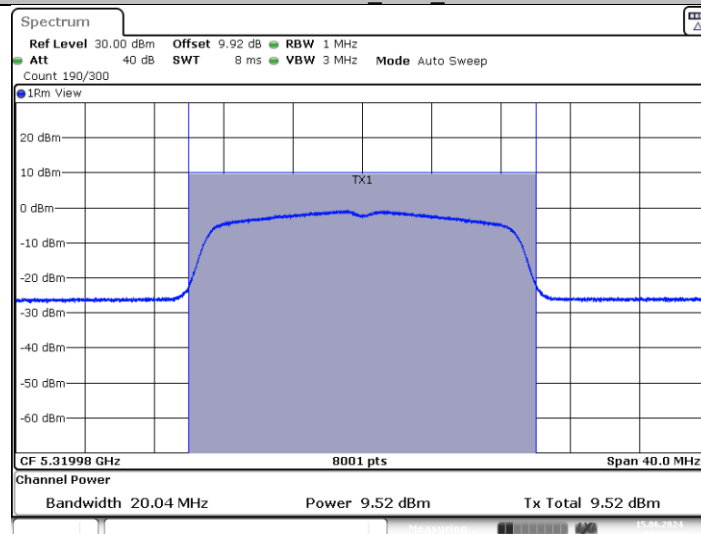


Date: 15.JUN.2024 13:43:26


11AC20SISO_Ant1_5500

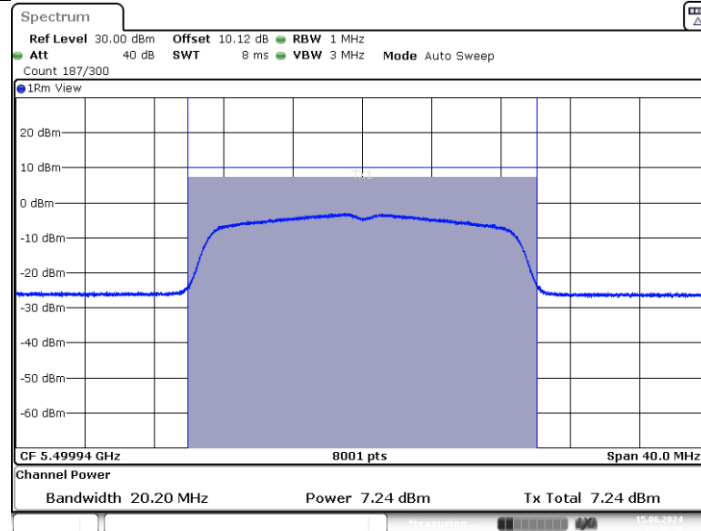


11AC20SISO_Ant1_5600

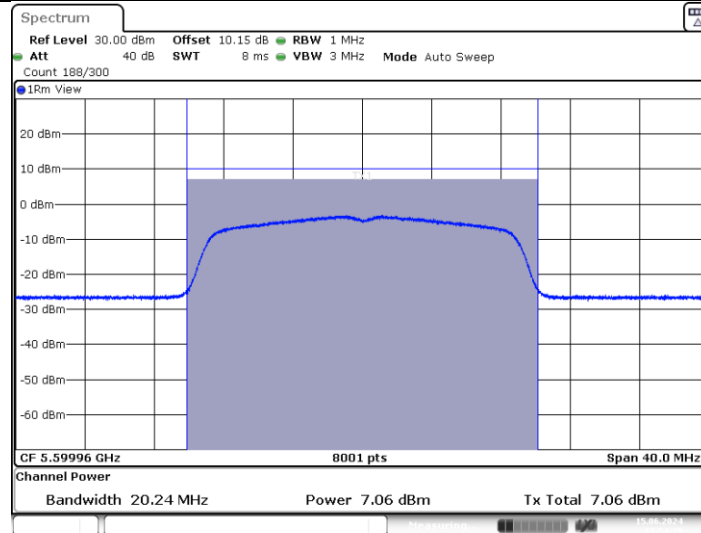


11AC20SISO_Ant1_5700

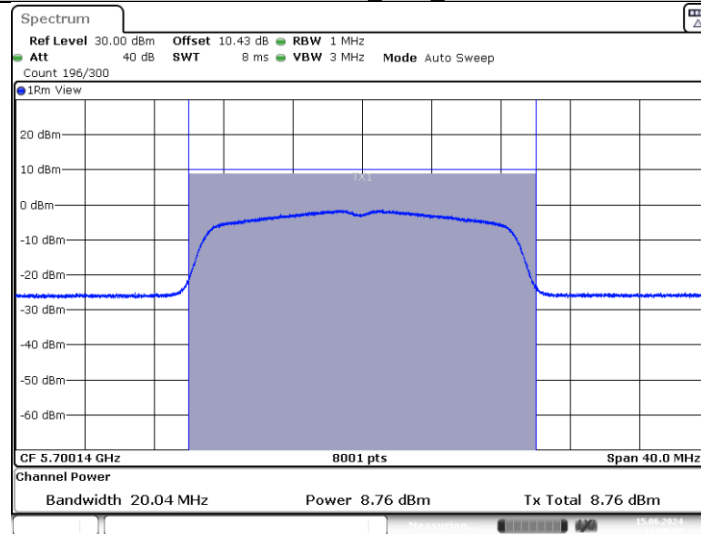


11AC20SISO_Ant1_5745

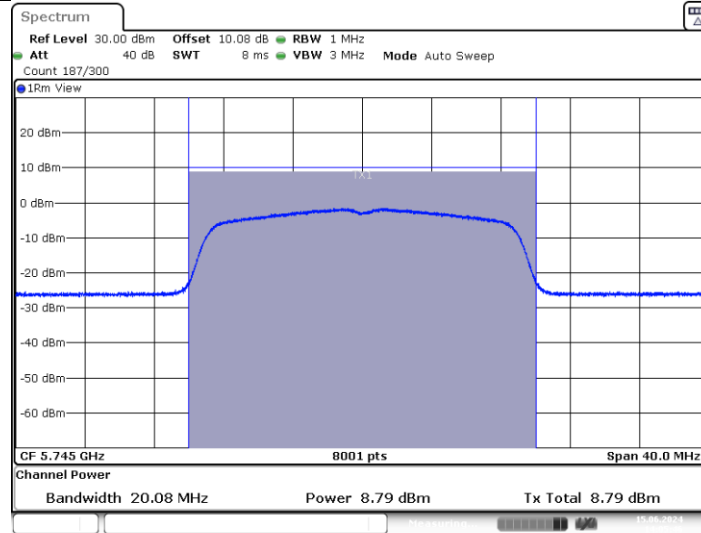


11AC20SISO_Ant1_5785

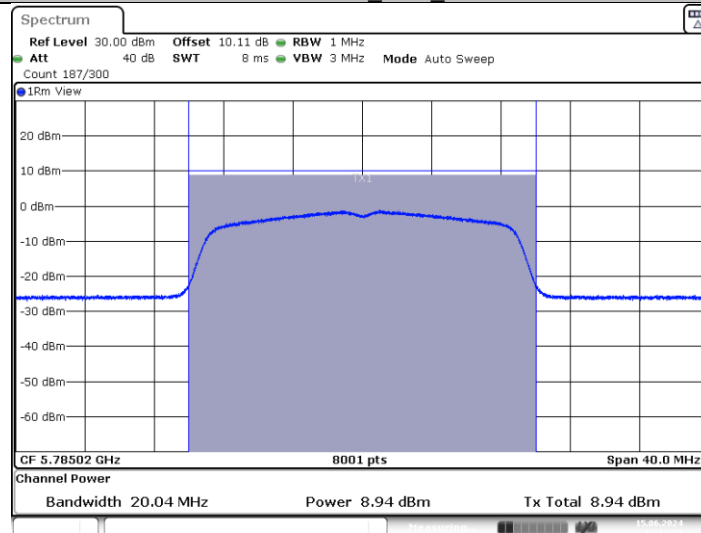

11AC20SISO_Ant1_5825

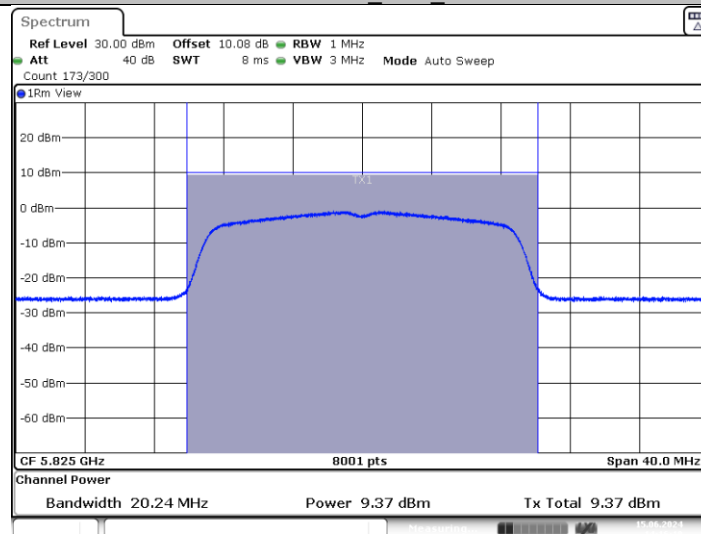


11AC40SISO_Ant1_5190

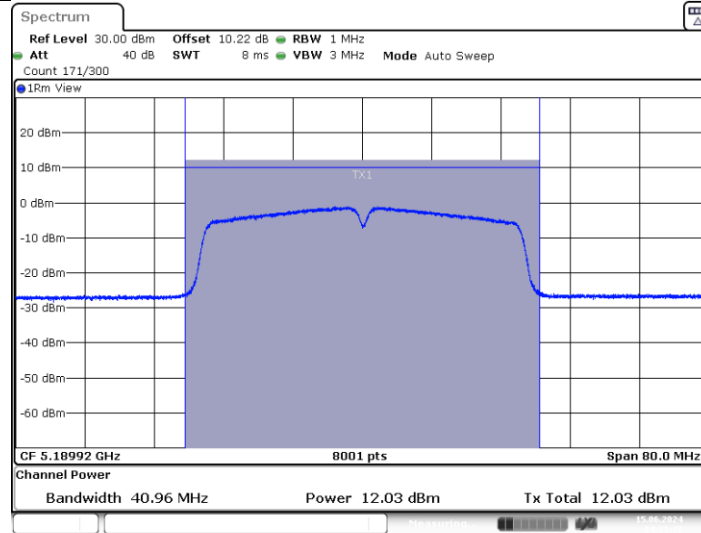


Date: 15.JUN.2024 14:21:31

11AC40SISO_Ant1_5230

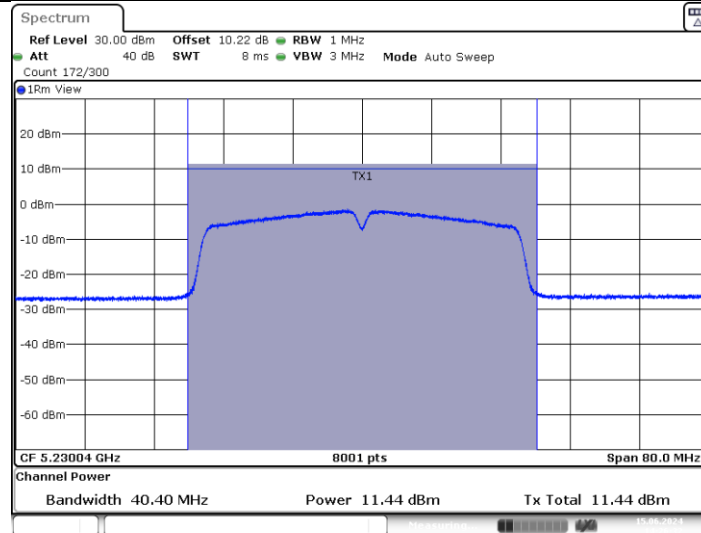


Date: 15.JUN.2024 14:26:32

11AC40SISO_Ant1_5270

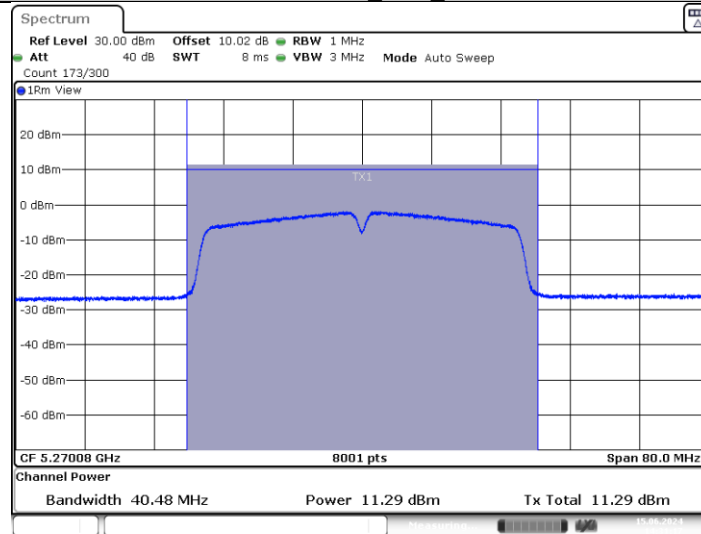


Date: 15.JUN.2024 14:31:17


11AC40SISO_Ant1_5310

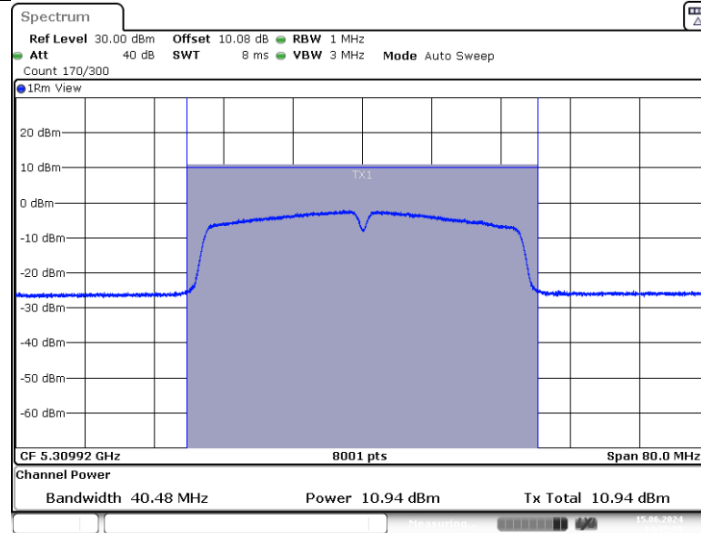


11AC40SISO_Ant1_5510

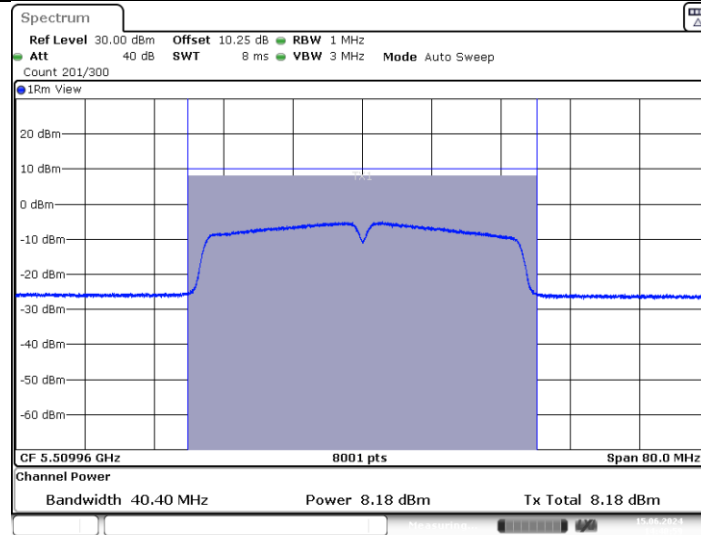

11AC40SISO_Ant1_5590

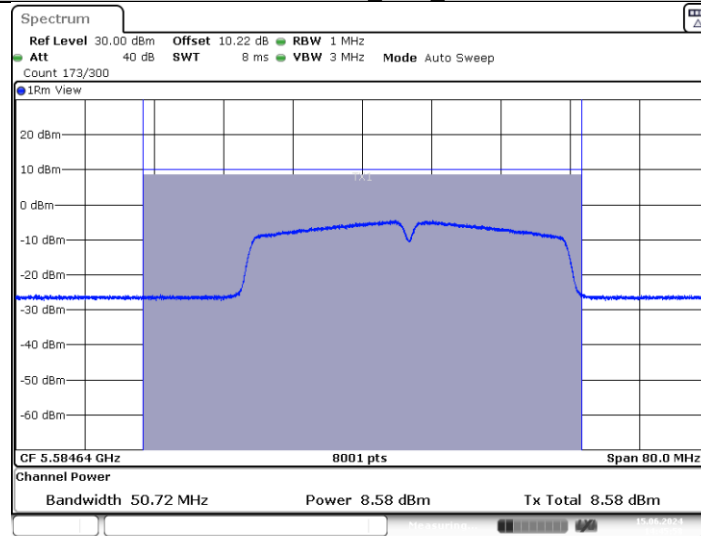


11AC40SISO_Ant1_5670

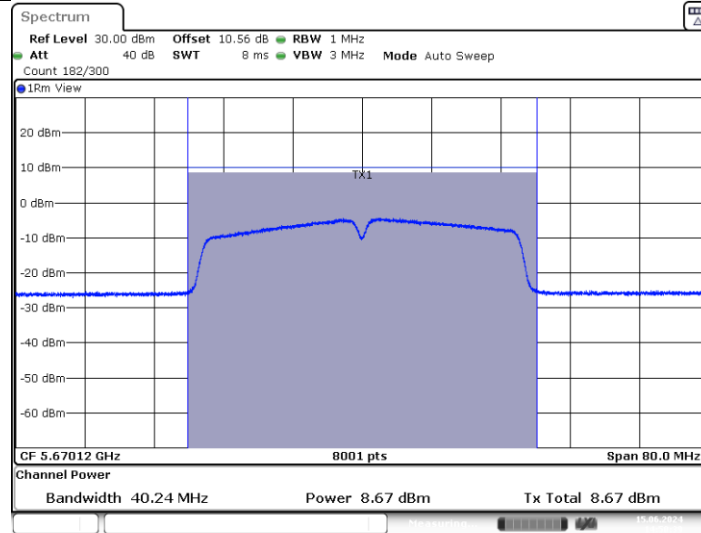


Date: 15.JUN.2024 14:50:38

11AC40SISO_Ant1_5755

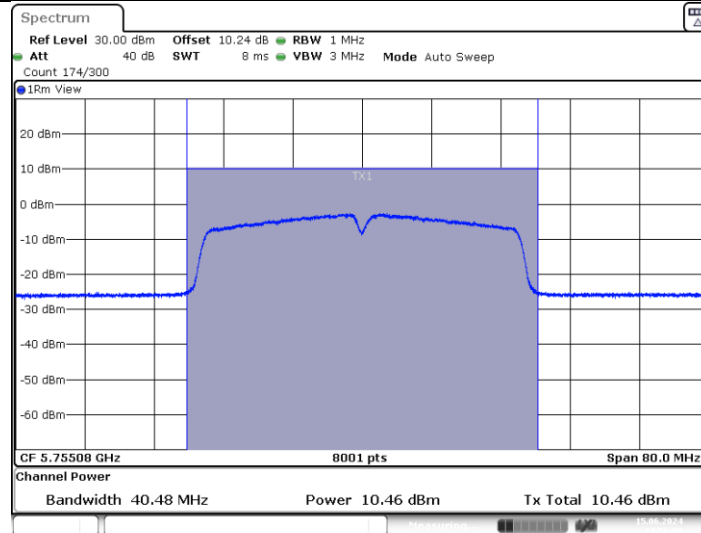


Date: 15.JUN.2024 14:56:00

11AC40SISO_Ant1_5795

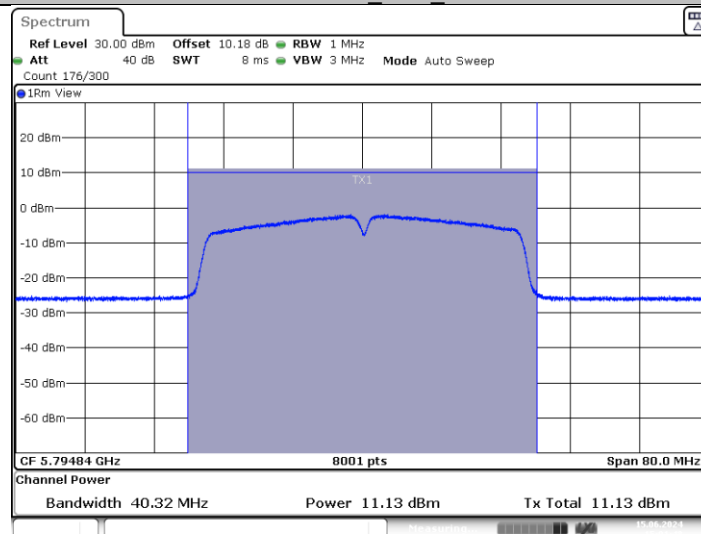


Date: 15.JUN.2024 15:01:48


11AC80SISO_Ant1_5210


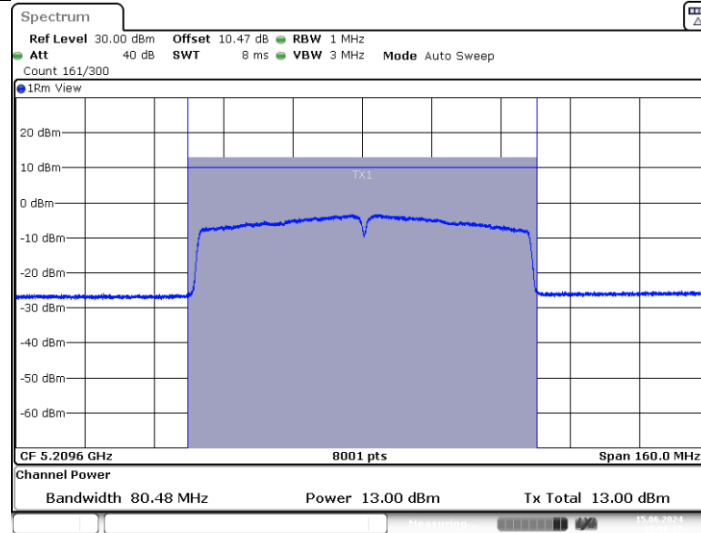


11AC80SISO_Ant1_5290

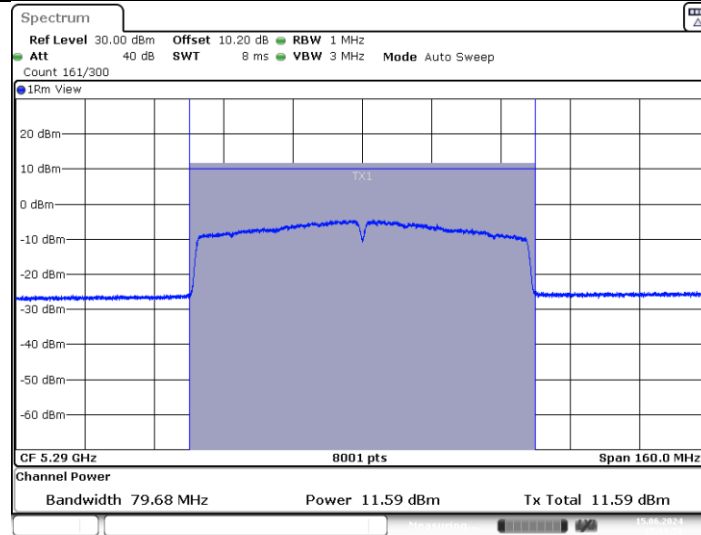

11AC80SISO_Ant1_5530

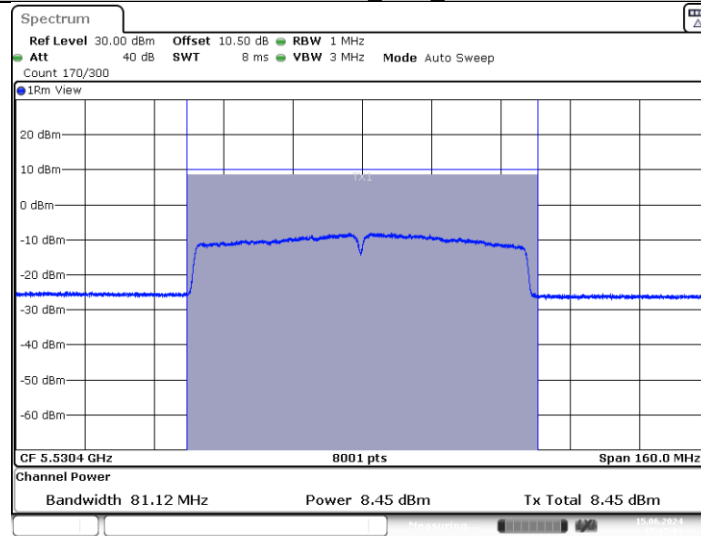

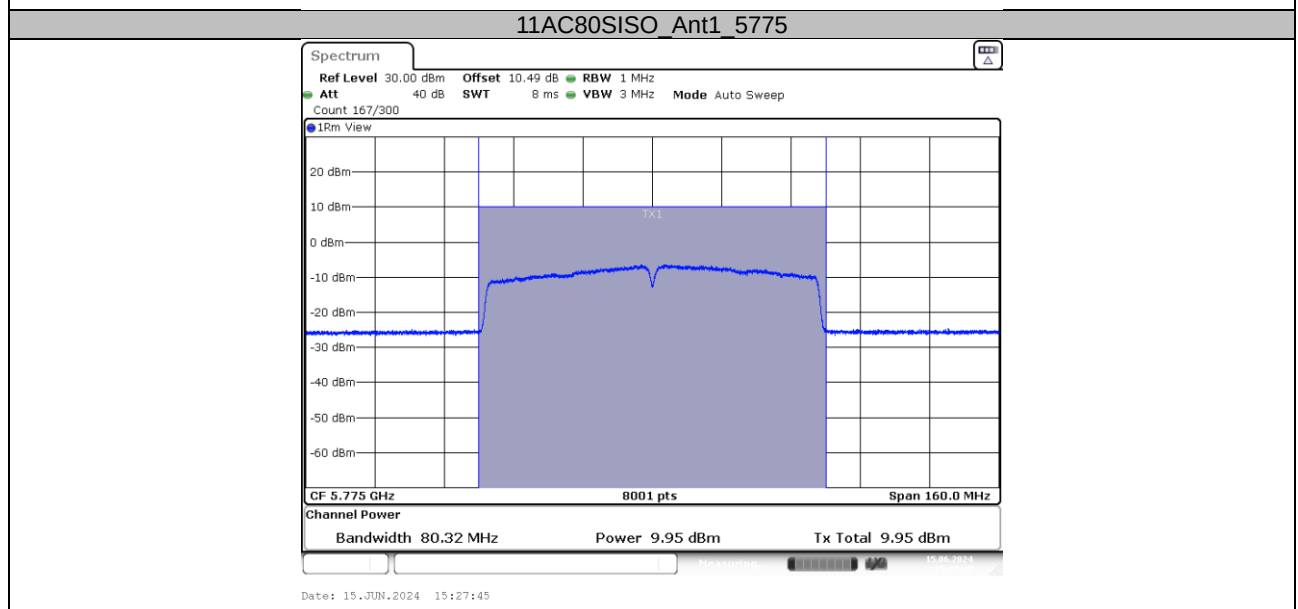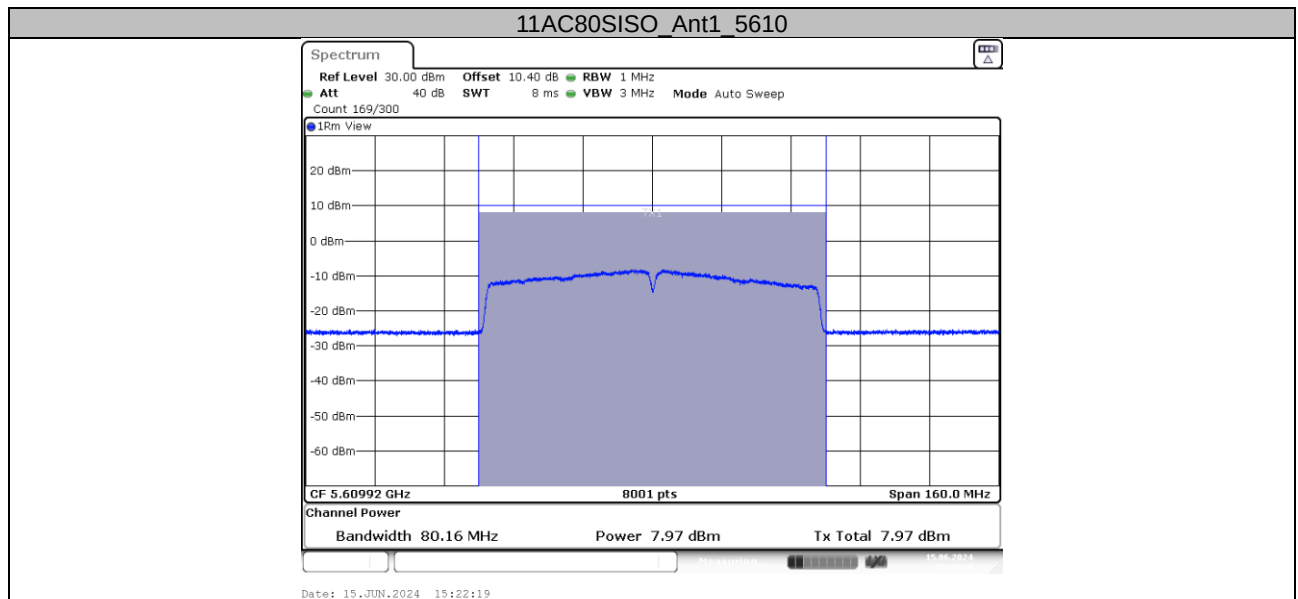


APPENDIXG - POWER SPECTRAL DENSITY


TestMode	Antenna	Freq(MHz)	Result [dBm/MHz]	Limit[dBm/MHz]	Verdict
11A	Ant1	5180	1.86	≤11.00	PASS
		5200	1.31	≤11.00	PASS
		5240	1.11	≤11.00	PASS
		5260	0.18	≤11.00	PASS
		5300	-0.14	≤11.00	PASS
		5320	-0.71	≤11.00	PASS
		5500	-3.07	≤11.00	PASS
		5600	-2.72	≤11.00	PASS
		5700	-0.91	≤11.00	PASS
		5745	-4.02	≤30.00	PASS
		5785	-3.35	≤30.00	PASS
		5825	-2.85	≤30.00	PASS
11N20SISO	Ant1	5180	1.85	≤11.00	PASS
		5200	1.35	≤11.00	PASS
		5240	1.07	≤11.00	PASS
		5260	0.20	≤11.00	PASS
		5300	-0.19	≤11.00	PASS
		5320	-0.07	≤11.00	PASS
		5500	-2.93	≤11.00	PASS
		5600	-2.73	≤11.00	PASS
		5700	-0.85	≤11.00	PASS
		5745	-3.77	≤30.00	PASS
		5785	-3.44	≤30.00	PASS
		5825	-3.02	≤30.00	PASS
11N40SISO	Ant1	5190	-1.18	≤11.00	PASS
		5230	-1.31	≤11.00	PASS
		5270	-1.81	≤11.00	PASS
		5310	-2.66	≤11.00	PASS
		5510	-5.29	≤11.00	PASS
		5590	-5.65	≤11.00	PASS
		5670	-4.48	≤11.00	PASS
		5755	-7.23	≤30.00	PASS
		5795	-6.88	≤30.00	PASS
11AC20SISO	Ant1	5180	2.10	≤11.00	PASS
		5200	0.45	≤11.00	PASS
		5240	0.86	≤11.00	PASS
		5260	-0.68	≤11.00	PASS
		5300	-0.78	≤11.00	PASS
		5320	-1.08	≤11.00	PASS
		5500	-4.03	≤11.00	PASS
		5600	-3.95	≤11.00	PASS
		5700	-2.01	≤11.00	PASS
		5745	-5.01	≤30.00	PASS
		5785	-4.24	≤30.00	PASS
11AC40SISO	Ant1	5190	-1.52	≤11.00	PASS
		5230	-1.63	≤11.00	PASS
		5270	-2.32	≤11.00	PASS
		5310	-2.20	≤11.00	PASS
		5510	-5.65	≤11.00	PASS
		5590	-5.51	≤11.00	PASS
		5670	-5.45	≤11.00	PASS
		5755	-6.05	≤30.00	PASS
		5795	-5.72	≤30.00	PASS
11AC80SISO	Ant1	5210	-3.74	≤11.00	PASS
		5290	-5.11	≤11.00	PASS
		5530	-7.95	≤11.00	PASS
		5610	-8.53	≤11.00	PASS
		5775	-10.23	≤30.00	PASS

Note: 1.The Result and Limit Unit is dBm/500 kHz in the band 5.725–5.85 GHz.
2.The Duty Cycle Factor and RBW Factor is compensated in the graph.


11A_Ant1_5180

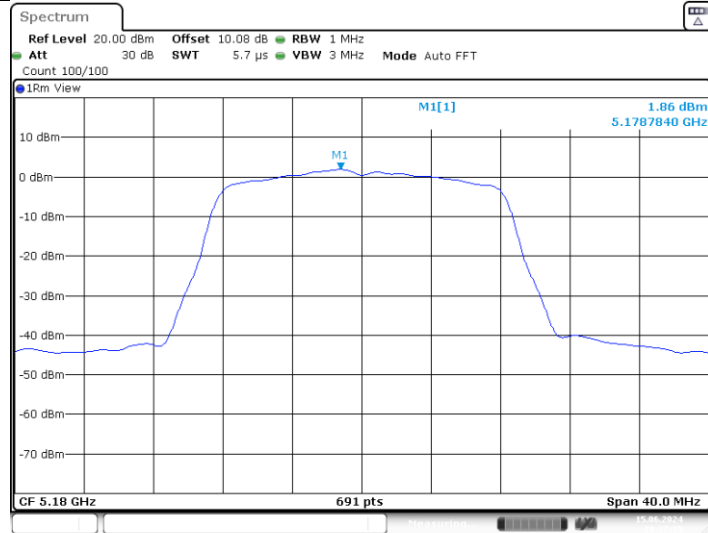


11A_Ant1_5200

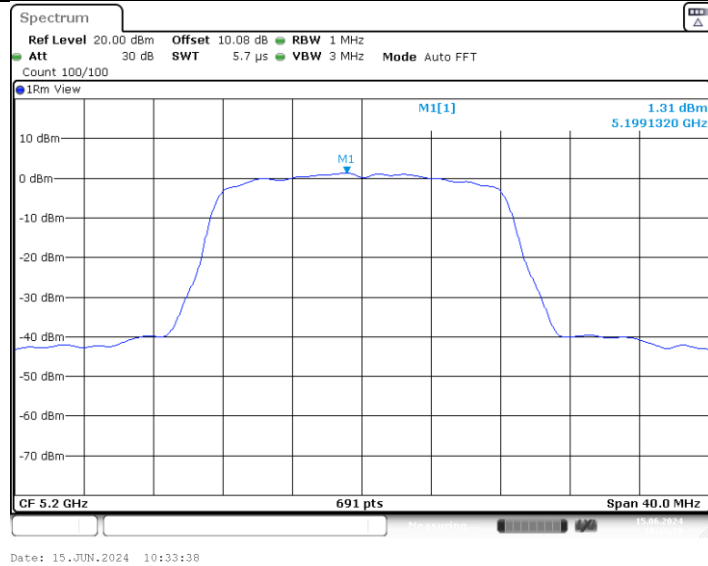


11A_Ant1_5240

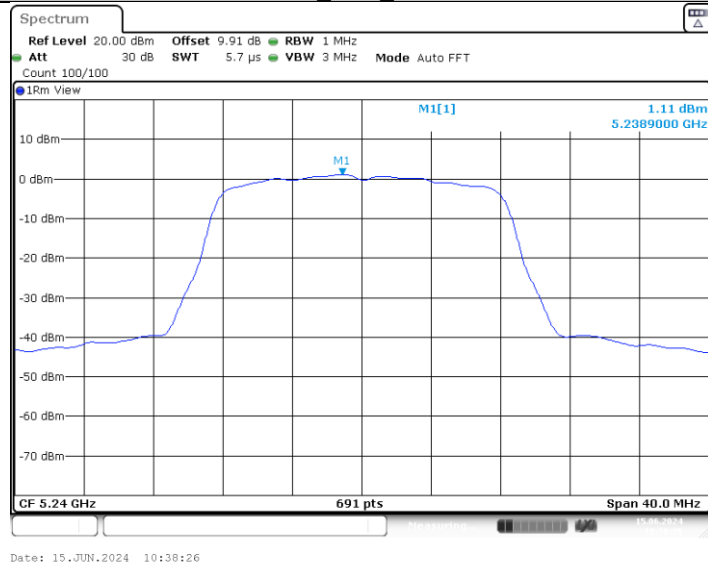


11A_Ant1_5260

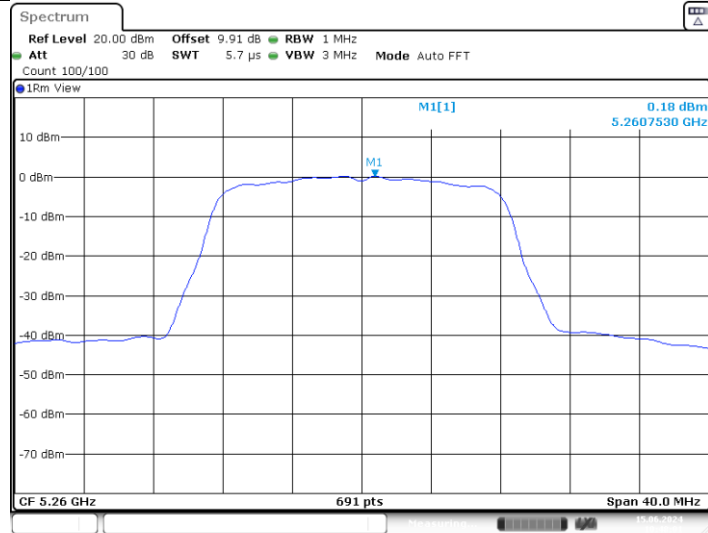


11A_Ant1_5300

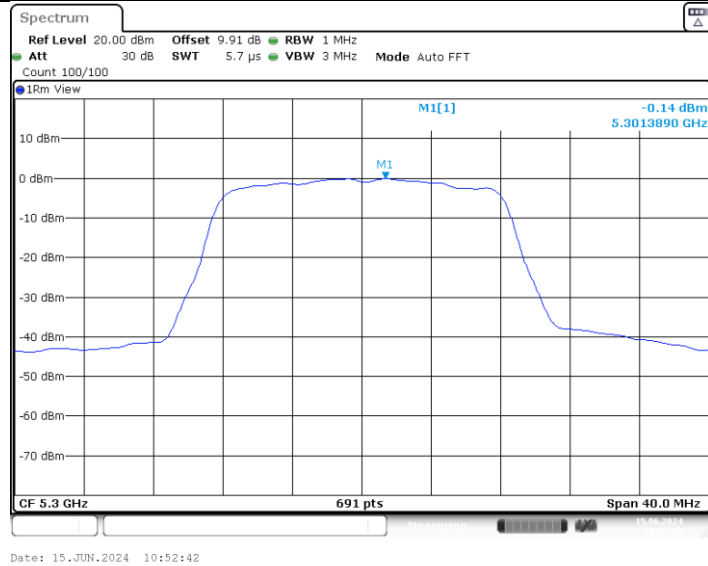


11A_Ant1_5320

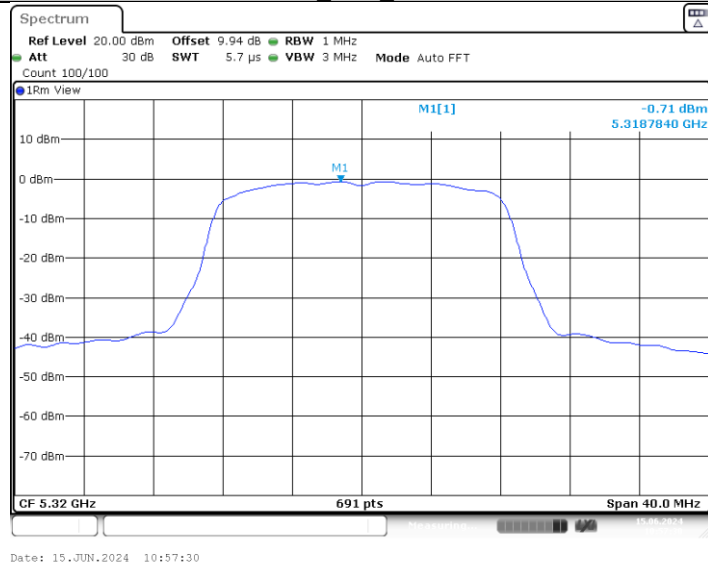


11A_Ant1_5500

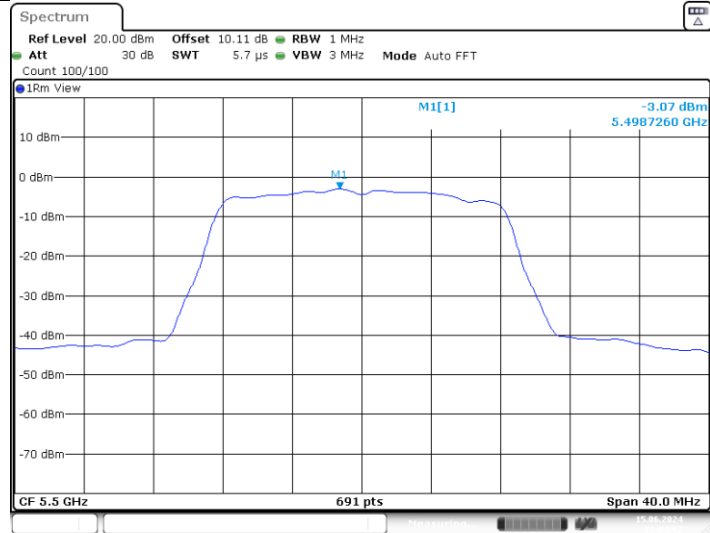


11A_Ant1_5600

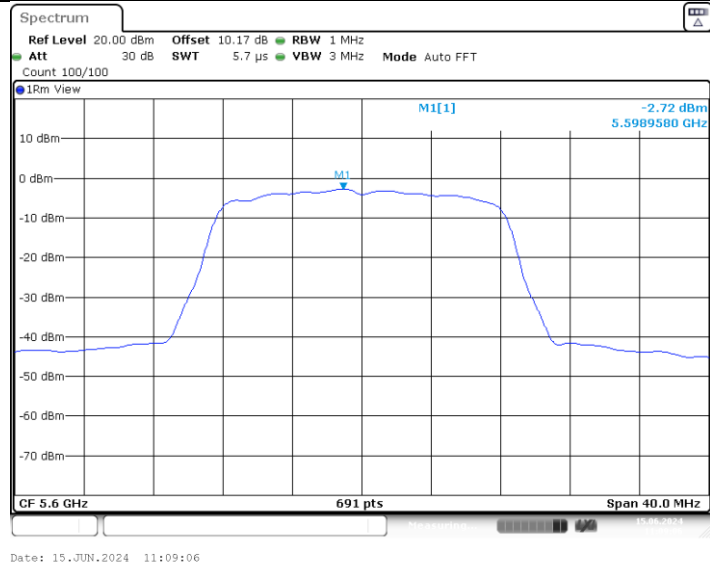


11A_Ant1_5700

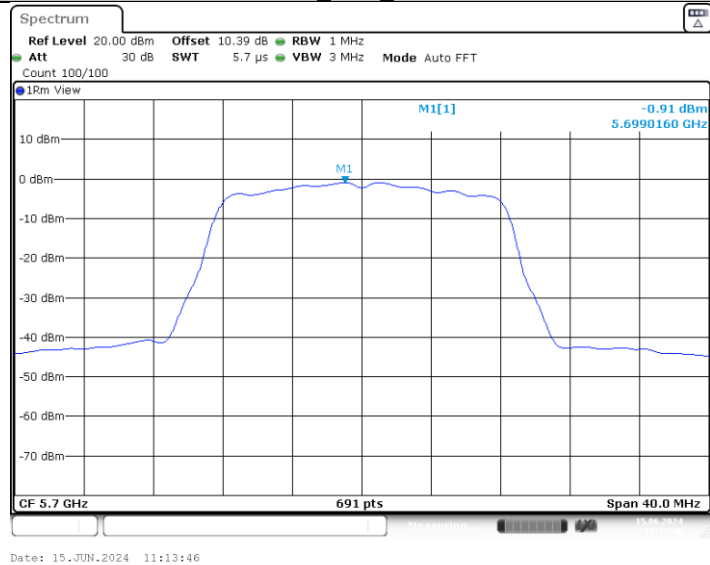

11A_Ant1_5745

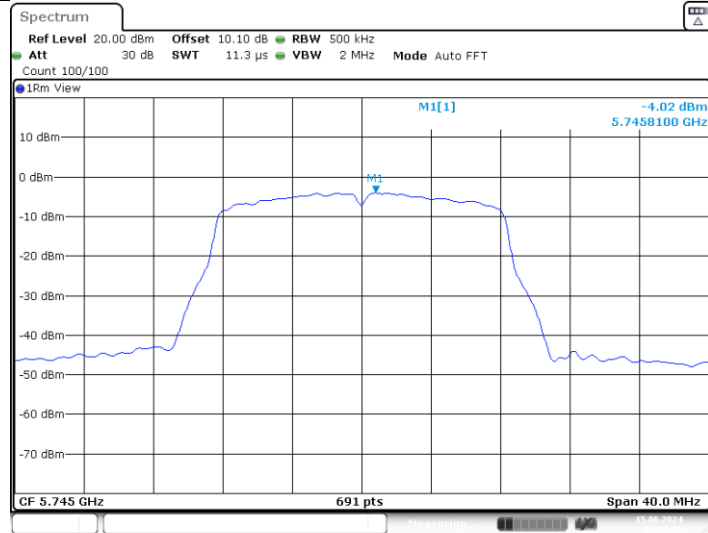


11A_Ant1_5785

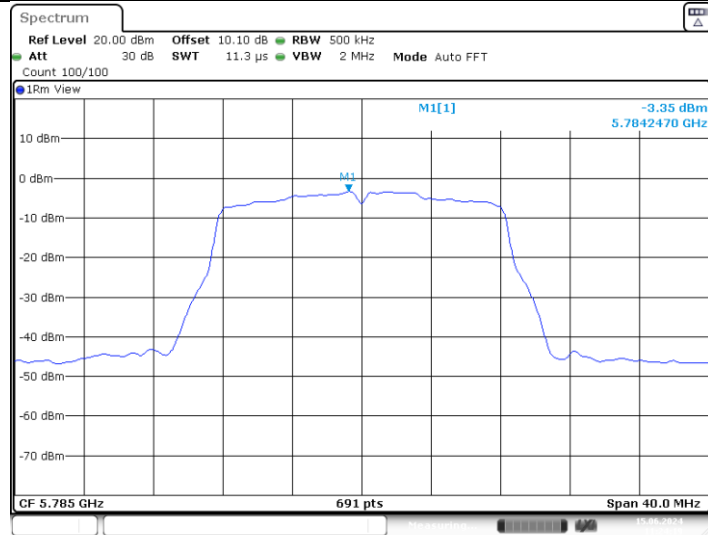


11A_Ant1_5825




11N20SISO_Ant1_5180

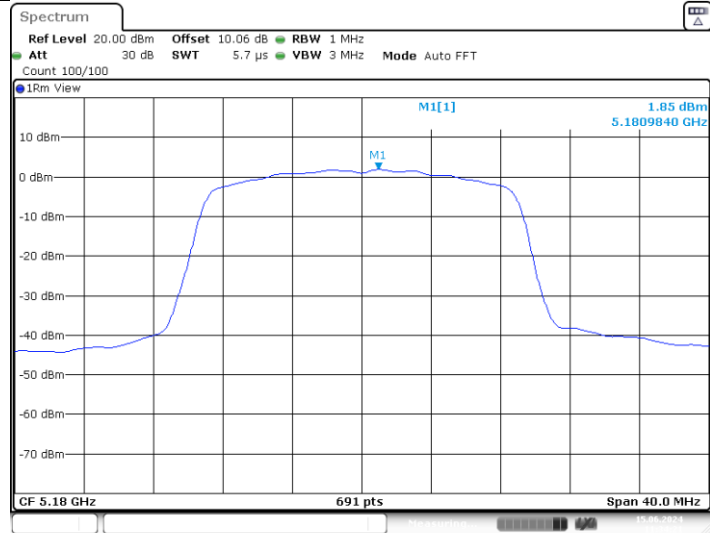


11N20SISO_Ant1_5200

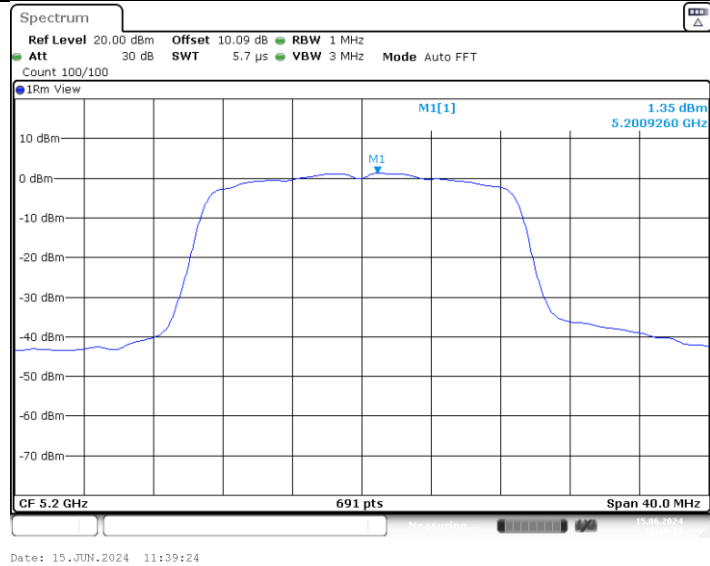


11N20SISO_Ant1_5240

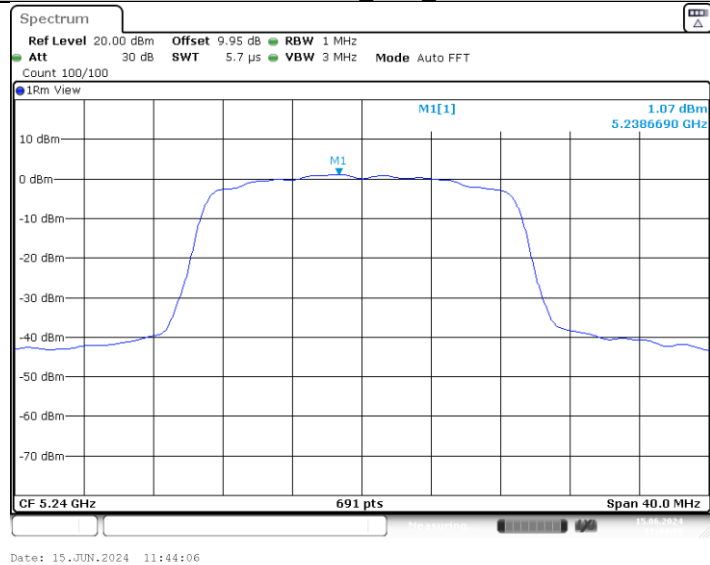


11N20SISO_Ant1_5260

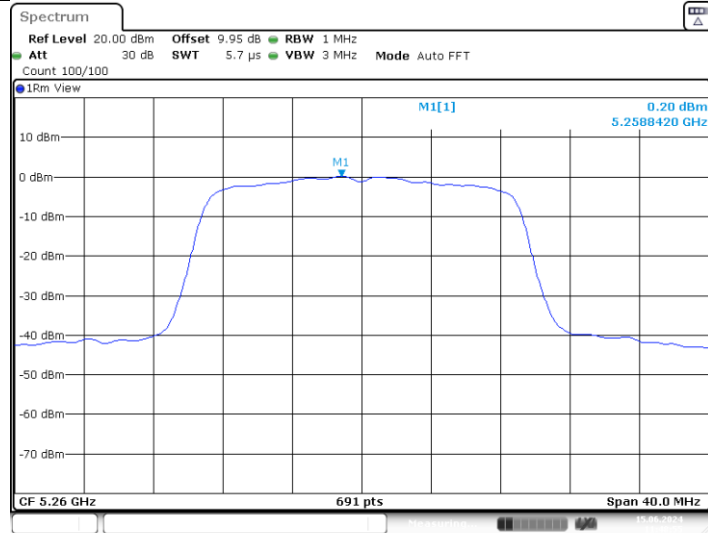


11N20SISO_Ant1_5300

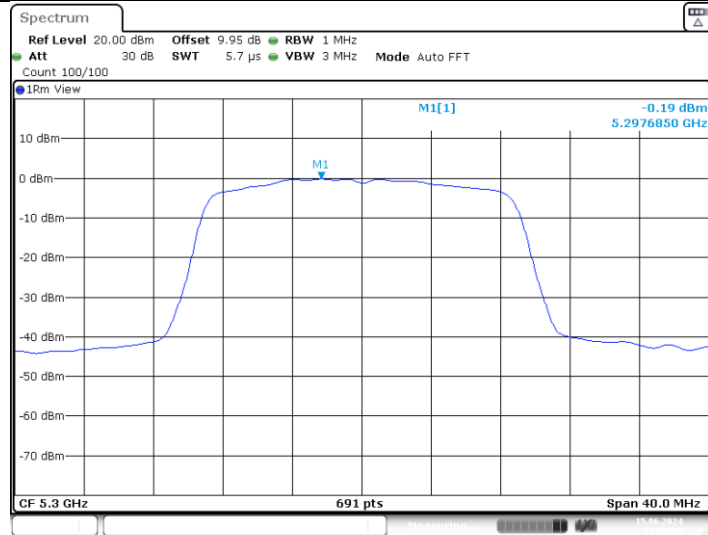


11N20SISO_Ant1_5320

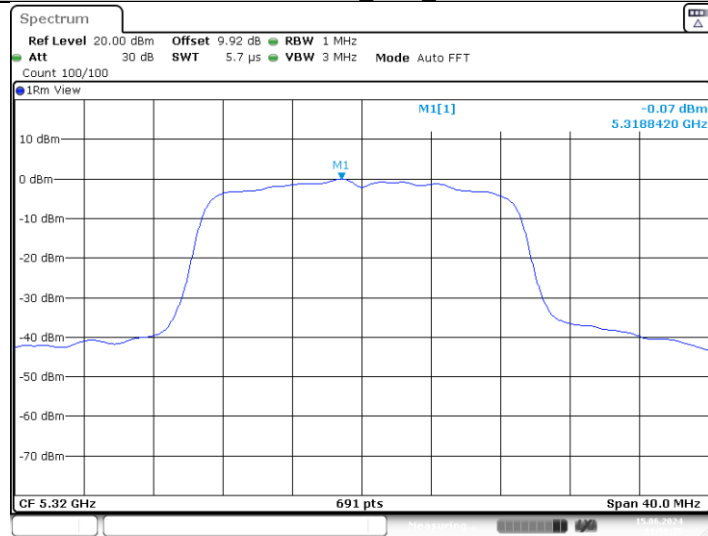


11N20SISO_Ant1_5500

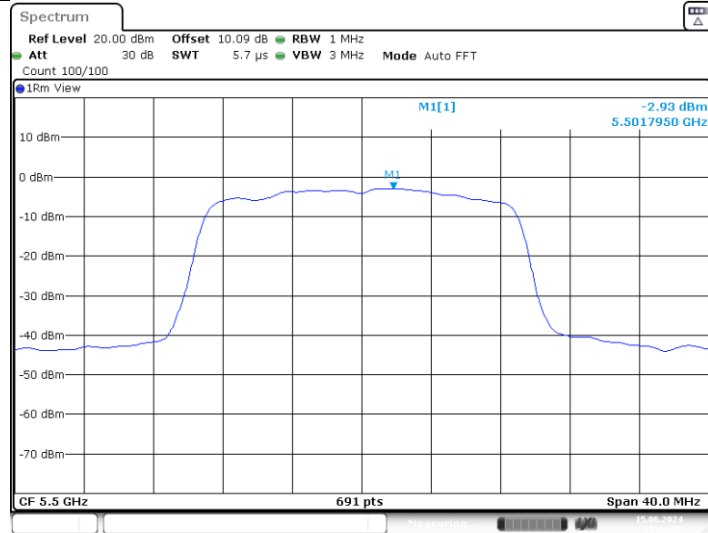


11N20SISO_Ant1_5600

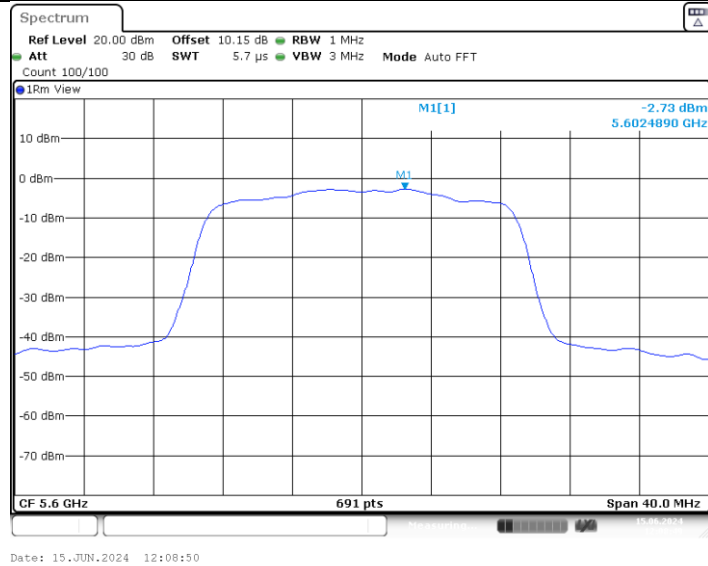

11N20SISO_Ant1_5700

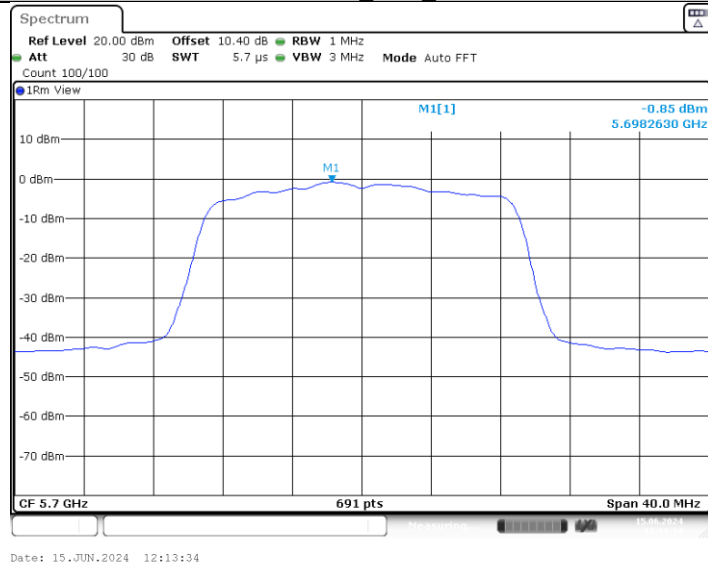


11N20SISO_Ant1_5745

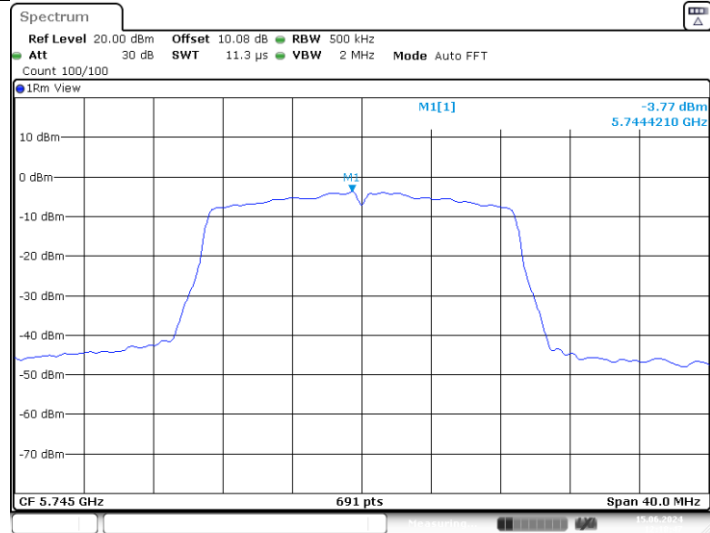


Date: 15.JUN.2024 12:18:47

11N20SISO_Ant1_5785

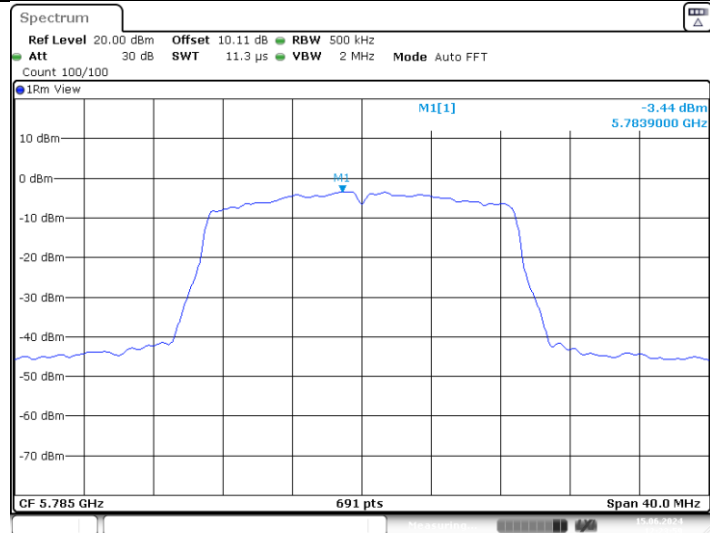


Date: 15.JUN.2024 12:23:59

11N20SISO_Ant1_5825

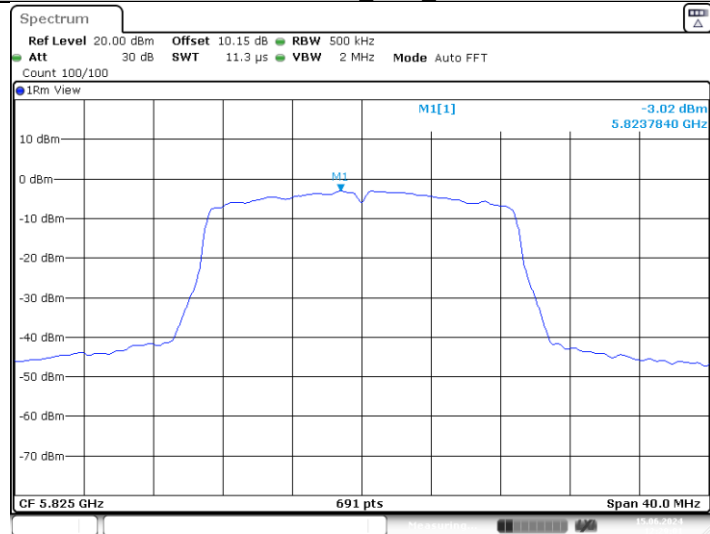


Date: 15.JUN.2024 12:29:01

11N40SISO_Ant1_5190

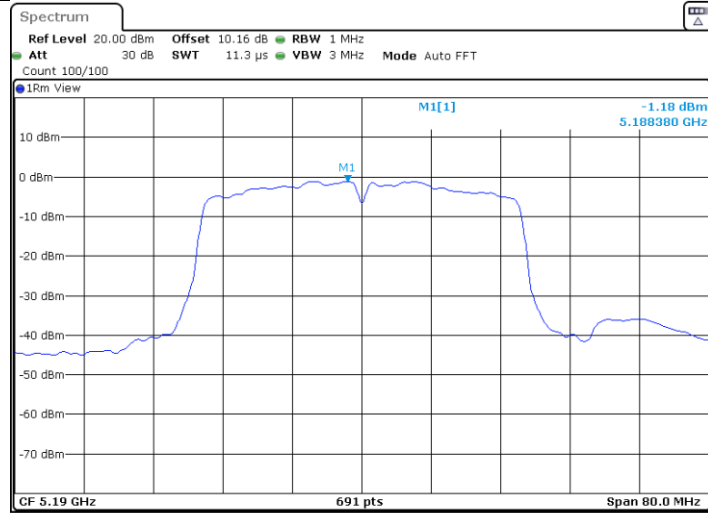


Date: 15.JUN.2024 12:34:15

11N40SISO_Ant1_5230

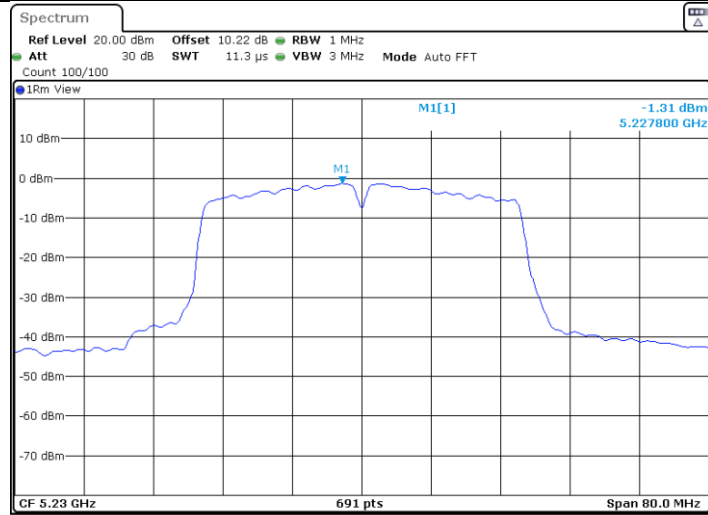

Date: 15.JUN.2024 12:39:18

11N40SISO_Ant1_5270

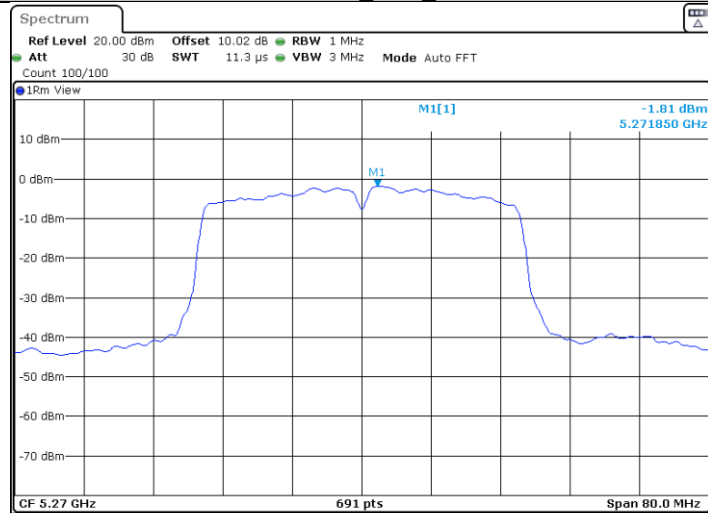


Date: 15.JUN.2024 12:43:59


11N40SISO_Ant1_5310




11N40SISO_Ant1_5510

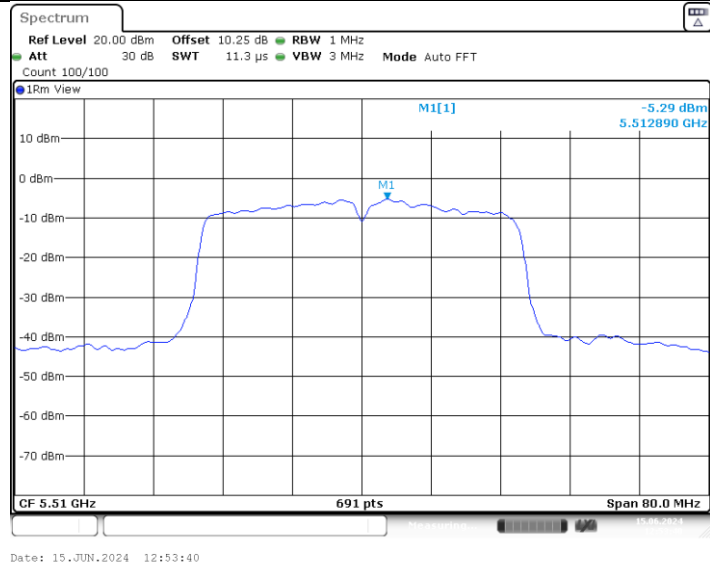


11N40SISO_Ant1_5590

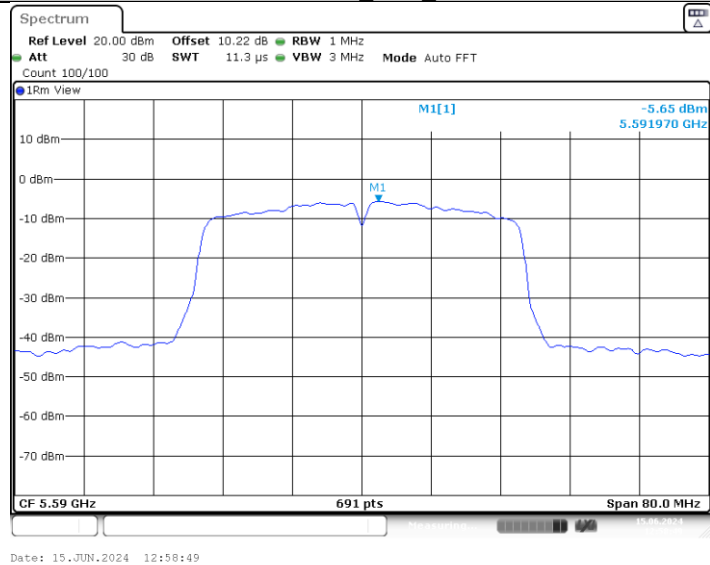


11N40SISO_Ant1_5670

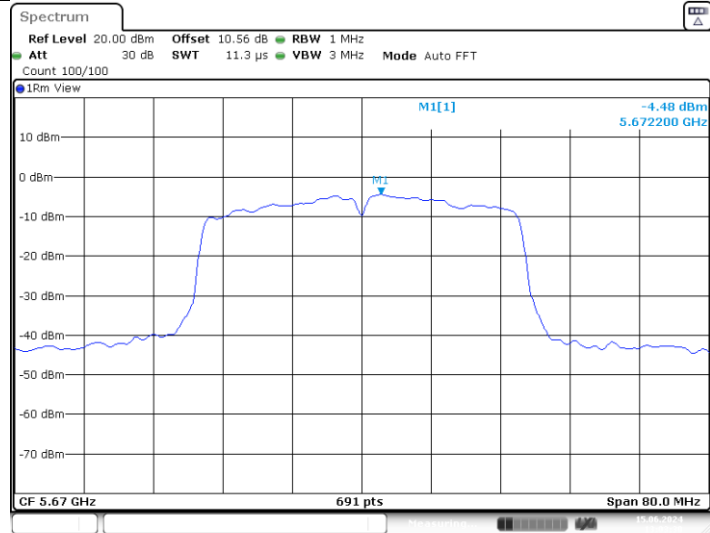


11N40SISO_Ant1_5755

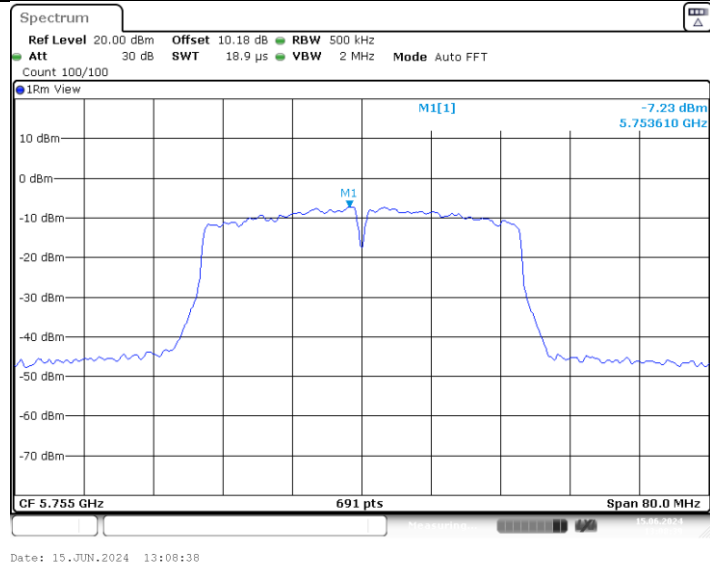


11N40SISO_Ant1_5795

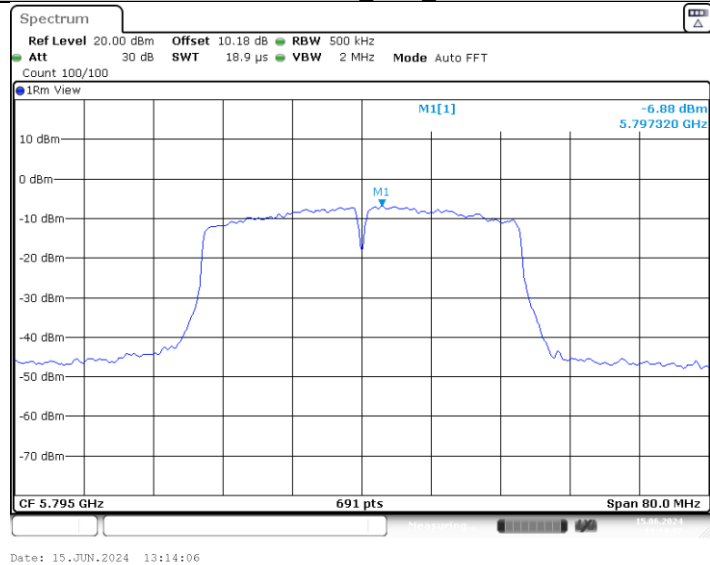


11AC20SISO_Ant1_5180

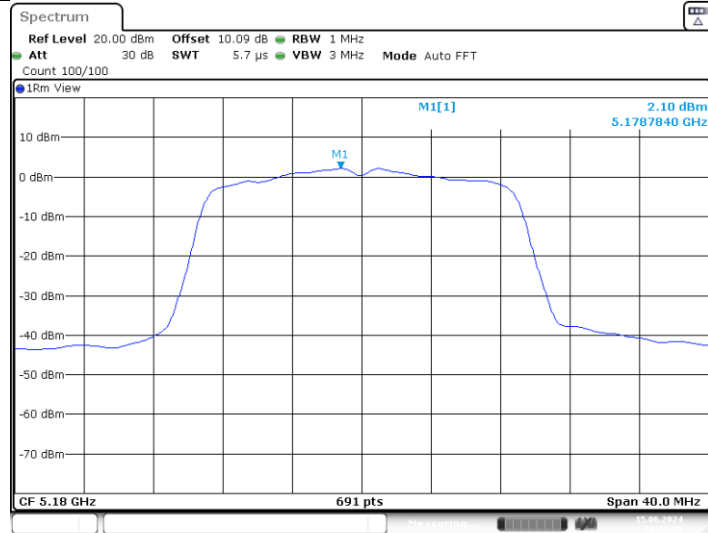


11AC20SISO_Ant1_5200

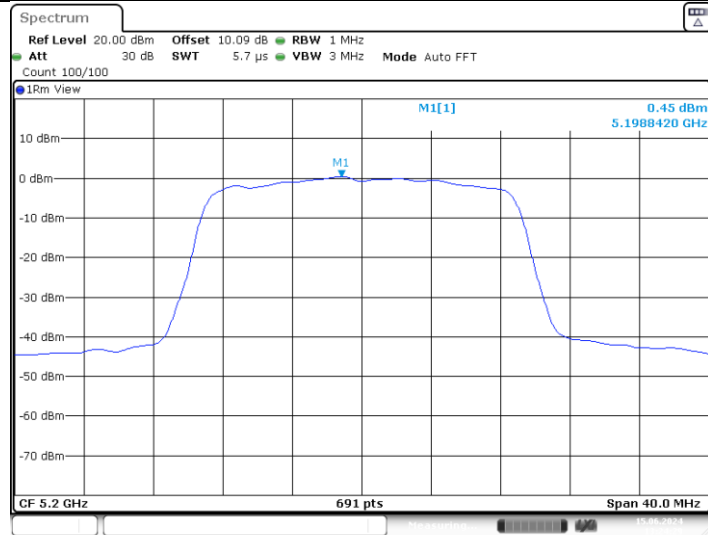

11AC20SISO_Ant1_5240

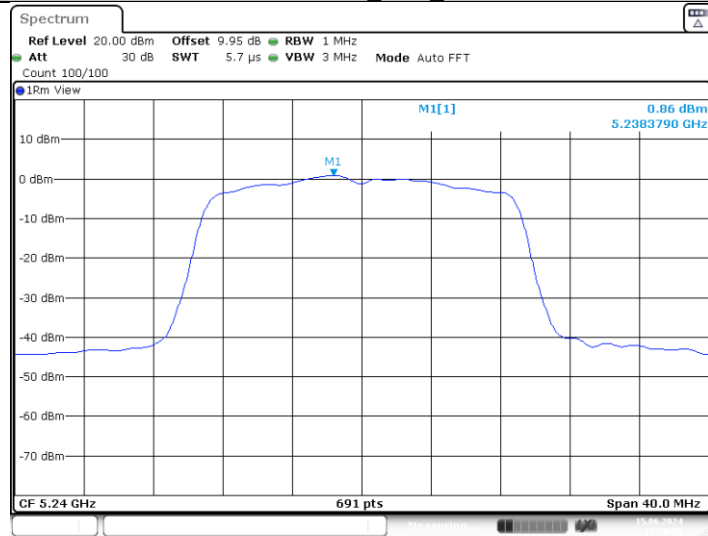


11AC20SISO_Ant1_5260

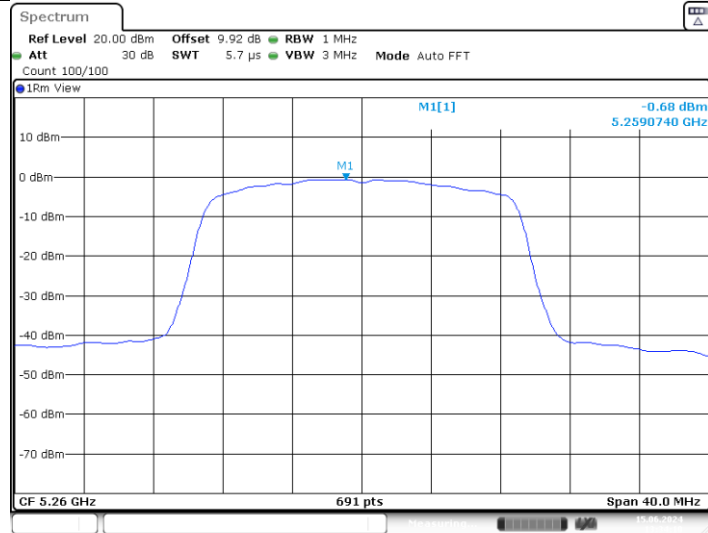


Date: 15.JUN.2024 13:34:10

11AC20SISO_Ant1_5300

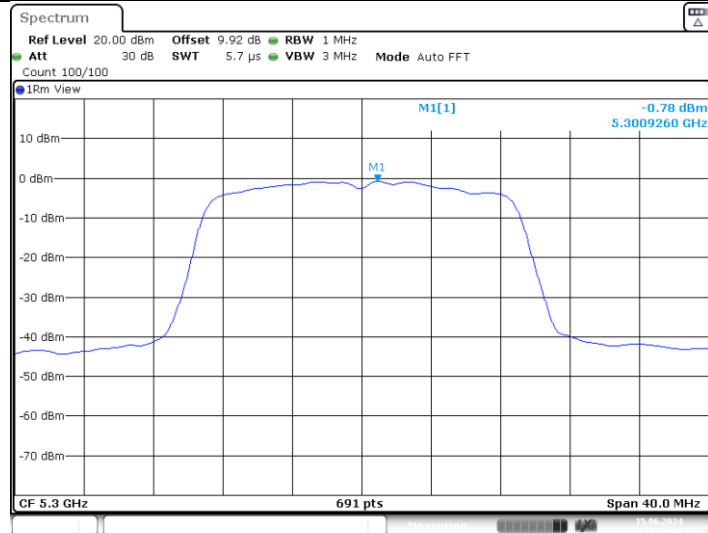


Date: 15.JUN.2024 13:38:48

11AC20SISO_Ant1_5320

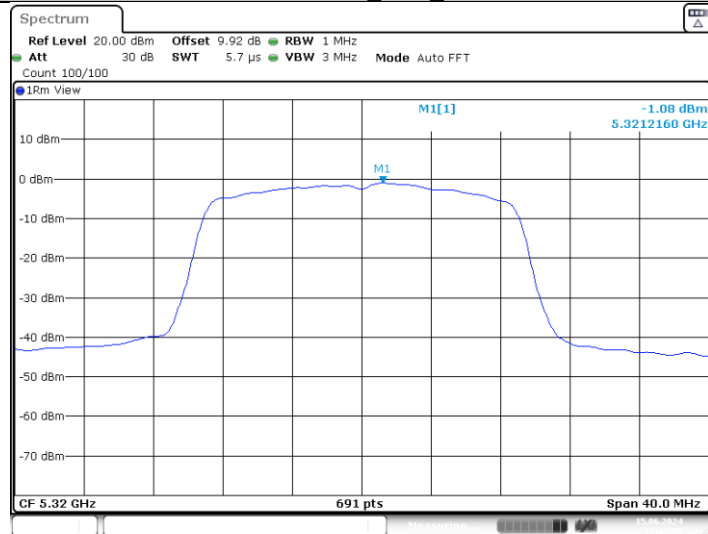


Date: 15.JUN.2024 13:43:34


11AC20SISO_Ant1_5500

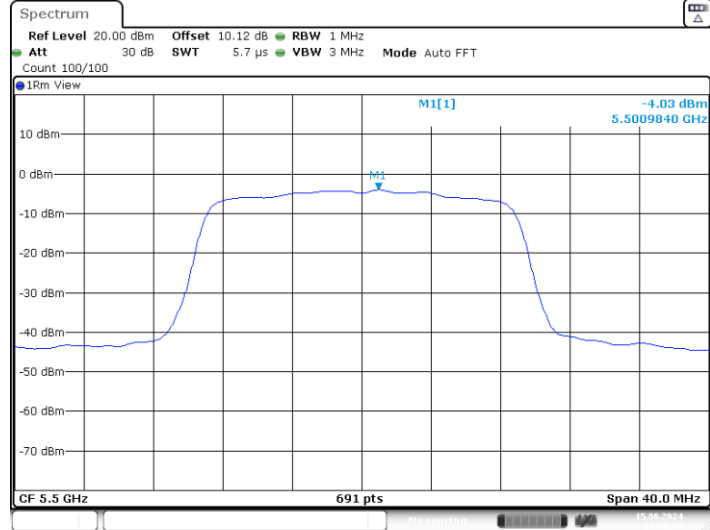


11AC20SISO_Ant1_5600

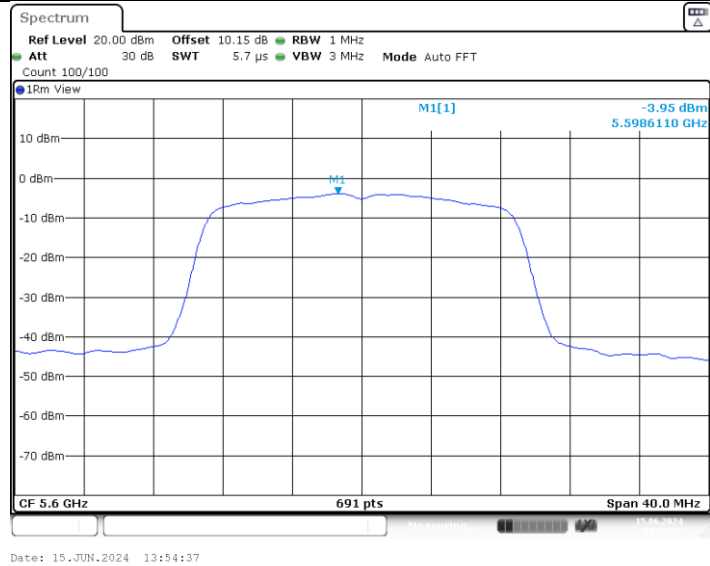


11AC20SISO_Ant1_5700

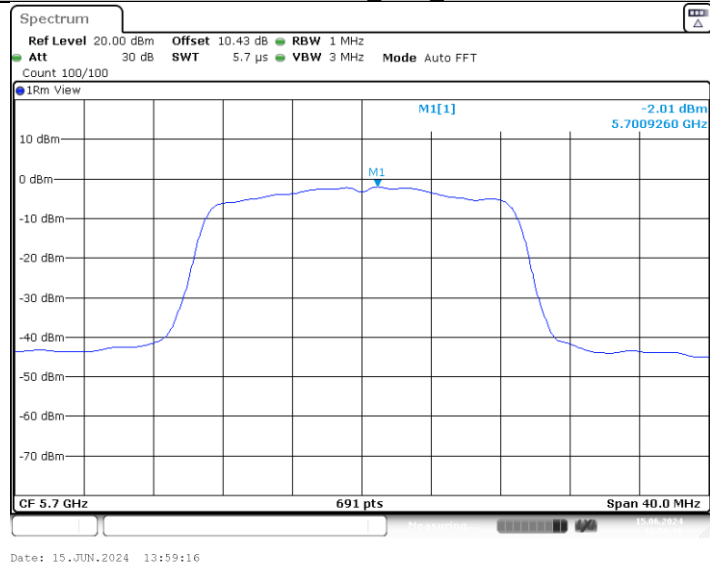


11AC20SISO_Ant1_5745

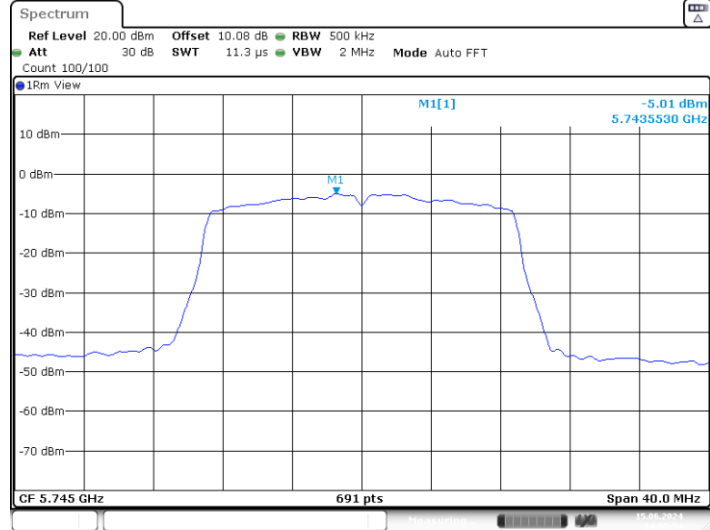


11AC20SISO_Ant1_5785

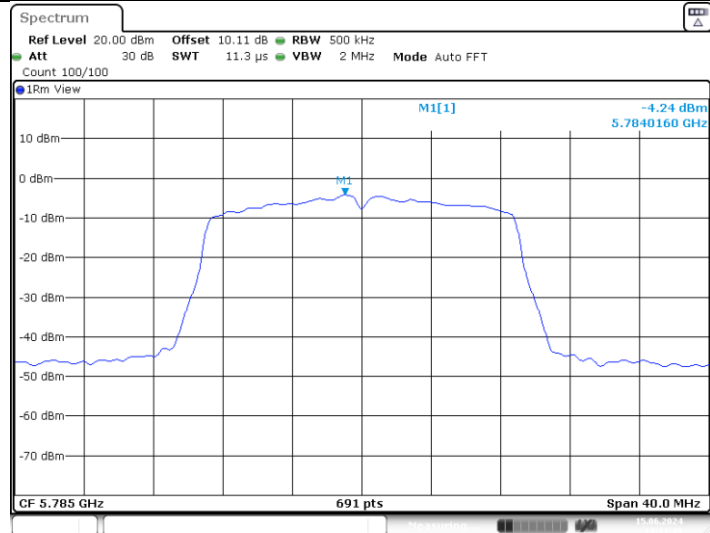


11AC20SISO_Ant1_5825

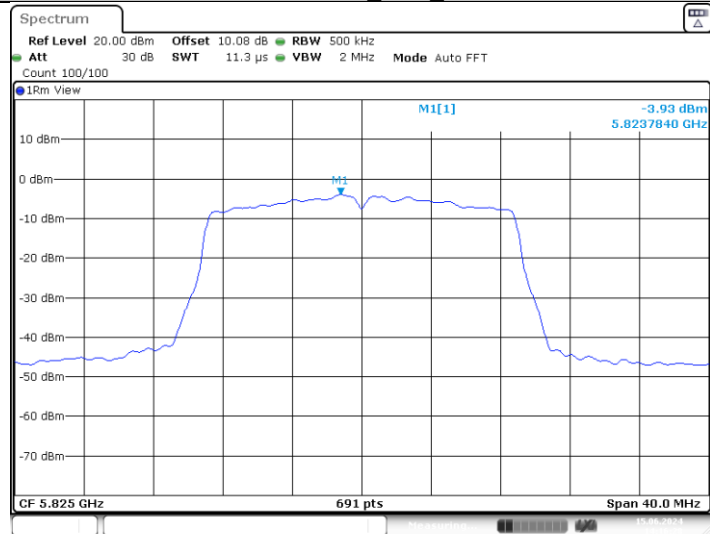


11AC40SISO_Ant1_5190

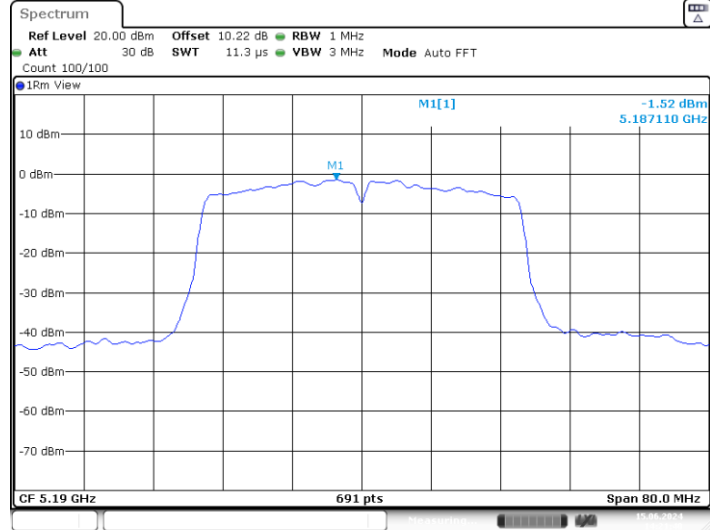

11AC40SISO_Ant1_5230

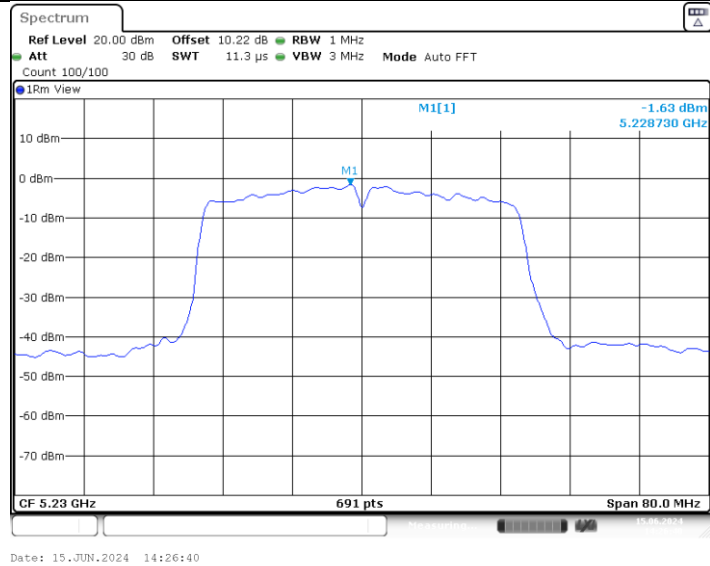


11AC40SISO_Ant1_5270

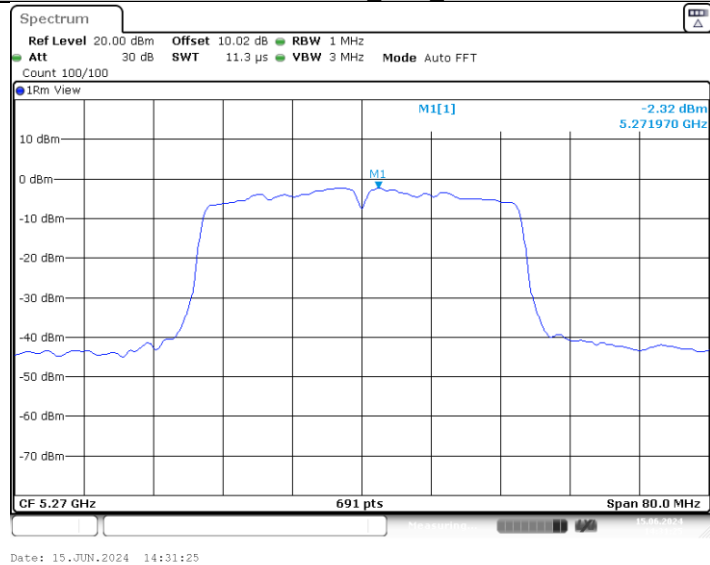


11AC40SISO_Ant1_5310




11AC40SISO_Ant1_5510

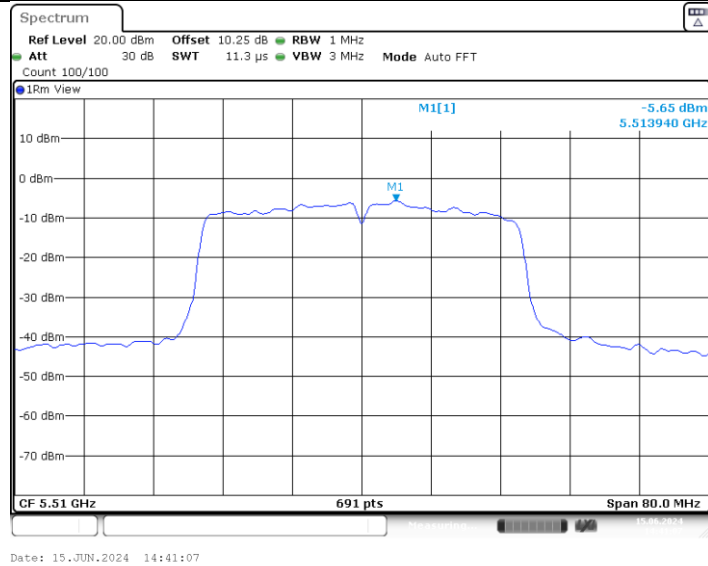


11AC40SISO_Ant1_5590

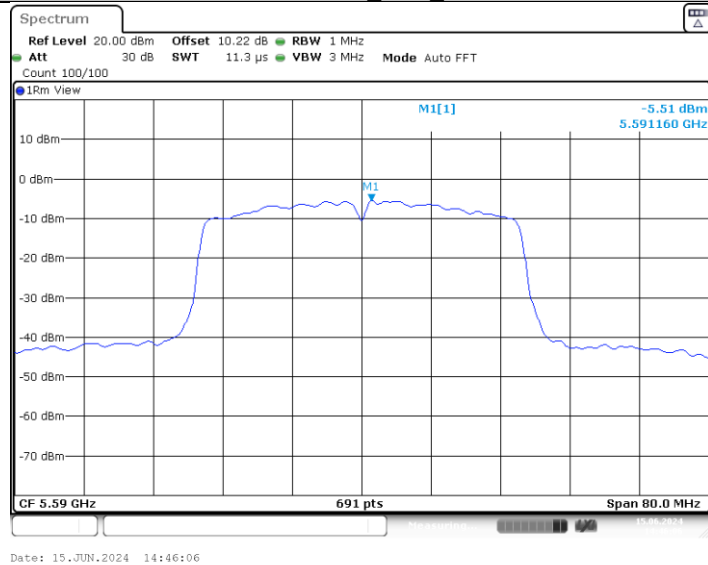


11AC40SISO_Ant1_5670

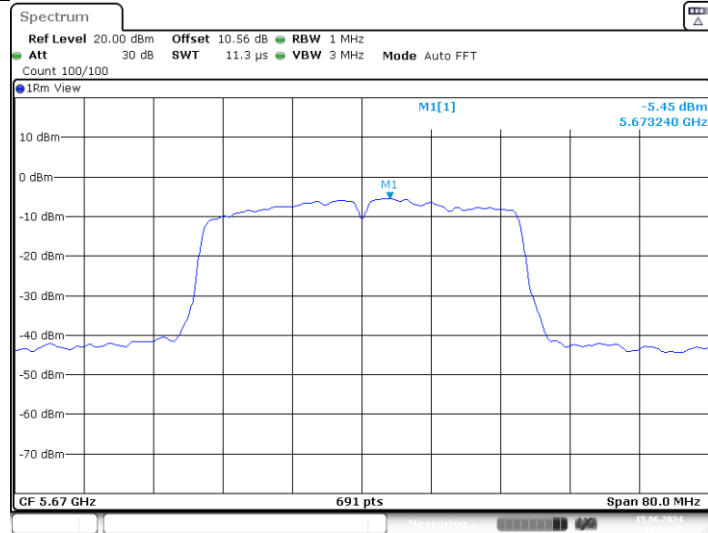


11AC40SISO_Ant1_5755

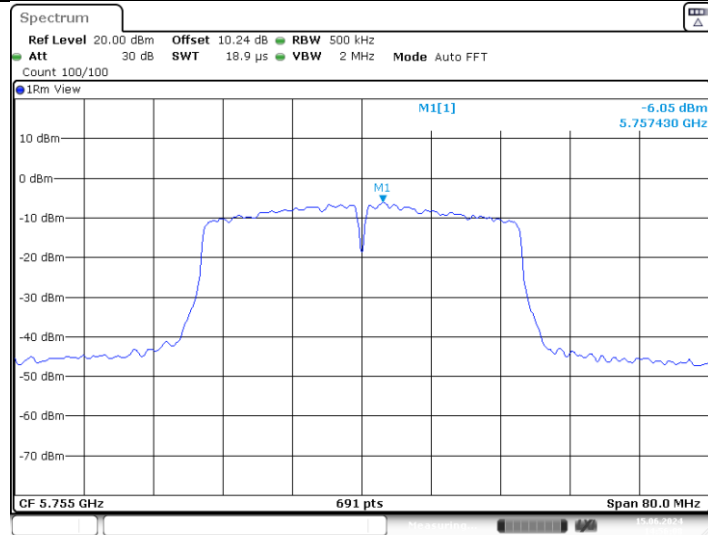


11AC40SISO_Ant1_5795

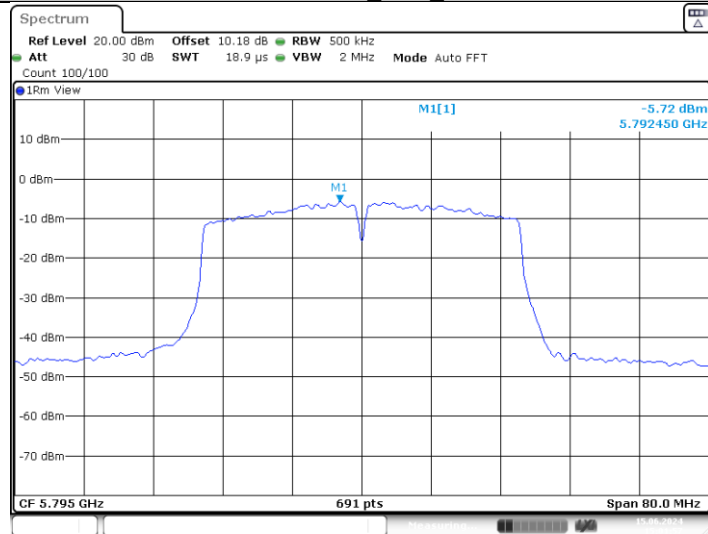


11AC80SISO_Ant1_5210

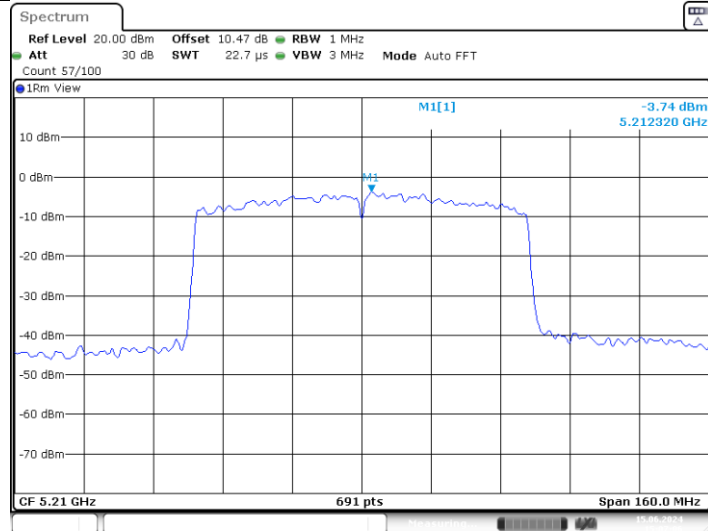


11AC80SISO_Ant1_5290

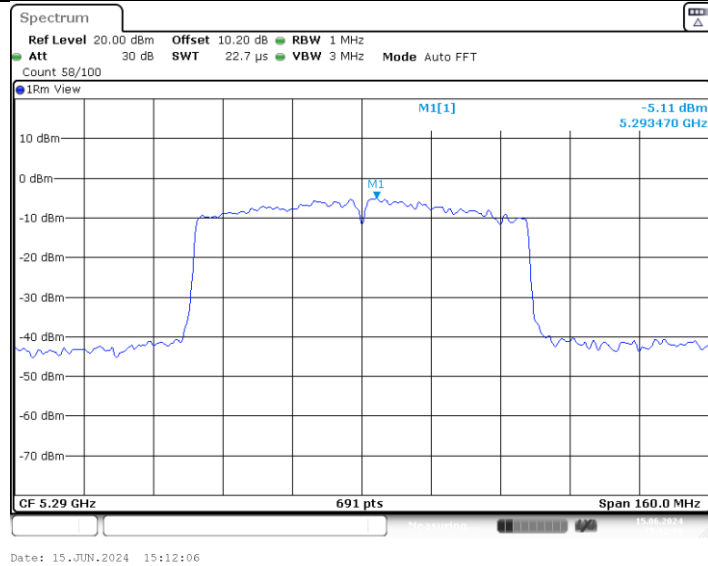

11AC80SISO_Ant1_5530

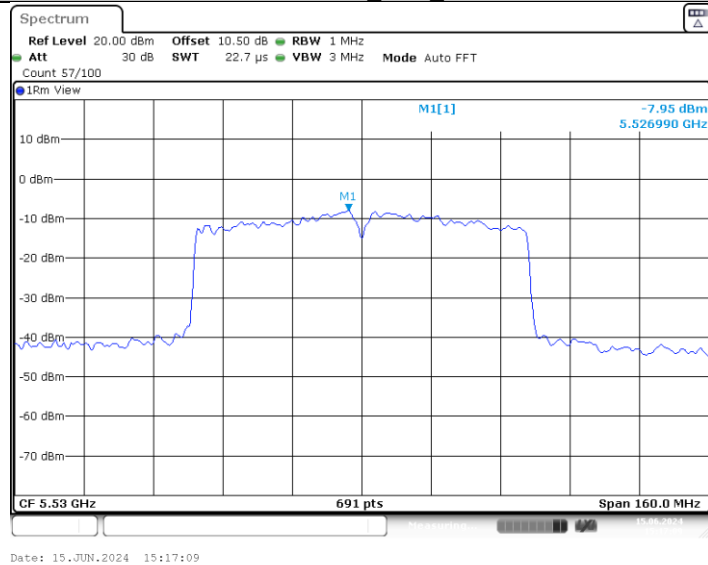


11AC80SISO_Ant1_5610

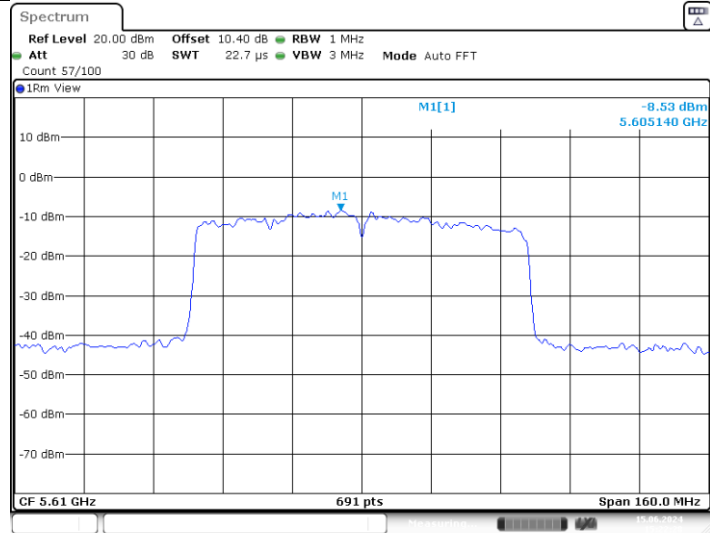

Date: 15.JUN.2024 15:22:28

11AC80SISO_Ant1_5775

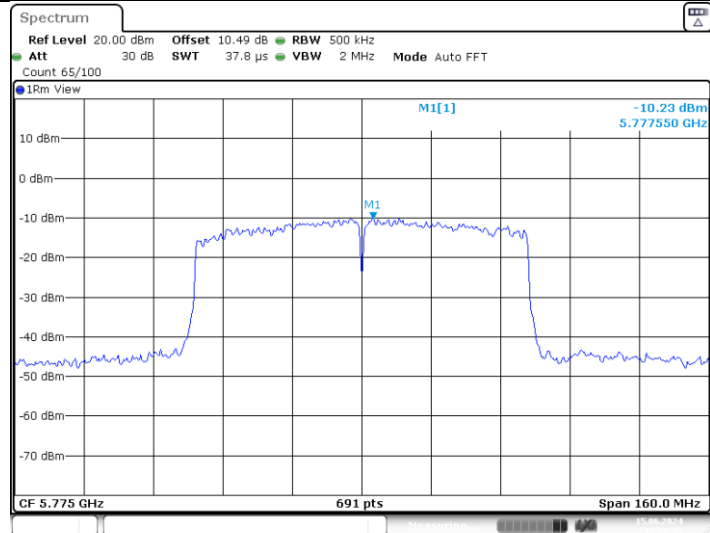

Date: 15.JUN.2024 15:27:53

APPENDIX H - Frequency Stability

TestMode	Antenna	Freq(MHz)	Voltage		Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
			Voltage [Vdc]	Temperature (°C)				
11A	Ant1	5180	NV	NT	-20000.00	-3.861004	20	PASS
			LV	NT	-20000.00	-3.861004	20	PASS
			HV	NT	-40000.00	-7.722008	20	PASS
		5200	NV	NT	-20000.00	-3.846154	20	PASS
			LV	NT	-20000.00	-3.846154	20	PASS
			HV	NT	-40000.00	-7.692308	20	PASS
		5240	NV	NT	-20000.00	-3.816794	20	PASS
			LV	NT	-20000.00	-3.816794	20	PASS
			HV	NT	-20000.00	-3.816794	20	PASS
		5260	NV	NT	-20000.00	-3.802281	20	PASS
			LV	NT	-20000.00	-3.802281	20	PASS
			HV	NT	-20000.00	-3.802281	20	PASS
		5300	NV	NT	-20000.00	-3.773585	20	PASS
			LV	NT	-20000.00	-3.773585	20	PASS
			HV	NT	-20000.00	-3.773585	20	PASS
		5320	NV	NT	-20000.00	-3.759398	20	PASS
			LV	NT	-20000.00	-3.759398	20	PASS
			HV	NT	-20000.00	-3.759398	20	PASS
		5500	NV	NT	-40000.00	-7.272727	20	PASS
			LV	NT	-40000.00	-7.272727	20	PASS
			HV	NT	-20000.00	-3.636364	20	PASS
		5600	NV	NT	-20000.00	-3.571429	20	PASS
			LV	NT	-20000.00	-3.571429	20	PASS
			HV	NT	-20000.00	-3.571429	20	PASS
		5700	NV	NT	-20000.00	-3.508772	20	PASS
			LV	NT	-20000.00	-3.508772	20	PASS
			HV	NT	-20000.00	-3.508772	20	PASS
		5745	NV	NT	-20000.00	-3.481288	20	PASS
			LV	NT	-20000.00	-3.481288	20	PASS
			HV	NT	-20000.00	-3.481288	20	PASS
		5785	NV	NT	-20000.00	-3.457217	20	PASS
			LV	NT	-20000.00	-3.457217	20	PASS
			HV	NT	-20000.00	-3.457217	20	PASS
		5825	NV	NT	-20000.00	-3.433476	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	-20000.00	-3.433476	20	PASS
11N20SISO	Ant1	5180	NV	NT	-60000.00	-11.583012	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	-20000.00	-3.861004	20	PASS
		5200	NV	NT	-20000.00	-3.846154	20	PASS
			LV	NT	-20000.00	-3.846154	20	PASS
			HV	NT	-40000.00	-7.692308	20	PASS
		5240	NV	NT	-20000.00	-3.816794	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	-20000.00	-3.816794	20	PASS
		5260	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	-20000.00	-3.802281	20	PASS
		5300	NV	NT	-40000.00	-7.547170	20	PASS
			LV	NT	-20000.00	-3.773585	20	PASS
			HV	NT	0.00	0.000000	20	PASS
		5320	NV	NT	0.00	0.000000	20	PASS
			LV	NT	-20000.00	-3.759398	20	PASS
			HV	NT	-40000.00	-7.518797	20	PASS
		5500	NV	NT	-40000.00	-7.272727	20	PASS
			LV	NT	-20000.00	-3.636364	20	PASS
			HV	NT	-40000.00	-7.272727	20	PASS
		5600	NV	NT	-40000.00	-7.142857	20	PASS
			LV	NT	-40000.00	-7.142857	20	PASS

		5700	HV	NT	-20000.00	-3.571429	20	PASS
			NV	NT	-20000.00	-3.508772	20	PASS
			LV	NT	-20000.00	-3.508772	20	PASS
		5745	HV	NT	-20000.00	-3.508772	20	PASS
			NV	NT	-20000.00	-3.481288	20	PASS
			LV	NT	0.00	0.000000	20	PASS
		5785	HV	NT	0.00	0.000000	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-6.914434	20	PASS
		5825	HV	NT	0.00	0.000000	20	PASS
			NV	NT	-20000.00	-3.433476	20	PASS
			LV	NT	-20000.00	-3.433476	20	PASS
11N40SIS O	Ant1	5190	HV	NT	-20000.00	-3.433476	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
		5230	HV	NT	0.00	0.000000	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-7.648184	20	PASS
		5270	HV	NT	-40000.00	-7.648184	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
		5310	HV	NT	0.00	0.000000	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-7.532957	20	PASS
		5510	HV	NT	-80000.00	-15.065913	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-7.259528	20	PASS
		5590	HV	NT	-40000.00	-7.259528	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-7.155635	20	PASS
		5670	HV	NT	-40000.00	-7.155635	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-7.054674	20	PASS
		5755	HV	NT	0.00	0.000000	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	-40000.00	-6.950478	20	PASS
		5795	HV	NT	-40000.00	-6.950478	20	PASS
			NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
11AC20SI SO	Ant1	5180	HV	NT	0.00	0.000000	20	PASS
			NV	NT	-40000.00	-7.722008	20	PASS
			LV	NT	-20000.00	-3.861004	20	PASS
		5200	HV	NT	-40000.00	-7.722008	20	PASS
			NV	NT	-40000.00	-7.692308	20	PASS
			LV	NT	-20000.00	-3.846154	20	PASS
		5240	HV	NT	-40000.00	-7.692308	20	PASS
			NV	NT	-20000.00	-3.816794	20	PASS
			LV	NT	-20000.00	-3.816794	20	PASS
		5260	HV	NT	-60000.00	-11.450382	20	PASS
			NV	NT	-40000.00	-7.604563	20	PASS
			LV	NT	-40000.00	-7.604563	20	PASS
		5300	HV	NT	-20000.00	-3.802281	20	PASS
			NV	NT	-20000.00	-3.773585	20	PASS
			LV	NT	-40000.00	-7.547170	20	PASS
		5320	HV	NT	-20000.00	-3.773585	20	PASS
			NV	NT	-40000.00	-7.518797	20	PASS
			LV	NT	-20000.00	-3.759398	20	PASS
		5500	HV	NT	-20000.00	-3.759398	20	PASS
			NV	NT	-20000.00	-3.636364	20	PASS
			LV	NT	-40000.00	-7.272727	20	PASS
		5600	HV	NT	-40000.00	-7.272727	20	PASS
			NV	NT	-40000.00	-7.142857	20	PASS
			LV	NT	-20000.00	-3.571429	20	PASS
		5700	HV	NT	-20000.00	-3.571429	20	PASS
			NV	NT	-40000.00	-7.017544	20	PASS
			LV	NT	-40000.00	-7.017544	20	PASS
		5700	HV	NT	-20000.00	-3.508772	20	PASS
			NV	NT	-20000.00	-3.508772	20	PASS
			LV	NT	-20000.00	-3.508772	20	PASS

		5745	NV	NT	-20000.00	-3.481288	20	PASS		
			LV	NT	-40000.00	-6.962576	20	PASS		
			HV	NT	-40000.00	-6.962576	20	PASS		
		5785	NV	NT	0.00	0.000000	20	PASS		
			LV	NT	-40000.00	-6.914434	20	PASS		
			HV	NT	-40000.00	-6.914434	20	PASS		
		5825	NV	NT	-20000.00	-3.433476	20	PASS		
			LV	NT	-40000.00	-6.866953	20	PASS		
			HV	NT	-40000.00	-6.866953	20	PASS		
11AC40SI SO	Ant1	5190	NV	NT	-40000.00	-7.707129	20	PASS		
			LV	NT	-40000.00	-7.707129	20	PASS		
			HV	NT	0.00	0.000000	20	PASS		
		5230	NV	NT	-40000.00	-7.648184	20	PASS		
			LV	NT	-80000.00	-15.296367	20	PASS		
			HV	NT	0.00	0.000000	20	PASS		
		5270	NV	NT	-40000.00	-7.590133	20	PASS		
			LV	NT	0.00	0.000000	20	PASS		
			HV	NT	-40000.00	-7.590133	20	PASS		
		5310	NV	NT	0.00	0.000000	20	PASS		
			LV	NT	-40000.00	-7.532957	20	PASS		
			HV	NT	0.00	0.000000	20	PASS		
		5510	NV	NT	0.00	0.000000	20	PASS		
			LV	NT	-40000.00	-7.259528	20	PASS		
			HV	NT	-40000.00	-7.259528	20	PASS		
		5590	NV	NT	0.00	0.000000	20	PASS		
			LV	NT	0.00	0.000000	20	PASS		
			HV	NT	0.00	0.000000	20	PASS		
		5670	NV	NT	0.00	0.000000	20	PASS		
			LV	NT	0.00	0.000000	20	PASS		
			HV	NT	0.00	0.000000	20	PASS		
		5755	NV	NT	0.00	0.000000	20	PASS		
			LV	NT	40000.00	6.950478	20	PASS		
			HV	NT	0.00	0.000000	20	PASS		
		5795	NV	NT	-40000.00	-6.902502	20	PASS		
			LV	NT	0.00	0.000000	20	PASS		
			HV	NT	40000.00	6.902502	20	PASS		
		11AC80SI SO	Ant1	5210	NV	NT	0.00	0.000000	20	PASS
					LV	NT	0.00	0.000000	20	PASS
					HV	NT	0.00	0.000000	20	PASS
				5290	NV	NT	0.00	0.000000	20	PASS
					LV	NT	0.00	0.000000	20	PASS
					HV	NT	0.00	0.000000	20	PASS
				5530	NV	NT	-80000.00	-14.466546	20	PASS
					LV	NT	0.00	0.000000	20	PASS
					HV	NT	0.00	0.000000	20	PASS
5610	NV			NT	0.00	0.000000	20	PASS		
	LV			NT	0.00	0.000000	20	PASS		
	HV			NT	0.00	0.000000	20	PASS		
5775	NV			NT	0.00	0.000000	20	PASS		
	LV			NT	0.00	0.000000	20	PASS		
	HV			NT	0.00	0.000000	20	PASS		
Temperature										
TestMode	Antenna	Freq(MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict		
11A	Ant1	5180	NV	-30	-20000.00	-3.861004	20	PASS		
			NV	-20	-40000.00	-7.722008	20	PASS		
			NV	-10	-40000.00	-7.722008	20	PASS		
			NV	0	-20000.00	-3.861004	20	PASS		
			NV	10	-20000.00	-3.861004	20	PASS		
			NV	20	-40000.00	-7.722008	20	PASS		
			NV	30	-20000.00	-3.861004	20	PASS		
			NV	40	-20000.00	-3.861004	20	PASS		
		5200	NV	-30	-20000.00	-3.846154	20	PASS		
			NV	-20	-20000.00	-3.846154	20	PASS		

			NV	-10	-20000.00	-3.846154	20	PASS
			NV	0	-40000.00	-7.692308	20	PASS
			NV	10	-40000.00	-7.692308	20	PASS
			NV	20	-20000.00	-3.846154	20	PASS
			NV	30	-20000.00	-3.846154	20	PASS
			NV	40	-20000.00	-3.846154	20	PASS
			NV	50	-20000.00	-3.846154	20	PASS
			NV	-30	-20000.00	-3.816794	20	PASS
			NV	-20	-40000.00	-7.633588	20	PASS
			NV	-10	-20000.00	-3.816794	20	PASS
		5240	NV	0	-20000.00	-3.816794	20	PASS
			NV	10	-20000.00	-3.816794	20	PASS
			NV	20	-20000.00	-3.816794	20	PASS
			NV	30	-20000.00	-3.816794	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	-20000.00	-3.816794	20	PASS
			NV	-30	-20000.00	-3.802281	20	PASS
			NV	-20	-20000.00	-3.802281	20	PASS
			NV	-10	-20000.00	-3.802281	20	PASS
			NV	0	-20000.00	-3.802281	20	PASS
		5260	NV	10	-20000.00	-3.802281	20	PASS
			NV	20	-20000.00	-3.802281	20	PASS
			NV	30	-20000.00	-3.802281	20	PASS
			NV	40	-40000.00	-7.604563	20	PASS
			NV	50	-20000.00	-3.802281	20	PASS
			NV	-30	-20000.00	-3.773585	20	PASS
			NV	-20	-20000.00	-3.773585	20	PASS
			NV	-10	-20000.00	-3.773585	20	PASS
			NV	0	-20000.00	-3.773585	20	PASS
			NV	10	-20000.00	-3.773585	20	PASS
		5300	NV	20	-20000.00	-3.773585	20	PASS
			NV	30	-40000.00	-7.547170	20	PASS
			NV	40	-40000.00	-7.547170	20	PASS
			NV	50	-40000.00	-7.547170	20	PASS
			NV	-30	-20000.00	-3.759398	20	PASS
			NV	-20	-20000.00	-3.759398	20	PASS
			NV	-10	-20000.00	-3.759398	20	PASS
			NV	0	-20000.00	-3.759398	20	PASS
			NV	10	-40000.00	-7.518797	20	PASS
			NV	20	-20000.00	-3.759398	20	PASS
		5320	NV	30	-40000.00	-7.518797	20	PASS
			NV	40	-20000.00	-3.759398	20	PASS
			NV	50	-20000.00	-3.759398	20	PASS
			NV	-30	-20000.00	-3.636364	20	PASS
			NV	-20	-60000.00	-10.909091	20	PASS
			NV	-10	-20000.00	-3.636364	20	PASS
			NV	0	-20000.00	-3.636364	20	PASS
			NV	10	-20000.00	-3.636364	20	PASS
			NV	20	-40000.00	-7.272727	20	PASS
			NV	30	-20000.00	-3.636364	20	PASS
		5500	NV	40	-40000.00	-7.272727	20	PASS
			NV	50	-40000.00	-7.272727	20	PASS
			NV	-30	-40000.00	-7.142857	20	PASS
			NV	-20	-20000.00	-3.571429	20	PASS
			NV	-10	-20000.00	-3.571429	20	PASS
			NV	0	-20000.00	-3.571429	20	PASS
			NV	10	-20000.00	-3.571429	20	PASS
			NV	20	-40000.00	-7.142857	20	PASS
			NV	30	-20000.00	-3.571429	20	PASS
			NV	40	0.00	0.000000	20	PASS
		5600	NV	50	-20000.00	-3.571429	20	PASS
			NV	-30	-20000.00	-3.508772	20	PASS
			NV	-20	-20000.00	-3.508772	20	PASS
			NV	-10	-20000.00	-3.508772	20	PASS
			NV	0	-20000.00	-3.508772	20	PASS
			NV	10	-20000.00	-3.508772	20	PASS
			NV	20	-20000.00	-3.508772	20	PASS
			NV	30	-20000.00	-3.508772	20	PASS
			NV	40	-20000.00	-3.508772	20	PASS
			NV	50	-20000.00	-3.508772	20	PASS

			NV	30	-20000.00	-3.508772	20	PASS
			NV	40	-20000.00	-3.508772	20	PASS
			NV	50	-20000.00	-3.508772	20	PASS
		5745	NV	-30	-20000.00	-3.481288	20	PASS
			NV	-20	-20000.00	-3.481288	20	PASS
			NV	-10	-20000.00	-3.481288	20	PASS
			NV	0	-20000.00	-3.481288	20	PASS
			NV	10	-20000.00	-3.481288	20	PASS
			NV	20	-20000.00	-3.481288	20	PASS
			NV	30	-20000.00	-3.481288	20	PASS
			NV	40	-20000.00	-3.481288	20	PASS
			NV	50	-20000.00	-3.481288	20	PASS
		5785	NV	-30	0.00	0.000000	20	PASS
			NV	-20	-40000.00	-6.914434	20	PASS
			NV	-10	-40000.00	-6.914434	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-20000.00	-3.457217	20	PASS
			NV	20	-20000.00	-3.457217	20	PASS
			NV	30	-20000.00	-3.457217	20	PASS
			NV	40	-20000.00	-3.457217	20	PASS
		5825	NV	50	-20000.00	-3.457217	20	PASS
			NV	-30	-20000.00	-3.433476	20	PASS
			NV	-20	-20000.00	-3.433476	20	PASS
			NV	-10	-20000.00	-3.433476	20	PASS
			NV	0	-40000.00	-6.866953	20	PASS
			NV	10	-20000.00	-3.433476	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	-20000.00	-3.433476	20	PASS
			NV	40	-20000.00	-3.433476	20	PASS
			NV	50	-20000.00	-3.433476	20	PASS
11N20SIS O	Ant1	5180	NV	-30	0.00	0.000000	20	PASS
			NV	-20	-60000.00	-11.583012	20	PASS
			NV	-10	-20000.00	-3.861004	20	PASS
			NV	0	-20000.00	-3.861004	20	PASS
			NV	10	-60000.00	-11.583012	20	PASS
			NV	20	-20000.00	-3.861004	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	-20000.00	-3.861004	20	PASS
			NV	50	-20000.00	-3.861004	20	PASS
		5200	NV	-30	-40000.00	-7.692308	20	PASS
			NV	-20	-20000.00	-3.846154	20	PASS
			NV	-10	-40000.00	-7.692308	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-40000.00	-7.692308	20	PASS
			NV	20	-20000.00	-3.846154	20	PASS
			NV	30	-40000.00	-7.692308	20	PASS
			NV	40	-20000.00	-3.846154	20	PASS
		5240	NV	50	-40000.00	-7.692308	20	PASS
			NV	-30	-20000.00	-3.816794	20	PASS
			NV	-20	-20000.00	-3.816794	20	PASS
			NV	-10	-40000.00	-7.633588	20	PASS
			NV	0	-20000.00	-3.816794	20	PASS
			NV	10	-20000.00	-3.816794	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
		5260	NV	40	-40000.00	-7.633588	20	PASS
			NV	50	-60000.00	-11.450382	20	PASS
			NV	-30	-40000.00	-7.604563	20	PASS
			NV	-20	-40000.00	-7.604563	20	PASS
			NV	-10	-20000.00	-3.802281	20	PASS
			NV	0	-40000.00	-7.604563	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	-40000.00	-7.604563	20	PASS
		5300	NV	30	-40000.00	-7.604563	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	-20000.00	-3.802281	20	PASS

			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-20000.00	-3.773585	20	PASS
			NV	20	-40000.00	-7.547170	20	PASS
			NV	30	-40000.00	-7.547170	20	PASS
			NV	40	-20000.00	-3.773585	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5320	NV	-30	-20000.00	-3.759398	20	PASS
			NV	-20	-20000.00	-3.759398	20	PASS
			NV	-10	-40000.00	-7.518797	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	-20000.00	-3.759398	20	PASS
			NV	40	-40000.00	-7.518797	20	PASS
			NV	50	-40000.00	-7.518797	20	PASS
		5500	NV	-30	-20000.00	-3.636364	20	PASS
			NV	-20	-20000.00	-3.636364	20	PASS
			NV	-10	-40000.00	-7.272727	20	PASS
			NV	0	-20000.00	-3.636364	20	PASS
			NV	10	-40000.00	-7.272727	20	PASS
			NV	20	-20000.00	-3.636364	20	PASS
			NV	30	-20000.00	-3.636364	20	PASS
			NV	40	-20000.00	-3.636364	20	PASS
			NV	50	-20000.00	-3.636364	20	PASS
		5600	NV	-30	-20000.00	-3.571429	20	PASS
			NV	-20	-20000.00	-3.571429	20	PASS
			NV	-10	20000.00	3.571429	20	PASS
			NV	0	-40000.00	-7.142857	20	PASS
			NV	10	-20000.00	-3.571429	20	PASS
			NV	20	-20000.00	-3.571429	20	PASS
			NV	30	-40000.00	-7.142857	20	PASS
			NV	40	-40000.00	-7.142857	20	PASS
			NV	50	-40000.00	-7.142857	20	PASS
		5700	NV	-30	-20000.00	-3.508772	20	PASS
			NV	-20	-40000.00	-7.017544	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	-40000.00	-7.017544	20	PASS
			NV	10	-20000.00	-3.508772	20	PASS
			NV	20	-20000.00	-3.508772	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	-40000.00	-7.017544	20	PASS
			NV	50	-20000.00	-3.508772	20	PASS
		5745	NV	-30	-20000.00	-3.481288	20	PASS
			NV	-20	-40000.00	-6.962576	20	PASS
			NV	-10	-20000.00	-3.481288	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-20000.00	-3.481288	20	PASS
			NV	20	-20000.00	-3.481288	20	PASS
			NV	30	-20000.00	-3.481288	20	PASS
			NV	40	-20000.00	-3.481288	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5785	NV	-30	-20000.00	-3.457217	20	PASS
			NV	-20	-20000.00	-3.457217	20	PASS
			NV	-10	-40000.00	-6.914434	20	PASS
			NV	0	-20000.00	-3.457217	20	PASS
			NV	10	-40000.00	-6.914434	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	-20000.00	-3.457217	20	PASS
			NV	40	-40000.00	-6.914434	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5825	NV	-30	-20000.00	-3.433476	20	PASS
			NV	-20	-40000.00	-6.866953	20	PASS
			NV	-10	-20000.00	-3.433476	20	PASS
			NV	0	-20000.00	-3.433476	20	PASS
			NV	10	-40000.00	-6.866953	20	PASS

11N40SIS O	Ant1		NV	20	-20000.00	-3.433476	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	-20000.00	-3.433476	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5190	NV	-30	-40000.00	-7.707129	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	-40000.00	-7.707129	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	-40000.00	-7.707129	20	PASS
			NV	50	-40000.00	-7.707129	20	PASS
		5230	NV	-30	0.00	0.000000	20	PASS
			NV	-20	-40000.00	-7.648184	20	PASS
			NV	-10	-40000.00	-7.648184	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-80000.00	-15.296367	20	PASS
			NV	20	-40000.00	-7.648184	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	40000.00	7.648184	20	PASS
			NV	50	-40000.00	-7.648184	20	PASS
		5270	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	-40000.00	-7.590133	20	PASS
			NV	10	-40000.00	-7.590133	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5310	NV	-30	-40000.00	-7.532957	20	PASS
			NV	-20	-40000.00	-7.532957	20	PASS
			NV	-10	-40000.00	-7.532957	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-40000.00	-7.532957	20	PASS
			NV	20	-40000.00	-7.532957	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	-40000.00	-7.532957	20	PASS
		5510	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	-40000.00	-7.259528	20	PASS
			NV	0	-40000.00	-7.259528	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	-40000.00	-7.259528	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5590	NV	-30	0.00	0.000000	20	PASS
			NV	-20	-40000.00	-7.155635	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	-40000.00	-7.155635	20	PASS
			NV	30	-40000.00	-7.155635	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	-40000.00	-7.155635	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	-40000.00	-7.054674	20	PASS
			NV	-10	160000.00	-7.054674	20	PASS
			NV	0	-40000.00	-7.054674	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS

		5755	NV	-30	0.00	0.000000	20	PASS
			NV	-20	-40000.00	-6.950478	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	-40000.00	-6.950478	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	-40000.00	-6.950478	20	PASS
			NV	40	-40000.00	-6.950478	20	PASS
		5795	NV	50	0.00	0.000000	20	PASS
			NV	-30	-40000.00	-6.902502	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-40000.00	-6.902502	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
11AC20SI SO	Ant1	5180	NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
			NV	-30	-40000.00	-7.722008	20	PASS
			NV	-20	-40000.00	-7.722008	20	PASS
			NV	-10	-40000.00	-7.722008	20	PASS
			NV	0	-20000.00	-3.861004	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	-40000.00	-7.722008	20	PASS
		5200	NV	30	-40000.00	-7.722008	20	PASS
			NV	40	-20000.00	-3.861004	20	PASS
			NV	50	-20000.00	-3.861004	20	PASS
			NV	-30	-20000.00	-3.846154	20	PASS
			NV	-20	-40000.00	-7.692308	20	PASS
			NV	-10	-20000.00	-3.846154	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-20000.00	-3.846154	20	PASS
		5240	NV	20	-20000.00	-3.846154	20	PASS
			NV	30	-60000.00	-11.538462	20	PASS
			NV	40	-40000.00	-7.692308	20	PASS
			NV	50	0.00	0.000000	20	PASS
			NV	-30	-40000.00	-7.633588	20	PASS
			NV	-20	-40000.00	-7.633588	20	PASS
			NV	-10	-40000.00	-7.633588	20	PASS
			NV	0	-60000.00	-11.450382	20	PASS
		5260	NV	10	-40000.00	-7.633588	20	PASS
			NV	20	-20000.00	-3.816794	20	PASS
			NV	30	-40000.00	-7.633588	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	-20000.00	-3.816794	20	PASS
			NV	-30	-20000.00	-3.802281	20	PASS
			NV	-20	-60000.00	-11.406844	20	PASS
			NV	-10	-20000.00	-3.802281	20	PASS
		5300	NV	0	-40000.00	-7.604563	20	PASS
			NV	10	-20000.00	-3.802281	20	PASS
			NV	20	-40000.00	-7.604563	20	PASS
			NV	30	-20000.00	-3.802281	20	PASS
			NV	40	-20000.00	-3.802281	20	PASS
			NV	50	-40000.00	-7.604563	20	PASS
			NV	-30	-40000.00	-7.547170	20	PASS
			NV	-20	-40000.00	-7.547170	20	PASS
		5320	NV	-10	-40000.00	-7.547170	20	PASS
			NV	0	-20000.00	-3.773585	20	PASS
			NV	10	-20000.00	-3.773585	20	PASS
			NV	20	-20000.00	-3.773585	20	PASS
			NV	30	-40000.00	-7.547170	20	PASS
			NV	40	-40000.00	-7.547170	20	PASS
			NV	50	-40000.00	-7.547170	20	PASS
			NV	-30	-20000.00	-3.759398	20	PASS
		5320	NV	-20	-40000.00	-7.518797	20	PASS
			NV	-10	-40000.00	-7.518797	20	PASS
			NV	0	-40000.00	-7.518797	20	PASS

			NV	10	-20000.00	-3.759398	20	PASS
			NV	20	-40000.00	-7.518797	20	PASS
			NV	30	-40000.00	-7.518797	20	PASS
			NV	40	-20000.00	-3.759398	20	PASS
			NV	50	-40000.00	-7.518797	20	PASS
		5500	NV	-30	-20000.00	-3.636364	20	PASS
			NV	-20	-40000.00	-7.272727	20	PASS
			NV	-10	-40000.00	-7.272727	20	PASS
			NV	0	-40000.00	-7.272727	20	PASS
			NV	10	-40000.00	-7.272727	20	PASS
			NV	20	-40000.00	-7.272727	20	PASS
			NV	30	-40000.00	-7.272727	20	PASS
			NV	40	-40000.00	-7.272727	20	PASS
			NV	50	-40000.00	-7.272727	20	PASS
			NV	-30	-40000.00	-7.142857	20	PASS
		5600	NV	-20	-40000.00	-7.142857	20	PASS
			NV	-10	-60000.00	-10.714286	20	PASS
			NV	0	-40000.00	-7.142857	20	PASS
			NV	10	-40000.00	-7.142857	20	PASS
			NV	20	-40000.00	-7.142857	20	PASS
			NV	30	-40000.00	-7.142857	20	PASS
			NV	40	-20000.00	-3.571429	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5700	NV	-30	-40000.00	-7.017544	20	PASS
			NV	-20	-60000.00	-10.526316	20	PASS
			NV	-10	-20000.00	-3.508772	20	PASS
			NV	0	-40000.00	-7.017544	20	PASS
			NV	10	-40000.00	-7.017544	20	PASS
			NV	20	-40000.00	-7.017544	20	PASS
			NV	30	-40000.00	-7.017544	20	PASS
			NV	40	-20000.00	-3.508772	20	PASS
			NV	50	-40000.00	-7.017544	20	PASS
		5745	NV	-30	-40000.00	-6.962576	20	PASS
			NV	-20	-20000.00	-3.481288	20	PASS
			NV	-10	-40000.00	-6.962576	20	PASS
			NV	0	-40000.00	-6.962576	20	PASS
			NV	10	-40000.00	-6.962576	20	PASS
			NV	20	-40000.00	-6.962576	20	PASS
			NV	30	-20000.00	-3.481288	20	PASS
			NV	40	-40000.00	-6.962576	20	PASS
			NV	50	-40000.00	-6.962576	20	PASS
		5785	NV	-30	-40000.00	-6.914434	20	PASS
			NV	-20	-20000.00	-3.457217	20	PASS
			NV	-10	-40000.00	-6.914434	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-40000.00	-6.914434	20	PASS
			NV	20	-40000.00	-6.914434	20	PASS
			NV	30	-20000.00	-3.457217	20	PASS
			NV	40	-20000.00	-3.457217	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5825	NV	-30	-60000.00	-10.300429	20	PASS
			NV	-20	-40000.00	-6.866953	20	PASS
			NV	-10	-20000.00	-3.433476	20	PASS
			NV	0	-40000.00	-6.866953	20	PASS
			NV	10	-40000.00	-6.866953	20	PASS
			NV	20	-40000.00	-6.866953	20	PASS
			NV	30	-40000.00	-6.866953	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	-40000.00	-6.866953	20	PASS
11AC40SI SO	Ant1	5190	NV	-30	-40000.00	-7.707129	20	PASS
			NV	-20	-80000.00	-15.414258	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	-40000.00	-7.707129	20	PASS
			NV	20	-40000.00	-7.707129	20	PASS
			NV	30	-40000.00	-7.707129	20	PASS
			NV	40	0.00	0.000000	20	PASS

		NV	50	-40000.00	-7.707129	20	PASS
		NV	-30	-40000.00	-7.648184	20	PASS
		NV	-20	0.00	0.000000	20	PASS
		NV	-10	-40000.00	-7.648184	20	PASS
		NV	0	0.00	0.000000	20	PASS
		NV	10	0.00	0.000000	20	PASS
		NV	20	-40000.00	-7.648184	20	PASS
		NV	30	-40000.00	-7.648184	20	PASS
		NV	40	-80000.00	-15.296367	20	PASS
		NV	50	-40000.00	-7.648184	20	PASS
		NV	-30	0.00	0.000000	20	PASS
		NV	-20	0.00	0.000000	20	PASS
		NV	-10	0.00	0.000000	20	PASS
		NV	0	0.00	0.000000	20	PASS
		NV	10	0.00	0.000000	20	PASS
		NV	20	-40000.00	-7.590133	20	PASS
		NV	30	0.00	0.000000	20	PASS
		NV	40	0.00	0.000000	20	PASS
		NV	50	-40000.00	-7.590133	20	PASS
		NV	-30	-40000.00	-7.532957	20	PASS
		NV	-20	-40000.00	-7.532957	20	PASS
		NV	-10	0.00	0.000000	20	PASS
		NV	0	-40000.00	-7.532957	20	PASS
		NV	10	-40000.00	-7.532957	20	PASS
		NV	20	-40000.00	-7.532957	20	PASS
		NV	30	0.00	0.000000	20	PASS
		NV	40	-40000.00	-7.532957	20	PASS
		NV	50	-40000.00	-7.532957	20	PASS
		NV	-30	-40000.00	-7.259528	20	PASS
		NV	-20	0.00	0.000000	20	PASS
		NV	-10	-40000.00	-7.259528	20	PASS
		NV	0	-40000.00	-7.259528	20	PASS
		NV	10	-80000.00	-14.519056	20	PASS
		NV	20	0.00	0.000000	20	PASS
		NV	30	-40000.00	-7.259528	20	PASS
		NV	40	-40000.00	-7.259528	20	PASS
		NV	50	0.00	0.000000	20	PASS
		NV	-30	-40000.00	-7.155635	20	PASS
		NV	-20	-40000.00	-7.155635	20	PASS
		NV	-10	-40000.00	-7.155635	20	PASS
		NV	0	-80000.00	-14.311270	20	PASS
		NV	10	0.00	0.000000	20	PASS
		NV	20	-40000.00	-7.155635	20	PASS
		NV	30	0.00	0.000000	20	PASS
		NV	40	0.00	0.000000	20	PASS
		NV	50	-40000.00	-7.155635	20	PASS
		NV	-30	0.00	0.000000	20	PASS
		NV	-20	-40000.00	-7.054674	20	PASS
		NV	-10	0.00	0.000000	20	PASS
		NV	0	0.00	0.000000	20	PASS
		NV	10	40000.00	7.054674	20	PASS
		NV	20	0.00	0.000000	20	PASS
		NV	30	0.00	0.000000	20	PASS
		NV	40	0.00	0.000000	20	PASS
		NV	50	0.00	0.000000	20	PASS
		NV	-30	0.00	0.000000	20	PASS
		NV	-20	0.00	0.000000	20	PASS
		NV	-10	0.00	0.000000	20	PASS
		NV	0	-80000.00	-13.900956	20	PASS
		NV	10	-40000.00	-6.950478	20	PASS
		NV	20	0.00	0.000000	20	PASS
		NV	30	0.00	0.000000	20	PASS
		NV	40	0.00	0.000000	20	PASS
		NV	50	0.00	0.000000	20	PASS
		NV	-30	0.00	0.000000	20	PASS
		NV	-20	0.00	0.000000	20	PASS
		NV	-10	-40000.00	-6.902502	20	PASS

			NV	0	-40000.00	-6.902502	20	PASS
			NV	10	0.00	0.000000	20	PASS
11AC80SI SO	Ant1	5210	NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
			NV	10	-80000.00	-15.355086	20	PASS
			NV	20	0.00	0.000000	20	PASS
		5290	NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
			NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
		5530	NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5610	NV	-30	-80000.00	-14.260250	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
		5775	NV	30	-80000.00	-14.260250	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
			NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS

End of Test Report