



3 IN 1 Wireless Charger

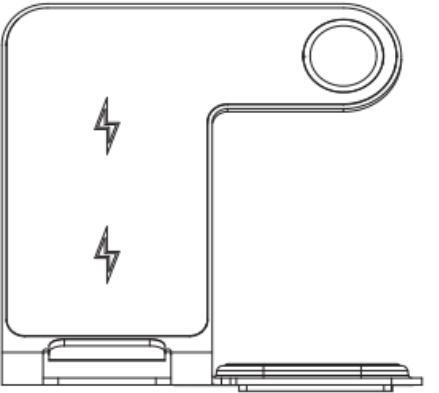

Specification

Specification

Product	3 IN 1 Wireless Charger
Input	9V ==2A
	Phone 15W (Max)
Output	Airpods 3W
	iWatch 2W
Charging distance	3-6mm
Work temperature	0-30°C
	iPhone8 to iPhone 14
	Android phone with wireless charging function
Suitable equipment	Airpods1, Airpods2, Airpods2 Pro
	iWatch1, 2, 3, 4, 5, 6, 7
Package list	Wireless charger×1 , UM×1,charge cable×1

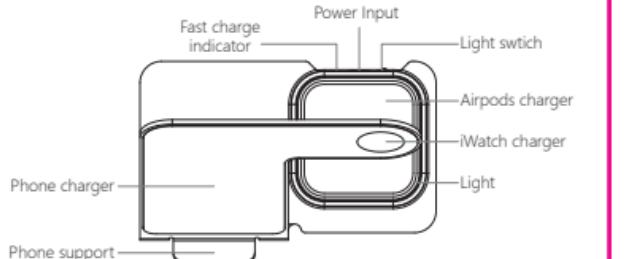


Steps:

1. Connect the charger to suitable PD or QC adaptor with charge cable.If the red LED light,shows the equipment work normally, otherwise please check the cable and adaptor.

2. Place the phone on the bracket vertically or horizontally, the phone will be in charging, same time the blue light will gradual change.If the blue light and green light blinking , please check whether your phone is placed correctly. The light can be shut down by the backside switch.

3. Place Airpods on the Airpods charger, it will be in charging

4. Place the iWatch on iWatch charger, the watch will be in charging

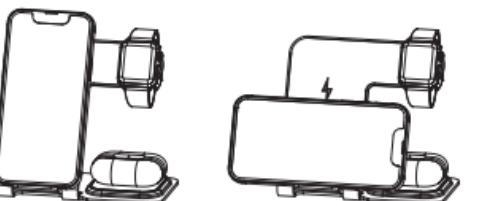

*Notice: Try to place the phone on the middle of the support. Make sure the thickness of the big phone case such as iPhone max shouldn't exceed 3mm, otherwise will lead to low charge speed, even stop charging

Warnings:

1. Make sure your phone supports wireless charging
2. Please do not place metal/magnet/credit card on the mobilephone or phone case,it will block the wireless charge

3. Do not use the mobile phone case which is more than 0.078 inch thick, otherwise it will not be able to charge.

4. Do not disassemble, bump,squeeze or put the product into the fire.

5. Do not use the product under the condition of the high temperature,humiity or corrosion,so as to avoid electric leakage in the circuit

6. Do not splash water or other liquids on the wireless charger. If cleaning is required, make sure the power is disconnected.

7. When charging, keep the distance between the implanted medical device(pacemaker, co-chlear implant,etc) and the wireless charger at least 20cm to avoid potential interference to the medical device

8. When using the DC charger for power supply,please make sure your charger Support QC charge, and its max power is more than 18W

9. Please keep the product out of the reach of kids.

FCC Warning

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions:
(1) This device may not cause harmful interference, and
(2) this device must accept any interference received, including interference that may cause undesired operation. Any Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

FCC RF exposure statement:

The equipment complies with FCC radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance between 20cm the radiator your body.