





View of Product-10




View of Product-11

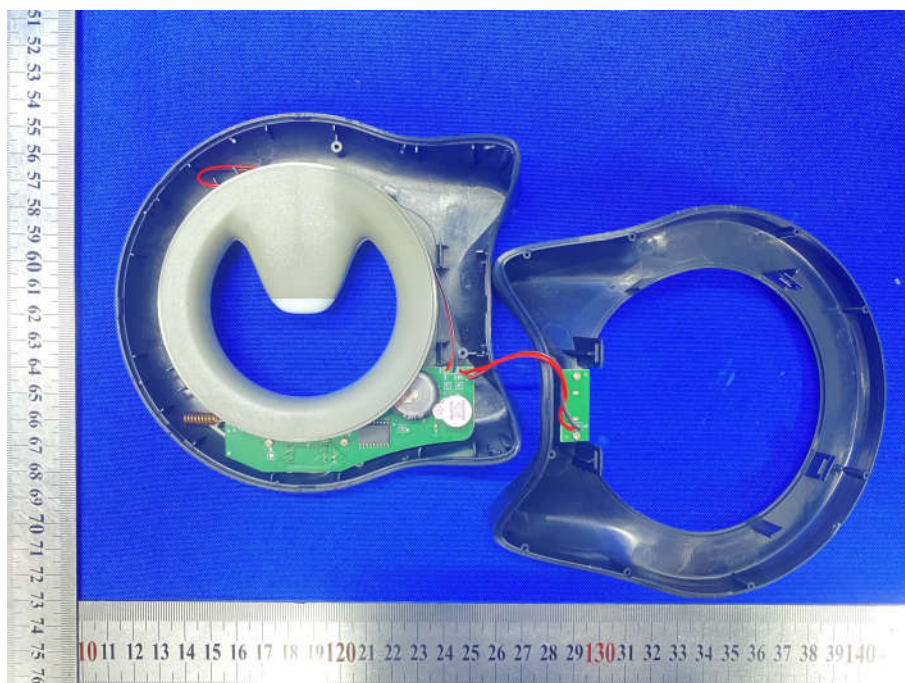


View of Product-12

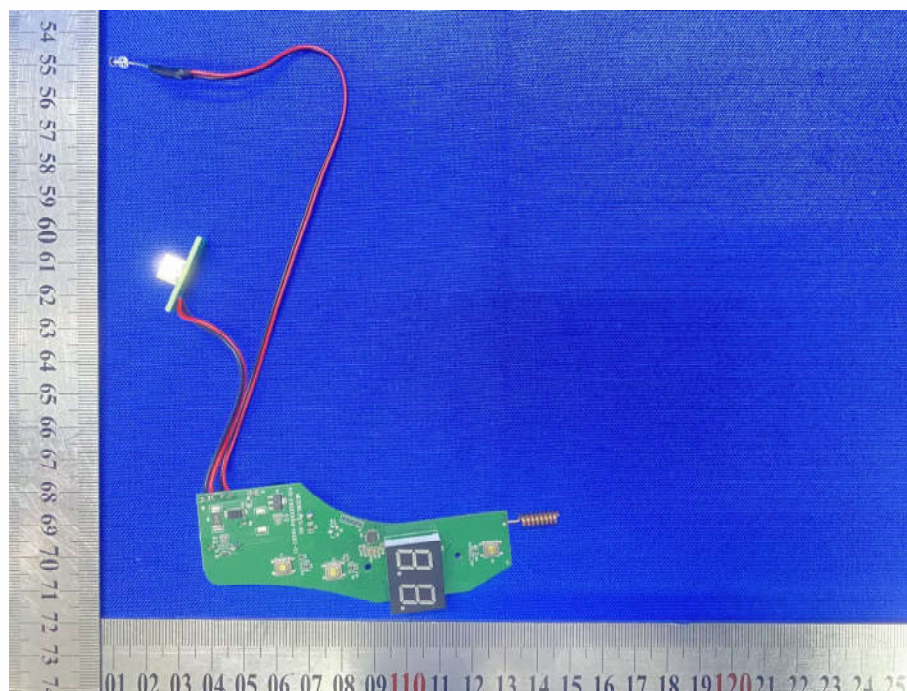


View of Product-13

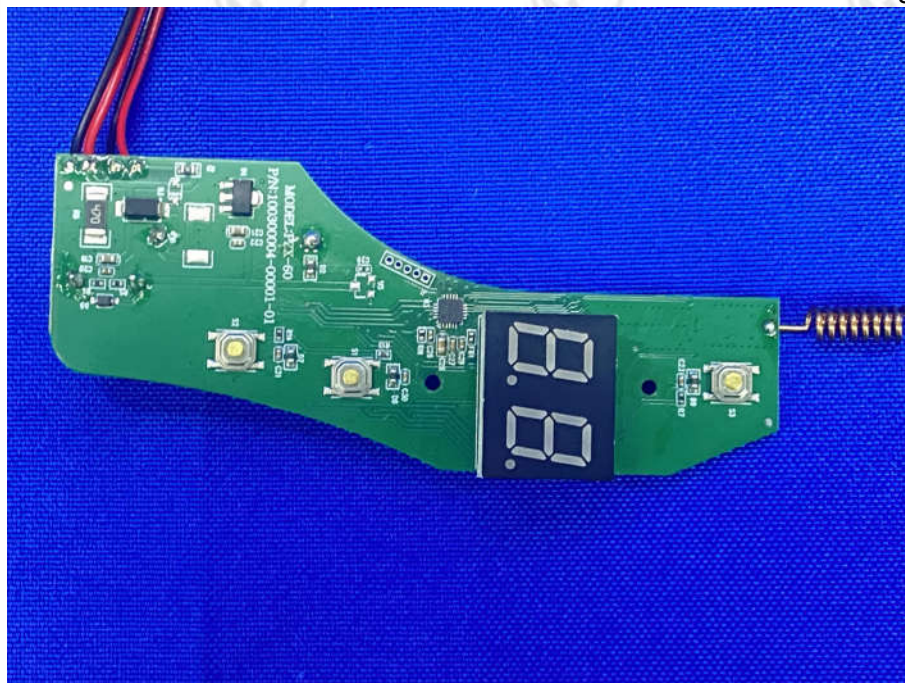


View of Product-14

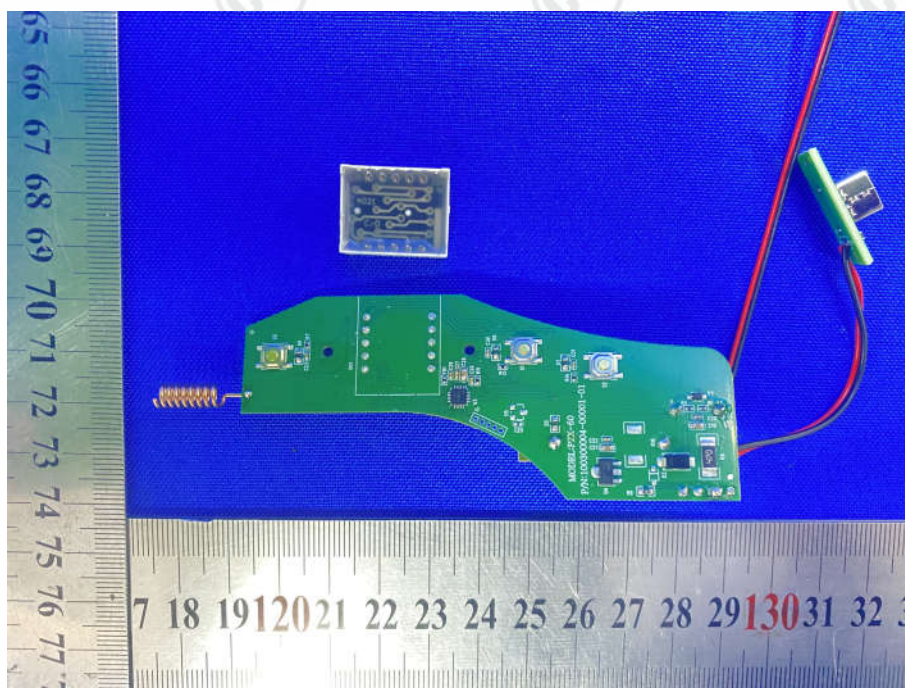

View of Product-15

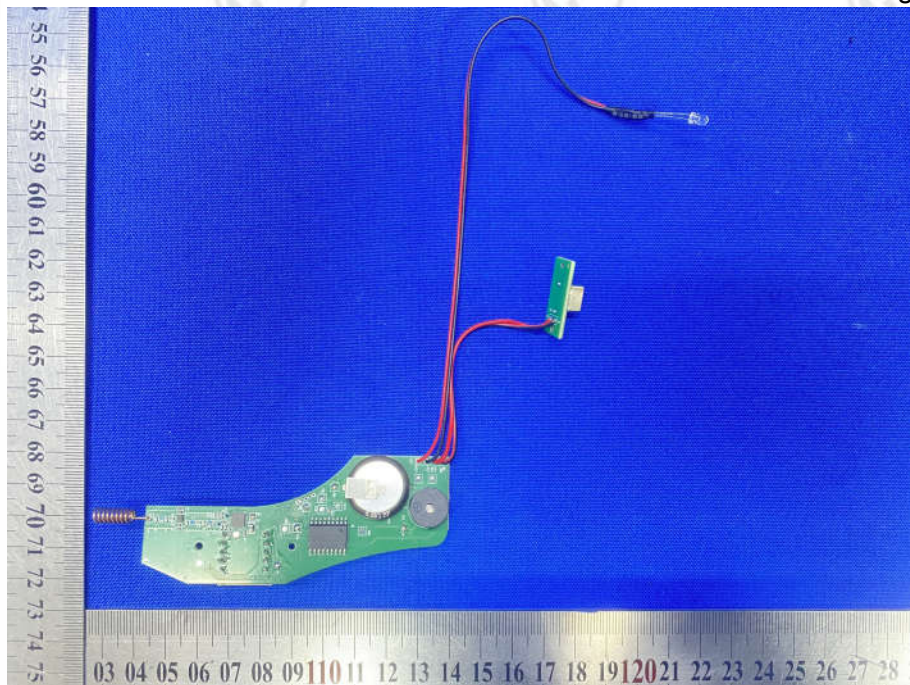

View of Product-16

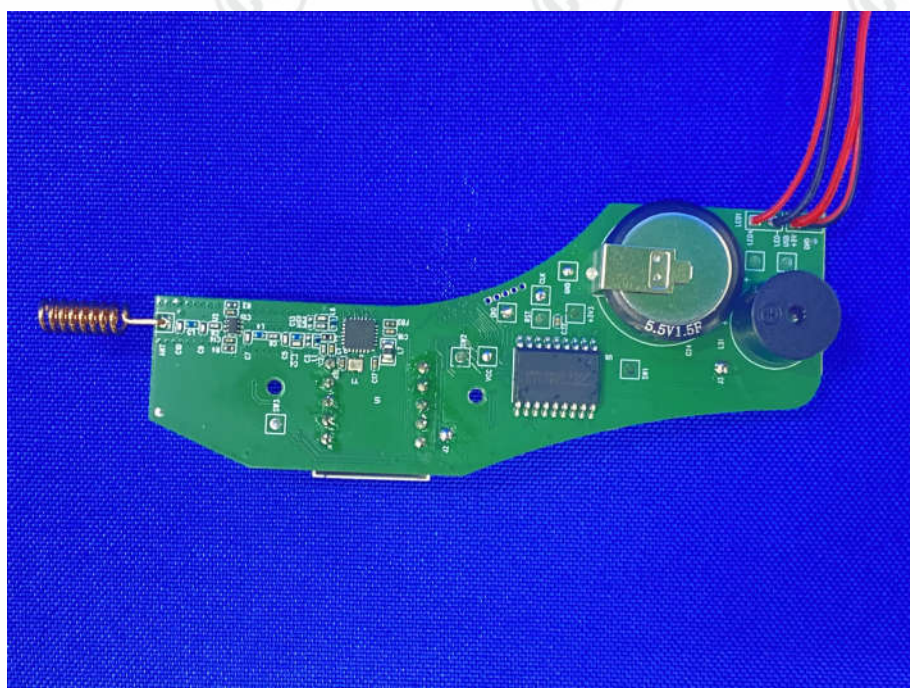


View of Product-17



View of Product-18




View of Product-19

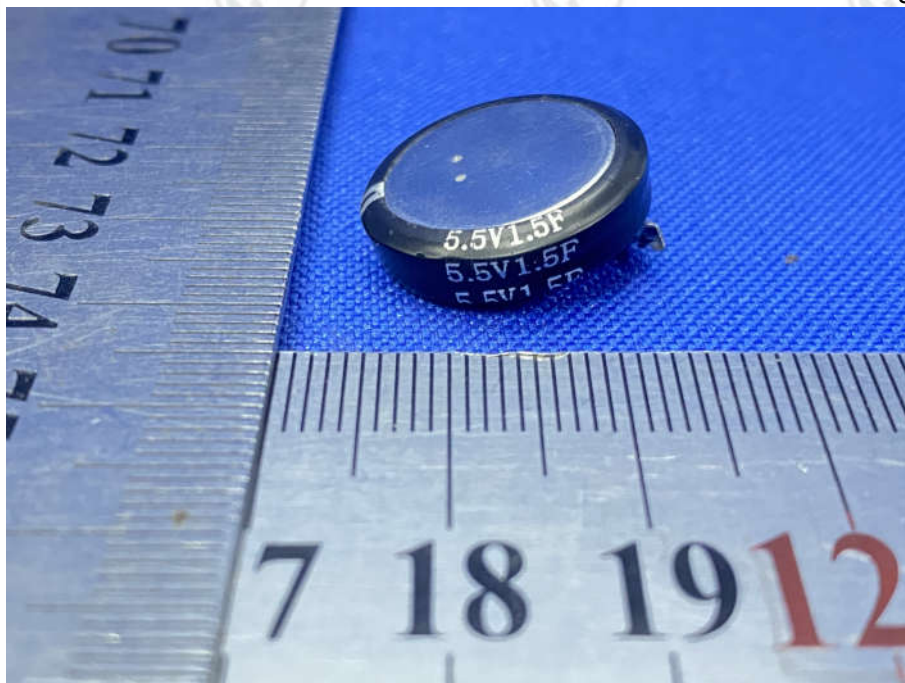


View of Product-20




View of Product-21

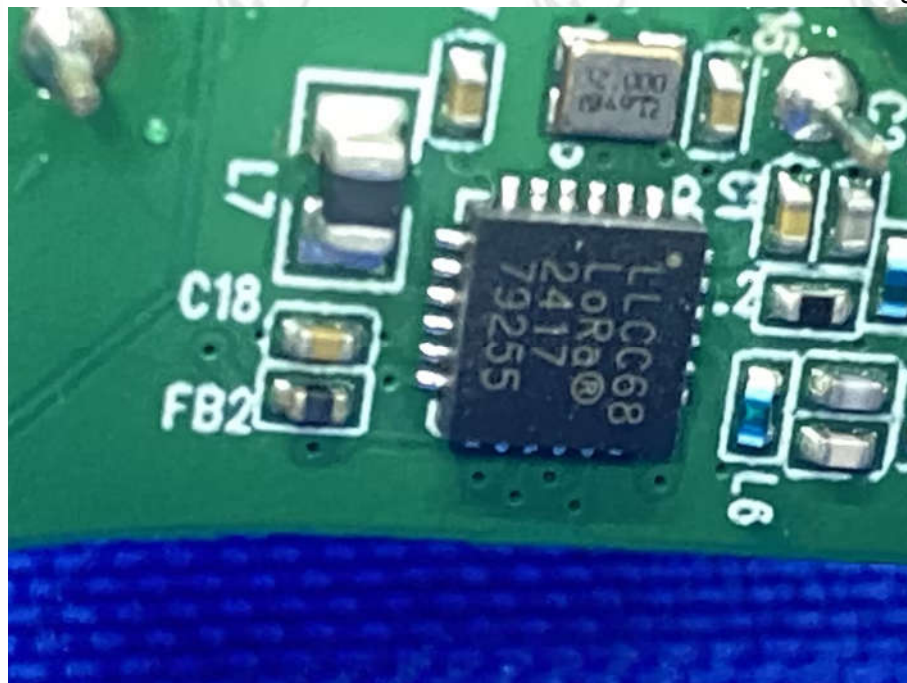


View of Product-22

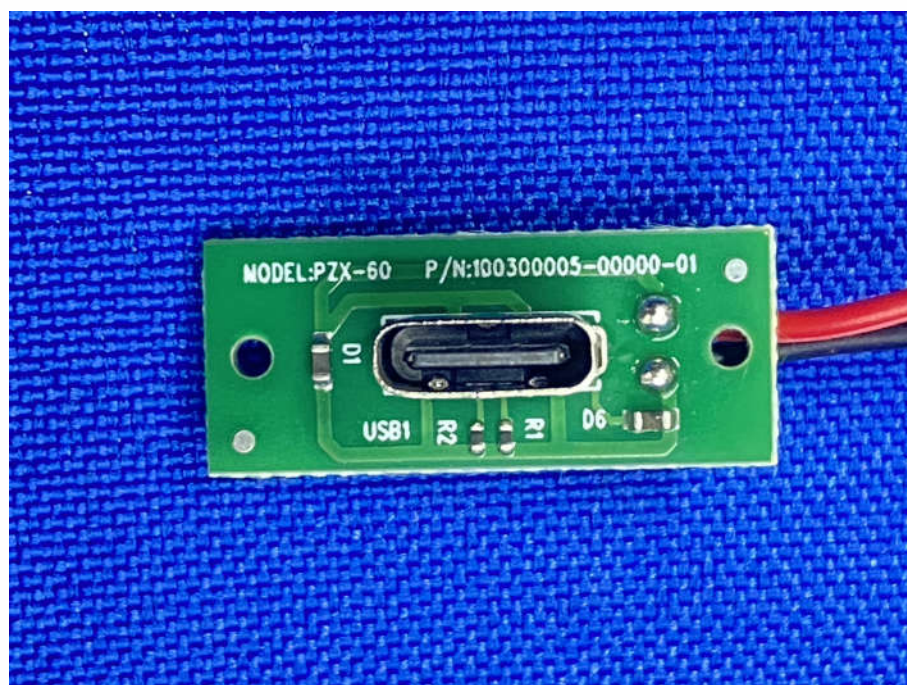

View of Product-23

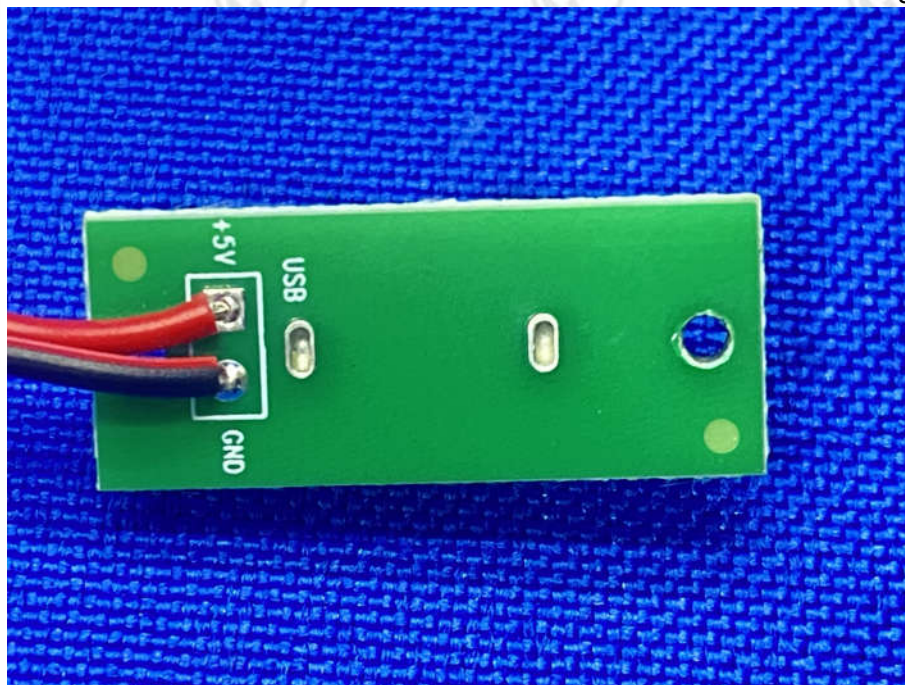

View of Product-24

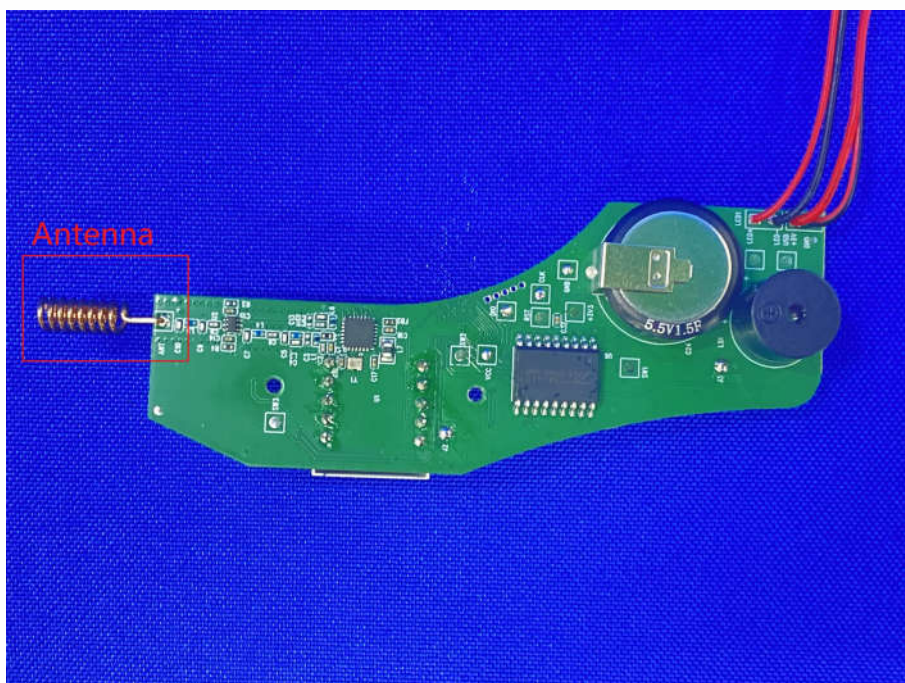

View of Product-25

声明 Statement

1. 检测报告无批准人签字、“专用章”及报告骑缝章无效;

This report is considered invalid without approved signature, special seal and the seal on the perforation;

2. 报告中公司名称及地址、样品及样品信息由申请者提供, 申请者应对其真实性负责, CTI 不负责验证其真实性;

The Company Name shown on Report and Address, the sample(s) and sample information was/were provided by the applicant who should be responsible for the authenticity which CTI hasn't verified;

3. 本报告检测结果仅对受测样品负责;

The result(s) shown in this report refer(s) only to the sample(s) tested;

4. 除非另有说明, 报告参照 ILAC-G8:09/2019/CNAS-GL015: 2022 使用简单接受判定规则进行符合性判定;

Unless otherwise stated, the decision rule for conformity reporting is based on Binary Statement for Simple Acceptance Rule stated in ILAC-G8:09/2019/CNAS-GL015:2022;

5. 未经 CTI 书面同意, 不得部分复制本报告;

Without written approval of CTI, this report can't be reproduced except in full;

6. 如检测报告中的英文内容与中文内容有差异, 以中文为准。

In case of any discrepancy between the English version and Chinese version of the testing reports (if generated), the Chinese version shall prevail.

*** 报告结束 ***

*** End of Report ***