



MOTOROLA SOLUTIONS



TESTING CERT # 2518.05

DECLARATION OF COMPLIANCE SAR ASSESSMENT Part 1 of 2

**Motorola Solutions Inc.
EME Test Laboratory**

Motorola Solutions Malaysia Sdn Bhd (455657-H)
Plot 2, Bayan Lepas Technoplex Industrial Park,
Mukim 12 SWD 11900 Bayan Lepas Penang, Malaysia.

**Date of Report: 12/04/2015
Report Revision: A**

Responsible Engineer: Tiong Nguk Ing (EME Engineer)
Report Author: Tiong Nguk Ing (EME Engineer)
Date/s Tested: 11/7/2015-11/19/2015
Manufacturer: Motorola Solutions Inc.
DUT Description: Handheld Portable – 403-527 MHz 4W LKP CFS WIFI, 403- 527 MHz 4W NKP CFS WIFI
Test TX mode(s): CW (PTT) , Bluetooth, WLAN 802.11 b/g/n
Max. Power output: 4.8 W (LMR 403-527 MHz band), 10 mW (Bluetooth), 69.9 mW (WLAN 802.11 b), 18.6 mW (WLAN 802.11g), 12.6 mW (WLAN 802.11n)
Nominal Power: 4.0 W (LMR 403-527 MHz band), 8.9 mW (Bluetooth), 55.0 mW (WLAN 802.11 b), 14.8 mW (WLAN 802.11g), 10 mW (WLAN 802.11n)
Tx Frequency Bands: LMR 403-527 MHz; Bluetooth 2.402-2.480 GHz; WLAN 802.11 b/g/n 2.412-2.462 GHz
Signaling type: FM (LMR), FHSS (Bluetooth), 802.11 b/g/n (WLAN)
Model(s) Tested: PMUE3836B, PMUE3838B
Model(s) Certified: PMUE3836B, PMUE3838B
Serial Number(s): 446TRT7269, 446TRT7258 and 867TRT4943
Classification: Occupational/Controlled
FCC ID: AZ489FT7068; LMR 406.125-512 MHz, Bluetooth 2.402-2.480 GHz, WLAN 802.11 b/g/n 2.412-2.462 GHz
 This report contains results that are immaterial for FCC equipment approval, which are clearly identified.
IC: 109U-89FT7068; This report contains results that are immaterial for IC equipment approval, which are clearly identified.

The test results clearly demonstrate compliance with FCC Occupational/Controlled RF Exposure limits of 8 W/kg averaged over 1 gram per the requirements of OET Bulletin 65. The 10 grams result is not applicable to FCC filing. The test results clearly demonstrate compliance with ICNIRP (1998) Guidelines for limiting exposure in time-varying electric, magnetic, and electromagnetic fields (up to 300 GHz), Health Physics 74, 494-522 RF Exposure limits of 10 W/kg averaged over 10grams of contiguous tissue.

Based on the information and the testing results provided herein, the undersigned certifies that when used as stated in the operating instructions supplied, said product complies with the national and international reference standards and guidelines listed in section 4.0 of this report. This report shall not be reproduced without written approval from an officially designated representative of the Motorola Solutions Inc EME Laboratory. I attest to the accuracy of the data and assume full responsibility for the completeness of these measurements. This reporting format is consistent with the suggested guidelines of the TIA TSB-150 December 2004. The results and statements contained in this report pertain only to the device(s) evaluated.

Deanna Zakharia
EME Lab Senior Resource Manager,
Laboratory Director
Approval Date: 12/4/2015

Part 1 of 2

1.0	Introduction.....	4
2.0	FCC SAR Summary.....	4
3.0	Abbreviations / Definitions.....	4
4.0	Referenced Standards and Guidelines	5
5.0	SAR Limits	6
6.0	Description of Devices Under Test (DUT).....	6
7.0	Optional Accessories and Test Criteria.....	8
7.1	Antennas	8
7.2	Batteries	8
7.3	Body worn Accessories.....	9
7.4	Audio Accessories	10
8.0	Description of Test System.....	11
8.1	Descriptions of Robotics/Probes/Readout Electronics	11
8.2	Description of Phantom(s).....	12
8.3	Description of Simulated Tissue.....	12
9.0	Additional Test Equipment.....	13
10.0	SAR Measurement System Validation and Verification	14
10.1	System Validation.....	14
10.2	System Verification	14
10.3	Equivalent Tissue Test Results.....	15
11.0	Environmental Test Conditions	17
12.0	DUT Test Setup and Methodology.....	17
12.1	Measurements	17
12.2	DUT Configuration(s).....	18
12.3	DUT Positioning Procedures	18
12.3.1	Body.....	18
12.3.2	Head.....	18
12.3.3	Face.....	18
12.4	DUT Test Channels	19
12.5	SAR Result Scaling Methodology.....	19
12.6	DUT Test Plan	20
13.0	DUT Test Data.....	20
13.1	LMR assessments at the Body for 406.125 – 512 MHz band.....	20
13.2	WLAN assessment at the Body for 802.11 b/g/n.....	33
13.3	LMR assessments at the Face for 406.125-512 MHz band	36
13.4	WLAN assessment at the Face for 802.11 b/g/n.....	38
13.5	Assessment for Industry Canada.....	39
13.6	Assessment at the Bluetooth band	40
13.7	Assessment outside FCC Part 90.....	40
13.8	Shortened Scan Assessment.....	41
14.0	Simultaneous Transmission Exclusion for BT	41
15.0	Simultaneous Transmission between LMR, WLAN and BT	42

16.0 Results Summary 42
 17.0 Variability Assessment 43
 18.0 System Uncertainty 44

APPENDICES

A Measurement Uncertainty Budget 45
 B Probe Calibration Certificates 50
 C Dipole Calibration Certificates 81

Part 2 of 2

APPENDICES

D System Verification Check Scans 2
 E DUT Scans 19
 F Shorten Scan of Highest SAR Configuration 37
 G DUT Test Position Photos 38
 H DUT, Body worn and audio accessories Photos 39

Report Revision History

Date	Revision	Comments
12/04/2015	A	Initial release

1.0 Introduction

This report details the utilization, test setup, test equipment, and test results of the Specific Absorption Rate (SAR) measurements performed at the Motorola Solutions Inc. EME Test Laboratory for handheld portable model number PMUE3836B and PMUE3838B. These devices are classified as Occupational/Controlled.

2.0 FCC SAR Summary

Table 1

Equipment Class	Frequency band (MHz)	Max Calc at Body (W/kg)		Max Calc at Face (W/kg)	
		1g-SAR	10g-SAR	1g-SAR	10g-SAR
TNF	406.125 -512 MHz (LMR)	6.59	4.78	4.29	3.13
*DSS	2402-2480 MHz (Bluetooth)	NA	NA	NA	NA
DTS	2412-2462 MHz (WLAN 802.11 b/g/n)	0.06	0.03	0.05	0.02
**Simultaneous Results		6.65	4.81	4.34	3.15

*Results not required per KDB (refer to sections 13.6 and 14.0)

3.0 Abbreviations / Definitions

BT: Bluetooth
 CNR: Calibration Not Required
 CW: Continuous Wave
 DSS: Direct Spread Spectrum
 DTS: Digital Transmission System
 DUT: Device Under Test
 EME: Electromagnetic Energy
 FHSS: Frequency Hopping Spread Spectrum
 Li-Ion: Lithium-Ion
 Li-Mn: Lithium Manganese
 LKP: Limited Keypad
 LMR: Land Mobile Radio
 NA: Not Applicable
 NiMH: Nickel Metal Hydride
 NKP: No Keypad
 OFDM: Orthogonal Frequency Division Multiplexing
 PTT: Push to Talk
 RF: Radio Frequency
 SAR: Specific Absorption Rate
 TNF: Licensed Non-Broadcast Transmitter Held to Face
 WLAN: Wireless Local Area Network

Audio accessories: These accessories allow communication while the DUT is worn on the body.

Body worn accessories: These accessories allow the DUT to be worn on the body of the user.

Maximum Power: Defined as the upper limit of the production line final test station.

4.0 Referenced Standards and Guidelines

This product is designed to comply with the following applicable national and international standards and guidelines.

- IEC62209-1 (2005) Procedure to determine the specific absorption rate (SAR) for hand-held devices used in close proximity to the ear (frequency range of 300 MHz to 3 GHz)
- Federal Communications Commission, “Evaluating Compliance with FCC Guidelines for Human Exposure to Radio frequency Electromagnetic Fields”, OET Bulletin 65, FCC, Washington, D.C.: 1997.
- IEEE 1528 (2003), Recommended Practice for Determining the Peak Spatial-Average Specific Absorption Rate (SAR) in the Human Head from Wireless Communications Devices: Measurement Techniques
- American National Standards Institute (ANSI) / Institute of Electrical and Electronics Engineers (IEEE) C95. 1-1992
- Institute of Electrical and Electronics Engineers (IEEE) C95.1-2005
- International Commission on Non-Ionizing Radiation Protection (ICNIRP) 1998
- Ministry of Health (Canada) Safety Code 6 (2015), Limits of Human Exposure to Radio frequency Electromagnetic Fields in the Frequency Range from 3 kHz to 300 GHz
- RSS-102 (Issue 5) – Radio Frequency (RF) Exposure Compliance of Radiocommunication Apparatus (All Frequency Bands)
- Australian Communications Authority Radio communications (Electromagnetic Radiation - Human Exposure) Standard (2014)
- ANATEL, Brazil Regulatory Authority, Resolution No. 303 of July 2, 2002 "Regulation of the limitation of exposure to electrical, magnetic, and electromagnetic fields in the radio frequency range between 9 kHz and 300 GHz." and “Attachment to resolution # 303 from July 2, 2002”
- IEC62209-2 Edition 1.0 2010-03, Human exposure to radio frequency fields from hand-held and body-mounted wireless communication devices – Human models, instrumentation, and procedures – Part 2: Procedure to determine the specific absorption rate (SAR) for wireless communication devices used in close proximity to the human body (frequency range of 30 MHz to 6 GHz).

- FCC KDB – 643646 D01 SAR Test for PTT Radios v01r03
- FCC KDB – 865664 D01 SAR Measurement 100 MHz to 6 GHz v01r04
- FCC KDB – 865664 D02 RF Exposure Reporting v01r02
- FCC KDB – 447498 D01 General RF Exposure Guidance v06
- FCC KDB – 248227 D01 802.11 Wi-Fi SAR v02r02

5.0 SAR Limits

Table 2

EXPOSURE LIMITS	SAR (W/kg)	
	(General Population / Uncontrolled Exposure Environment)	(Occupational / Controlled Exposure Environment)
Spatial Average - ANSI - (averaged over the whole body)	0.08	0.4
Spatial Peak - ANSI - (averaged over any 1-g of tissue)	1.6	8.0
Spatial Peak – ICNIRP/ANSI - (hands/wrists/feet/ankles averaged over 10-g)	4.0	20.0
Spatial Peak - ICNIRP - (Head and Trunk 10-g)	2.0	10.0

6.0 Description of Devices Under Test (DUT)

These portable devices operate in the LMR bands using frequency modulation (FM). These devices also contain WLAN technology for data capabilities over 802.11 b/g/n wireless networks and Bluetooth technology for short range wireless devices.

The LMR bands in these devices operate in a half duplex system. A half duplex system only allows the user to transmit or receive. These devices cannot transmit and receive simultaneously. The user must stop transmitting in order to receive a signal or listen for a response, regardless of PTT button or use of voice activated audio accessories. This type of operation, along with the RF safety booklet, which instructs the user to transmit no more than 50% of the time, justifies the use of 50% duty factor for this device.

These devices also incorporate a Bluetooth v4.0, which include classis Bluetooth, Bluetooth high speed and Bluetooth low energy. It is Class 1 Bluetooth device with Frequency Hopping Spread Spectrum (FHSS) technology. The Bluetooth radio modem is used to wireless link audio accessories. The maximum actual transmission duty cycle is imposed by the Bluetooth standard. The maximum duty cycle for BT is derived from 5-slots packet type operation which consists of receiving on 1-slot and transmitting on 5-slots, and thus maximum duty cycle = 77.01%.

WLAN 802.11 b/g/n operate using Direct Sequence Spread Spectrum (DSSS) and Orthogonal Frequency-Division Multiplexing (OFDM) accordance with the IEEE 802.11 b/g/n

Table 3 below summarizes the technologies, bands, maximum duty cycles and maximum output powers. Maximum output powers are defined as upper limit of the production line final test station.

Table 3

Technologies	Band (MHz)	Transmission	Duty Cycle (%)	Max Power (W)
LMR	403-512	FM	*50	4.80
BT	2402-2480	FHSS	77.01	0.0100
WLAN	2412-2462	802.11b	100	0.0699
WLAN	2412-2462	802.11g	100	0.0186
WLAN	2412-2462	802.11n	100	0.0126

Note - * includes 50% PTT operation

The intended operating positions are “at the face” with the DUT at least 1 inch from the mouth, and “at the body” by means of the offered body worn accessories. Body worn audio and PTT operation is accomplished by means of optional remote accessories that are connected to the radio. Operation at the body without an audio accessory attached is possible by means of BT accessories.

7.0 Optional Accessories and Test Criteria

These devices are offered with optional accessories. All accessories were individually evaluated during the test plan creation to determine if testing was required per the guidelines outlined in “SAR Test Reduction Considerations for Occupational PTT Radios” FCC KDB 643646 to assess compliance of the devices. The following sections identify the test criteria and details for each accessory category. Refer to Exhibit 7B for antenna separation distances.

7.1 Antennas

There are optional removable antennas and one internal BT/WLAN antenna offered for these products. The Table below lists their descriptions.

Table 4

Antenna Models	Description	Selected for test	Tested
PMAE4079A	Whip, 403- 527 MHz , ¼ Wave, 0 dBd	Yes	Yes
PMAE4071A	Stubby, 470- 527 MHz , ¼ Wave, -1 dBd	Yes	Yes
PMAE4069A	Stubby, 403-450 MHz , ¼ Wave, -1 dBd	Yes	Yes
PMAE4070A	Stubby, 440-490 MHz , ¼ Wave, -1 dBd	Yes	Yes
85012026001	Internal BT/WLAN, 2402-2484 MHz, ¼ Wave, 0 dBi	Yes	Yes; for WLAN only

7.2 Batteries

There are optional batteries offered for these products. The Table below lists their descriptions.

Table 5

Battery Models	Description	Selected for test	Tested	Comments
PMNN4435AR	Li-Mn 1400 mAh low temp -30C battery Submersible (IP57)	Yes	Yes	
PMNN4417BR	Impress IP56 Li-Ion 1600T 1500 mAh	Yes	Yes	
PMNN4406BR	Standard IP67 Li-Ion 1600T 1500 mAh	Yes	Yes	
PMNN4491A	Impress Slim Battery 2050 mAh	Yes	Yes	Default battery for body testing
PMNN4490A	Impress TIA4950 Hi-Capacity 2900 mAh	Yes	Yes	
PMNN4418BR	Impress IP56 Li-Ion 2250T 2150 mAh	Yes	Yes	
PMNN4415A	Standard IP56 NiMH 1400T 1300 mAh	Yes	Yes	
PMNN4416BR	Standard IP56 Li-Ion 1600T 1500mAh	Yes	Yes	
PMNN4493A	Impress Ultra Hi-Capacity 3000 mAh	Yes	Yes	Default battery for face testing
PMNN4488A	Impress Ultra Hi-Capacity 3000 mAh with vibrator	Yes	Yes	Compatible with body worn PMLN7296A only.
PMNN4409BR	Impress Hi-Capacity Li-Ion non-FM 2150 mAh	Yes	Yes	
PMNN4407BR	Impress Li-Ion Slim battery 1500 mAh	Yes	Yes	
PMNN4463A	Li-Ion IP57 2000 mAh	Yes	Yes	

7.3 Body worn Accessories

All body worn accessories were considered. The Table below lists the body worn accessories, and body worn accessory descriptions.

Table 6

Body worn Models	Description	Selected for test	Tested	Comments
NTN5243A	Adjustable Black Nylon Carrying Strap, attaches to D-ring on cases	Yes	Yes	Tested with PMLN5866A, PMLN5864A, PMLN5870A
PMLN5866A	Hard Leather Carry Case with 3.0" Swivel belt loop - No display	Yes	Yes	Tested with NTN5243A with belt loop removed.
PMLN5865A	Hard Leather Carry Case with 3.0" Swivel belt loop - LKP	No	No	By similarity to PMLN5866A
PMLN5867A	Hard Leather Carry Case with 2.5" Swivel belt loop - LKP	No	No	By similarity to PMLN5866A
PMLN5868A	Hard Leather Carry Case with 2.5" Swivel belt loop - No display	No	No	By similarity to PMLN5866A
PMLN5870A	Nylon Carry Case 3.0" Fixed belt loop- No display	Yes	Yes	Tested with NTN5243A
PMLN5869A	Nylon Carry Case 3.0" Fixed belt loop- LKP	No	No	By similarity to PMLN5870A
PMLN5864A	Hard Leather Carry Case 3.0" Fixed belt loop- No display	Yes	Yes	Tested with NTN5243A
PMLN5863A	Hard Leather Carry Case 3.0" Fixed belt loop- LKP	No	No	By similarity to PMLN5864A
PMLN4651A	2 Inch Belt Clip	Yes	Yes	
PMLN7008A	2.5 Inch Belt Clip	Yes	Yes	
PMLN7296A	Vibrating Belt Clip	Yes	Yes	Only applicable for battery with vibrator PMNN4488A
HLN6602A	Universal Chest Pack	Yes	Yes	
RLN4570A	Break-a-way Chest Pack with radio holder, pen holder and velcro secured pouch	Yes	Yes	
RLN4815A	RadioPAk Radio Utility Case	Yes	Yes	
RLN6487A	Leather Radio Strap - XL	Yes	Yes	Tested with RLN6488A & PMLN5870A.
RLN6488A	Anti-Sway Strap Leather Radio Strap	Yes	Yes	Tested with RLN6487A & PMLN5870A.
RLN6486A	Leather Radio Strap	No	No	By similarity to RLN6487A
HLN9985B	Waterproof Bag with Large Strap	No	No	For convenient carry DUT purpose only.
4280384F89	RadioPAk extension belt for waists larger than 40 inches.	No	No	Extension belt for RLN4815A
RLN4295A	Small Clip, epaulet strap	No	No	small Clip, epaulet strap worn on the shoulder to hold a RSM
PMLN6066A	Slim Connector Aesthetic Cover	No	No	To cover accessory connector on DUT when no accessory is attached.
4200865599	1.75 Inch Wide Leather Belt	No	No	Already cover with worst case configuration –“ Carry Case & Carry Strap”

7.4 Audio Accessories

All audio accessories were considered. The Table below lists the offered audio accessories and their descriptions. Exhibit 7B illustrates photos of the tested audio accessories.

Table 7

Audio Acc. Models	Description	Selected for test	Tested	Comments
PMMN4073A	IMPRES RSM, small 3.5 jack	Yes	Yes	Tested with RLN4885B
PMMN4076A	Remote Speaker Microphone Small with 3.5mm Jack	No	No	By similarity to PMMN4073A
PMMN4071A	IMPRES RSM large 3.5 jack NC	Yes	Yes	Tested with RLN4885B
RLN4885B	Receive-Only Covered Earbud with Coiled Cord	Yes	Yes	Tested with PMMN4073A & PMMN4071A
PMMN4075A	Remote Speaker Microphone Small, No Emergency, IP57	Yes	Yes	
PMLN5724A	2 Wire Surveillance Kit, Black	Yes	Yes	
PMLN5726A	2-Wire Surveillance Kit, Beige	No	No	By similarity to PMLN5724A, only color different.
PMLN7269A	2-wire surveillance kit with quick disconnect clear acoustic tube, black	Yes	Yes	
PMLN7270A	2-wire surveillance kit with quick disconnect clear acoustic tube, beige	No	No	By similarity to PMLN7269A, only color different.
PMLN6754A	3-wire surveillance kit w/ trans tube-black	Yes	Yes	
PMLN6755A	3-wire surveillance kit w/ trans tube-beige	No	No	By similarity to PMLN6754A, only color different.
PMLN5727A	Earpiece Inline Mic/PTT, Swvl, MagOne	Yes	Yes	Default Audio accessory
PMLN5733A	Earbud with In-Line Mic/PTT, MagOne	No	No	By similarity to PMLN5727A
PMLN6757A	Earpiece, adjust d-style w/in-line PTT/Mic	Yes	Yes	
PMLN5732A	Earset w/ Boom Mic, Mag One	Yes	Yes	
PMLN6761A	Ultra-Lite Headset MagOne	Yes	Yes	
PMLN5731A	Heavy duty Headset, Noise Cancellation, Inline PTT	Yes	Yes	
PMLN6635A	Lightweight Headset	Yes	Yes	
PMLN6759A	Temple transducer	Yes	Yes	
PMLN6760A	Behind the head heavy duty headset	Yes	Yes	
PMLN6763A	Behind the Head Heavy Duty Headset Intrinsicly safe TIA	Yes	Yes	
WADN4190B	Receive-Only Flexible Earpiece	No	No	Receive only.
PMLN4620B	D-Shell Receive only earpiece (one size)	No	No	Receive only.
RLN4941A	Receive-Only Earpiece w/trans tube & Rubber Eartip	No	No	Receive only.
RMN4055B	HT Series Listen Only Over-The-Head Headset with 3.5mm NON threaded connector	No	No	Receive only.
RMN5132A	HT Series Listen Only Neckband Headset with 3.5mm NON threaded connector	No	No	Receive only.

8.0 Description of Test System



8.1 Descriptions of Robotics/Probes/Readout Electronics

Table 8

Dosimetric System type	System version	DAE type	Probe Type
Schmid & Partner Engineering AG SPEAG DASY 5	52.8.8.1222	DAE4	ES3DV3 EX3DV4 (E-Field)

The DASY5™ system is operated per the instructions in the DASY5™ Users Manual. The complete manual is available directly from SPEAG™. All measurement equipment used to assess SAR compliance was calibrated according to ISO/IEC 17025 A2LA guidelines. Section 9.0 presents additional test equipment information. Appendices B and C present the applicable calibration certificates. The E-field probe first scans a coarse grid over a large area inside the phantom in order to locate the interpolated maximum SAR distribution. After the coarse scan measurement, the probe is automatically moved to a position at the interpolated maximum. The subsequent scan can directly use this position as reference for the cube evaluations.

8.2 Description of Phantom(s)

Table 9

Phantom Type	Phantom(s) Used	Material Parameters	Phantom Dimensions LxWxD (mm)	Material Thickness (mm)	Support Structure Material	Loss Tangent (wood)
Triple Flat	NA	200MHz -6GHz; Er = 3-5, Loss Tangent = ≤0.05	280x175x175	2mm +/- 0.2mm	Wood	< 0.05
SAM	NA	300MHz -6GHz; Er = < 5, Loss Tangent = ≤0.05	Human Model			
Oval Flat	√	300MHz -6GHz; Er = 4+/- 1, Loss Tangent = ≤0.05	600x400x190			

8.3 Description of Simulated Tissue

The sugar based simulate tissue is produced by placing the correct measured amount of De-ionized water into a large container. Each of the dried ingredients are weighed and added to the water carefully to avoid clumping. If the solution has a high sugar concentration the water is pre-heated to aid in dissolving the ingredients. For Diacetin and similar type simulates, sugar and HEC ingredients are not needed. The solution is mixed thoroughly, covered, and allowed to sit overnight prior to use.

The simulated tissue mixture was mixed based on the Simulated Tissue Composition indicated in Table 10. During the daily testing of this product, the applicable mixture was used to measure the Di-electric parameters at each of the tested frequencies to verify that the Di-electric parameters were within the tolerance of the tissue specifications.

Simulated Tissue Composition (percent by mass)

Table 10

Ingredients	450 MHz		2450 MHz	
	Head	Body	Head	Body
Sugar	56.00	46.50	0	0
Diacetin	0	0	51.00	34.50
De ionized –Water	39.10	50.53	48.75	65.20
Salt	3.80	1.87	0.15	0.20
HEC	1.00	1.00	0	0
Bact.	0.10	0.10	0.10	0.10

9.0 Additional Test Equipment

The Table below lists additional test equipment used during the SAR assessment.

Table 11

Equipment Type	Model Number	Serial Number	Calibration Date	Calibration Due Date
Speag Probe	ES3DV3	3122	6/19/2015	6/19/2016
Speag Probe	EX3DV4	7364	6/23/2015	6/23/2016
Speag DAE	DAE4	1488	7/14/2015	7/14/2016
Speag DAE	DAE4	1483	6/16/2015	6/16/2016
Signal Generator	E4438C	MY47272101	8/12/2014	8/12/2016
Power Meter	E4419B	MY40330364	5/29/2015	5/29/2017
Power Sensor	8482B	3318A07392	6/3/2015	6/3/2016
Power Meter	E4418B	MY45100739	5/29/2015	5/29/2017
Power Sensor	8481B	MY41091243	3/6/2015	3/6/2016
Power Meter	E4416A	MY50001037	2/16/2015	2/16/2016
Power Sensor	N8481B	MY51450002	2/23/2015	2/23/2016
Broadband Power Sensor	NRP-Z11	120907	2/11/2015	2/11/2016
Power Amplifier	5S1G4	312988	CNR	CNR
Power Amplifier	10W1000C	312859	CNR	CNR
Bi-directional Coupler	3020A	41935	8/27/2015	8/27/2016
Bi-directional Coupler	3022	81639	7/6/2015	7/6/2016
Dickson Temperature Recorder	TM320	06153216	7/20/2015	7/20/2016
Temperature Probe	DTM3000	3257	8/28/2015	8/28/2016
Dielectric Assessment Kit	DAK-12	1069	5/12/2015	5/12/2016
Network Analyzer	E5071B	MY42403218	8/4/2015	8/4/2016
Speag Dipole	D450V3	1053	3/17/2015	3/17/2017
Speag Dipole	D2450V2	781	3/20/2015	3/20/2017

10.0 SAR Measurement System Validation and Verification

DASY output files of the probe/dipole calibration certificates and system verification test results are included in appendices B, C & D respectively.

10.1 System Validation

The SAR measurement system was validated according to procedures in KDB 865664. The validation status summary Table is below.

Table 12

Dates	Probe Calibration Point	Probe SN	Measured Tissue Parameters		Validation			
			σ	ϵ_r	Sensitivity	Linearity	Isotropy	
CW								
8/25/2015	Body	450	3122	0.91	54.8	Pass	Pass	Pass
8/26/2015	Head	450		0.91	43.9	Pass	Pass	Pass
CW								
7/15/2015	Body	2450	7364	1.86	48.9	Pass	Pass	Pass
7/15/2015	Head	2450		1.77	36.4	Pass	Pass	Pass

10.2 System Verification

System verification checks were conducted each day during the SAR assessment. The results are normalized to 1W. Appendix D includes DASY plots for each day during the SAR assessment. The Table below summarizes the daily system check results used for the SAR assessment.

Table 13

Probe Serial #	Tissue Type	Dipole Kit / Serial #	Ref SAR @ 1W (W/kg)	System Check Results Measured (W/kg)	System Check Test Results when normalized to 1W (W/kg)	Tested Date
3122	FCC Body	SPEAG D450V3 / 1053	4.41 +/- 10%	1.18	4.72	11/7/2015
				1.20	4.80	11/8/2015
				1.16	4.64	11/9/2015
				1.19	4.76	11/10/2015
				1.21	4.84	11/11/2015
				1.19	4.76	11/12/2015
				1.20	4.80	11/13/2015*
				1.18	4.72	11/15/2015
				1.18	4.72	11/16/2015*
	1.18		4.72	11/18/2015*		
7364	IEEE/IEC Head	SPEAG D2450V2 / 781	4.45 +/- 10%	1.16	4.64	11/17/2015
	FCC Body			1.15	4.60	11/18/2015
				1.17	4.68	11/19/2015
7364	IEEE/IEC Head	SPEAG D2450V2 / 781	52.30 +/- 10%	12.8	51.20	11/13/2015*
	FCC Body			12.4	49.60	11/16/2015
				13.3	53.20	11/17/2015

Note: * System performance check cover next testing day (within 24 hours).

10.3 Equivalent Tissue Test Results

Simulated tissue prepared for SAR measurements is measured daily and within 24 hours prior to actual SAR testing to verify that the tissue is within +/- 5% of target parameters at the center of the transmit band. This measurement is done using the applicable equipment indicated in section 9.0. The Table below summarizes the measured tissue parameters used for the SAR assessment.

Table 14

Frequency (MHz)	Tissue Type	Conductivity Target (S/m)	Dielectric Constant Target	Conductivity Meas. (S/m)	Dielectric Constant Meas.	Tested Date
403	FCC Body	0.93 (0.88-0.98)	57.2 (54.3-60.1)	0.89	55.90	11/16/2015
403	IEEE/ IEC Head	0.87 (0.83-0.91)	44.1 (41.9-46.3)	0.84	46.00	11/18/2015
406	IEEE/ IEC Head	0.87 (0.83-0.91)	44 (41.8-46.2)	0.84	45.90	11/17/2015
421	FCC Body	0.94 (0.89-0.98)	57 (54.1-59.8)	0.92	55.30	11/7/2015
				0.91	55.00	11/9/2015
				0.91	56.10	11/10/2015
				0.90	56.20	11/11/2015
				0.90	56.10	11/12/2015
				0.91	56.40	11/13/2015
				0.91	56.40	11/14/2015
				0.91	55.60	11/15/2015
440	FCC Body	0.94 (0.89-0.99)	56.8 (54-59.6)	0.92	54.90	11/8/2015
				0.93	54.70	11/9/2015
450	FCC Body	0.94 (0.89-0.99)	56.7 (53.9-59.5)	0.94	54.90	11/7/2015
				0.92	54.80	11/8/2015
				0.93	54.60	11/9/2015
				0.93	55.7	11/10/2015
				0.93	55.7	11/11/2015
				0.93	55.6	11/12/2015
				0.94	55.9	11/13/2015*
				0.95	55.1	11/15/2015
				0.93	55.20	11/16/2015*
				0.93	55.60	11/18/2015*
450	IEEE/ IEC Head	0.87 (0.83-0.91)	43.5 (41.3-45.7)	0.88	45.00	11/17/2015
				0.85	44.30	11/18/2015
				0.85	44.0	11/19/2015
459	FCC Body	0.94 (0.89-0.99)	56.7 (53.8-59.5)	0.95	54.80	11/7/2015
				0.94	54.40	11/9/2015
				0.94	55.60	11/10/2015
				0.94	55.00	11/15/2015
				0.94	55.10	11/16/2015
				0.94	55.10	11/17/2015
				0.93	55.50	11/19/2015
470	FCC Body	0.94 (0.89-0.99)	56.6 (53.8-59.5)	0.96	54.70	11/7/2015
				0.94	54.50	11/8/2015
				0.95	54.30	11/9/2015
				0.95	55.40	11/10/2015
				0.94	55.40	11/11/2015
				0.94	55.30	11/12/2015

Table 14 Continued

Frequency (MHz)	Tissue Type	Conductivity Target (S/m)	Dielectric Constant Target	Conductivity Meas. (S/m)	Dielectric Constant Meas.	Tested Date
470	FCC Body	0.94 (0.89-0.99)	56.6 (53.8-59.5)	0.95	55.60	11/13/2015*
				0.95	54.80	11/15/2015
				0.95	54.90	11/16/2015
470	IEEE/ IEC Head	0.87 (0.83-0.91)	43.4 (41.2-45.6)	0.89	44.60	11/17/2015
				0.87	43.60	11/19/2015
490	FCC Body	0.94 (0.90-0.99)	56.5 (53.7-59.3)	0.97	54.40	11/7/2015
				0.97	54.00	11/9/2015
498	FCC Body	0.94 (0.90-0.99)	56.5 (53.7-59.3)	0.98	54.30	11/7/2015
				0.97	53.90	11/9/2015
				0.97	55.20	11/13/2015
498	IEEE/ IEC Head	0.87 (0.83-0.92)	43.2 (41.1-45.4)	0.92	44.10	11/17/2015
512	FCC Body	0.94 (0.90-0.99)	56.5 (53.6-59.3)	0.98	53.70	11/9/2015
520	FCC Body	0.95 (0.90-0.99)	56.4 (53.6-59.2)	0.99	54.2	11/16/2015
520	IEEE/ IEC Head	0.87 (0.83-0.92)	43.1 (41.0-45.3)	0.91	43	11/18/2015
527	FCC Body	0.95 (0.90-0.99)	56.4 (53.6-59.2)	0.99	54.1	11/16/2015
				0.99	54.5	11/18/2015
527	IEEE/ IEC Head	0.88 (0.83-0.92)	43.1 (40.9-45.2)	0.91	42.9	11/18/2015
2412	FCC Body	1.91 (1.82-2.01)	52.8 (47.5-58.0)	1.99	47.9	11/13/2015*
				1.93	47.6	11/16/2015
2412	IEEE/ IEC Head	1.77 (1.68-1.86)	39.3 (35.3-43.2)	1.83	35.5	11/17/2015
2450	FCC Body	1.95 (1.85-2.05)	52.7 (47.4-58.0)	2.04	47.7	11/13/2015*
				1.97	47.5	11/16/2015
2450	IEEE/ IEC Head	1.80 (1.71-1.89)	39.2 (35.3-43.1)	1.88	35.4	11/17/2015

Note: * Tissue cover next testing day (within 24 hours).

11.0 Environmental Test Conditions

The EME Laboratory's ambient environment is well controlled resulting in very stable simulated tissue temperature and therefore stable dielectric properties. Simulated tissue temperature is measured prior to each scan to insure it is within $\pm 2^{\circ}\text{C}$ of the temperature at which the dielectric properties were determined. The liquid depth within the phantom used for measurements was at least 15cm. Additional precautions are routinely taken to ensure the stability of the simulated tissue such as covering the phantoms when scans are not actively in process in order to minimize evaporation. The lab environment is continuously monitored. The Table below presents the range and average environmental conditions during the SAR tests reported herein:

Table 15

	Target	Measured
Ambient Temperature	18 – 25 °C	Range: 20.7 – 24.3°C Avg. 22.2 °C
Tissue Temperature	NA	Range: 20.2 - 21.5°C Avg. 20.7°C

The EME Lab RF environment uses a Spectrum Analyzer to monitor for extraneous large signal RF contaminants that could possibly affect the test results. If such unwanted signals are discovered the SAR scans are repeated.

12.0 DUT Test Setup and Methodology

12.1 Measurements

SAR measurements were performed using the DASY system described in section 8.0 using zoom scans. Oval flat phantoms filled with applicable simulated tissue were used for body and face testing.

The Table below includes the step sizes and resolution of area and zoom scans per KDB 865664 requirements.

Table 16

Description		≤ 3 GHz	> 3 GHz
Maximum distance from closest measurement point (geometric center of probe sensors) to phantom surface		5 ± 1 mm	$\frac{1}{2} \cdot \delta \cdot \ln(2) \pm 0.5$ mm
Maximum probe angle from probe axis to phantom surface normal at the measurement location		30° ± 1°	20° ± 1°
Maximum area scan spatial resolution: Δx_{Area} , Δy_{Area}		≤ 2 GHz: ≤ 15 mm 2 – 3 GHz: ≤ 12 mm	3 – 4 GHz: ≤ 12 mm 4 – 6 GHz: ≤ 10 mm
		When the x or y dimension of the test device, in the measurement plane orientation, is smaller than the above, the measurement resolution must be ≤ the corresponding x or y dimension of the test device with at least one measurement point on the test device.	
Maximum zoom scan spatial resolution: Δx_{Zoom} , Δy_{Zoom}		≤ 2 GHz: ≤ 8 mm 2 – 3 GHz: ≤ 5 mm*	3 – 4 GHz: ≤ 5 mm* 4 – 6 GHz: ≤ 4 mm*
Maximum zoom scan spatial resolution, normal to phantom surface	uniform grid: $\Delta z_{Zoom}(n)$	≤ 5 mm	3 – 4 GHz: ≤ 4 mm 4 – 5 GHz: ≤ 3 mm 5 – 6 GHz: ≤ 2 mm
Note: δ is the penetration depth of a plane-wave at normal incidence to the tissue medium; see draft standard IEEE P1528-2011 for details. * When zoom scan is required and the reported SAR from the area scan based 1-g SAR estimation procedures of KDB 447498 is ≤ 1.4 W/kg, ≤ 8 mm, ≤ 7 mm and ≤ 5 mm zoom scan resolution may be applied, respectively, for 2 GHz to 3 GHz, 3 GHz to 4 GHz and 4 GHz to 6 GHz.			

12.2 DUT Configuration(s)

The DUT is a portable device operational at the body and face as described in section 6.0 while using the applicable accessories listed in section 7.0. All accessories listed in section 7.0 of this report were considered when implementing the guidelines specified in KDB 643646.

12.3 DUT Positioning Procedures

The positioning of the device for each body location is described below and illustrated in Appendix G.

12.3.1 Body

The DUT was positioned in normal use configuration against the phantom with the offered body worn accessory as well as with and without the offered audio accessories as applicable.

12.3.2 Head

Not applicable.

12.3.3 Face

The DUT was positioned with its' front sides separated 2.5cm from the phantom.

12.4 DUT Test Channels

The number of test channels was determined by using the following IEEE 1528 equation. The use of this equation produces the same or more test channels compared to the FCC KDB 447498 number of test channels formula.

$$N_c = 2 * \text{roundup}[10 * (f_{\text{high}} - f_{\text{low}}) / f_c] + 1$$

Where

N_c = Number of channels

F_{high} = Upper channel

F_{low} = Lower channel

F_c = Center channel

12.5 SAR Result Scaling Methodology

The calculated 1-gram and 10-gram averaged SAR results indicated as “Max Calc. 1g-SAR” and “Max Calc.10g-SAR” in the data Tables is determined by scaling the measured SAR to account for power leveling variations and drift. Appendix F includes a shortened scan to justify SAR scaling for drift. For this device the “Max Calc. 1g-SAR” and “Max Calc.10g-SAR” are scaled using the following formula:

$$\text{Max_Calc} = \text{SAR_meas} \cdot 10^{\frac{-\text{Drift}}{10}} \cdot \frac{P_{\text{max}}}{P_{\text{int}}} \cdot \text{DC}$$

P_{max} = Maximum Power (W)

P_{int} = Initial Power (W)

Drift = DASY drift results (dB)

SAR_meas = Measured 1-g or 10-g Avg. SAR (W/kg)

DC = Transmission mode duty cycle in % where applicable

50% duty cycle is applied for PTT operation

Note: for conservative results, the following are applied:

If $P_{\text{int}} > P_{\text{max}}$, then $P_{\text{max}}/P_{\text{int}} = 1$.

Drift = 1 for positive drift

Additional SAR scaling was applied using the methodologies outlined in FCC KDB 865664 using tissue sensitivity values. SAR was scaled for conditions where the tissue permittivity was measured above the nominal target and for tissue conductivity that was measured below the nominal target. Negative or reduced SAR scaling is not permitted.

12.6 DUT Test Plan

The guidelines and requirements outlined in section 4.0 were used to assess compliance of this device. All modes of operation identified in section 6.0 were considered during the development of the test plan. All tests were performed in CW and 50% duty cycle was applied to PTT configurations in the final results.

Standalone and simultaneous BT testing were assessed in sections 13.6 and 14.0 per the guidelines of KDB 447498.

WLAN tests were performed in 802.11b mode using a duty cycle of 99.87% with results scaled to 100% as per guidelines of KDB 248227.

13.0 DUT Test Data

13.1 LMR assessments at the Body for 406.125 – 512 MHz band

Battery PMNN4491A was selected as the default battery for assessments at the Body because it is the thinnest battery (refer to Exhibit 7B for battery illustration). The default battery was used during conducted power measurements for all test channels within FCC allocated frequency range (406.125 -512 MHz) which are listed in Table 17. The channel with the highest conducted power will be identified as the default channel per KDB 643646 (SAR Test for PTT Radios). SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 17

Test Freq (MHz)	Power (W)
406.125	4.78
420.800	4.79
440.000	4.69
450.000	4.75
459.100	4.75
470.000	4.78
490.000	4.73
498.000	4.78
512.000	4.63

Assessments at the Body with Body worn HLN6602A

DUT assessment with offered antennas, default battery and, default body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 18

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#	
PMAE4079A	PMNN4491A	HLN6602A	PMLN5727A	406.125								
				420.800	4.80	-0.46	4.23	3.10	2.35	1.72	TLC-AB-151107-02	
				440.000								
				450.000								
				459.100								
				470.000								
				490.000								
				498.000								
PMAE4071A	PMNN4491A	HLN6602A	PMLN5727A	512.000								
				470.000	4.80	-0.33	7.79	5.61	4.20	3.03	TLC-AB-151107-03	
				490.000	4.80	-0.55	7.03	5.06	3.99	2.87	TLC-AB-151107-04	
				498.000	4.77	-0.41	6.91	4.94	3.82	2.73	TLC-AB-151107-05	
PMAE4069A	PMNN4491A	HLN6602A	PMLN5727A	512.000								
				406.125								
				420.800	4.69	-0.15	4.14	3.03	2.19	1.61	TLC-AB-151107-06	
				440.000								
PMAE4070A	PMNN4491A	HLN6602A	PMLN5727A	450.000								
				440.000	4.76	-0.22	5.38	3.88	2.85	2.06	KKL-AB-151108-02	
				450.000	4.79	-0.34	8.12	5.84	4.40	3.16	TLC-AB-151107-10	
				459.100	4.80	-0.49	7.82	5.62	4.38	3.15	TLC-AB-151107-08	
				470.000	4.79	-0.49	7.72	5.58	4.33	3.13	TLC-AB-151107-07	
Assessment of Additional Batteries	PMAE4071A	PMNN4417BR	HLN6602A	PMLN5727A	490.000	4.70	-0.54	3.95	2.84	2.28	1.64	TLC-AB-151107-09
					470.000	4.80	-0.56	8.54	6.16	4.86	3.50	KKL-AB-151108-03
	PMAE4070A	PMNN4406BR	HLN6602A	PMLN5727A	450.000	4.80	-0.45	8.26	5.98	4.58	3.32	KKL-AB-151108-04
	PMAE4071A				470.000	4.80	-0.51	6.92	5.04	3.89	2.83	KKL-AB-151108-07
	PMAE4070A	PMNN4416BR	HLN6602A	PMLN5727A	450.000	4.80	-0.53	7.45	5.43	4.21	3.07	KKL-AB-151108-06
	PMAE4071A				470.000	4.80	0.16	6.89	4.99	3.45	2.50	TLC-AB-151108-08
	PMAE4070A	PMNN4407BR	HLN6602A	PMLN5727A	450.000	4.80	-0.47	6.72	4.91	3.74	2.74	TLC-AB-151108-09
	PMAE4071A				470.000	4.80	-0.58	8.79	6.33	5.02	3.62	TLC-AB-151108-10
	PMAE4070A	PMNN4415A	HLN6602A	PMLN5727A	450.000	4.78	-0.34	8.82	6.39	4.79	3.47	TLC-AB-151108-11
	PMAE4071A				470.000	4.77	-0.64	8.74	6.38	5.10	3.72	TLC-AB-151108-12
	PMAE4070A				450.000	4.74	-0.46	8.52	6.19	4.80	3.48	TLC-AB-151108-13

Table 18 Continued

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4071A	PMNN4435AR	HLN6602A	PMLN5727A	470.000	4.80	-0.63	7.20	5.23	4.16	3.02	TLC-AB-151108-14
PMAE4070A				450.000	4.80	-0.30	6.44	4.71	3.45	2.52	TLC-AB-151108-15
PMAE4071A	PMNN4418BR	HLN6602A	PMLN5727A	470.000	4.77	-0.50	7.39	5.36	4.17	3.03	TLC-AB-151108-16
PMAE4070A				450.000	4.77	-0.25	7.94	5.79	4.23	3.09	TLC-AB-151108-17
PMAE4071A	PMNN4409BR	HLN6602A	PMLN5727A	470.000	4.77	-0.54	7.49	5.38	4.27	3.07	TLC-AB-151109-02
PMAE4070A				450.000	4.80	-0.24	7.02	5.09	3.71	2.69	TLC-AB-151109-03
PMAE4071A	PMNN4490A	HLN6602A	PMLN5727A	470.000	4.72	-0.46	7.31	5.29	4.13	2.99	TLC-AB-151109-04
PMAE4070A				450.000	4.70	-0.24	6.52	4.76	3.52	2.57	TLC-AB-151109-05
PMAE4071A	PMNN4493A	HLN6602A	PMLN5727A	470.000	4.80	-0.33	7.32	5.29	3.95	2.85	TLC-AB-151109-06
PMAE4070A				450.000	4.80	-0.27	7.61	5.55	4.05	2.95	TLC-AB-151109-07
PMAE4071A	PMNN4463A	HLN6602A	PMLN5727A	470.000	4.80	-0.41	7.01	5.11	3.85	2.81	TLC-AB-151109-08
PMAE4070A				450.000	4.74	-0.25	5.63	4.12	3.02	2.21	TLC-AB-151109-09

Assessments at the Body with Body worn RLN4570A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 19

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	RLN4570A	PMLN5727A	406.125							
				420.800	4.80	-0.17	5.35	3.85	2.78	2.00	TLC-AB-151109-10
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
				512.000							
PMAE4071A	PMNN4491A	RLN4570A	PMLN5727A	470.000	4.80	-0.60	9.63	6.90	5.53	3.96	TLC-AB-151109-11
				490.000	4.79	-0.59	8.47	6.10	4.86	3.50	TLC-AB-151109-12
				498.000	4.79	-0.59	7.54	5.45	4.33	3.13	TLC-AB-151109-13
				512.000	4.66	-0.44	6.38	4.61	3.64	2.63	TLC-AB-151109-14

Table 19 Continued

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4069A	PMNN4491A	RLN4570A	PMLN5727A	406.125							
				420.800	4.80	-0.34	4.71	3.40	2.55	1.84	TLC-AB-151109-15
				440.000							
				450.000							
PMAE4070A	PMNN4491A	RLN4570A	PMLN5727A	440.000	4.64	-0.28	5.99	4.29	3.30	2.37	TLC-AB-151109-20
				450.000	4.80	-0.30	9.50	6.83	5.09	3.66	TLC-AB-151109-19
				459.100	4.80	-0.54	9.52	6.85	5.39	3.88	TLC-AB-151109-17
				470.000	4.80	-0.56	8.30	5.97	4.72	3.40	TLC-AB-151109-16
				490.000	4.80	-0.62	5.22	3.71	3.01	2.14	TLC-AB-151109-18
Assessment of Additional Batteries											
PMAE4071A	PMNN4417BR	RLN4570A	PMLN5727A	470.000	4.80	-0.57	9.35	6.73	5.33	3.84	FIE-AB-151109-21
PMAE4070A				459.100	4.80	-0.57	10.00	7.23	5.70	4.12	FIE-AB-151109-22
PMAE4071A	PMNN4406BR	RLN4570A	PMLN5727A	470.000	4.80	-0.22	7.35	5.27	3.87	2.77	FIE-AB-151109-23
PMAE4070A				459.100	4.80	-0.56	7.87	5.72	4.48	3.25	FIE-AB-151109-24
PMAE4071A	PMNN4416BR	RLN4570A	PMLN5727A	470.000	4.80	-0.64	7.92	5.73	4.59	3.32	FIE-AB-151109-25
PMAE4070A				459.100	4.80	0.22	8.16	5.87	4.08	2.94	FIE-AB-151109-26
PMAE4071A	PMNN4407BR	RLN4570A	PMLN5727A	470.000	4.80	-0.60	9.70	6.96	5.57	4.00	FIE-AB-151110-02
PMAE4070A				459.100	4.80	-0.58	8.95	6.41	5.11	3.66	FIE-AB-151110-03
PMAE4071A	PMNN4415A	RLN4570A	PMLN5727A	470.000	4.76	-0.40	9.06	6.56	5.01	3.63	FIE-AB-151112-26
PMAE4070A				459.100	4.80	-0.60	7.52	5.48	4.32	3.15	FIE-AB-151110-06
PMAE4071A	PMNN4435AR	RLN4570A	PMLN5727A	470.000	4.80	-0.63	7.50	5.46	4.34	3.16	FIE-AB-151110-07
PMAE4070A				459.100	4.80	-0.62	7.10	5.19	4.09	2.99	FIE-AB-151110-08
PMAE4071A	PMNN4418BR	RLN4570A	PMLN5727A	470.000	4.80	-0.52	8.48	6.12	4.78	3.45	FIE-AB-151110-09
PMAE4070A				459.100	4.80	-0.42	6.79	4.88	3.74	2.69	TLC-AB-151110-11
PMAE4071A	PMNN4409BR	RLN4570A	PMLN5727A	470.000	4.80	-0.51	8.67	6.27	4.88	3.53	TLC-AB-151110-12
PMAE4070A				459.100	4.78	-0.50	7.84	5.67	4.42	3.19	TLC-AB-151110-13
PMAE4071A	PMNN4490A	RLN4570A	PMLN5727A	470.000	4.75	-0.46	8.44	6.10	4.74	3.43	TLC-AB-151110-14
PMAE4070A				459.100	4.76	-0.48	7.58	5.51	4.27	3.10	TLC-AB-151110-15
PMAE4071A	PMNN4493A	RLN4570A	PMLN5727A	470.000	4.80	-0.38	8.93	6.55	4.87	3.57	TLC-AB-151110-16
PMAE4070A				459.100	4.80	-0.37	6.58	4.80	3.58	2.61	TLC-AB-151110-17
PMAE4071A	PMNN4463A	RLN4570A	PMLN5727A	470.000	4.80	-0.51	7.55	5.50	4.25	3.09	TLC-AB-151110-18
PMAE4070A				459.100	4.80	-0.54	6.86	5.02	3.88	2.84	TLC-AB-151110-19

Assessments at the Body with Body worn RLN4815A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 20

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	RLN4815A	PMLN5727A	406.125							
				420.800	4.80	-0.21	2.57	1.90	1.35	1.00	TLC-AB-151110-20
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				512.000							
PMAE4071A	PMNN4491A	RLN4815A	PMLN5727A	470.000	4.80	-0.50	4.47	3.33	2.51	1.87	TLC-AB-151110-21
				490.000							
				498.000							
				512.000							
PMAE4069A	PMNN4491A	RLN4815A	PMLN5727A	406.125							
				420.800	4.79	-0.23	2.12	1.57	1.12	0.83	TLC-AB-151110-22
				440.000							
				450.000							
PMAE4070A	PMNN4491A	RLN4815A	PMLN5727A	440.000							
				450.000							
				459.100							
				470.000	4.80	-0.45	5.12	3.83	2.84	2.12	TLC-AB-151110-23
				490.000							
Assessment of Additional Batteries											
PMAE4070A	PMNN4417BR	RLN4815A	PMLN5727A	470.000	4.80	-0.49	5.00	3.75	2.80	2.10	TLC-AB-151110-24
	PMNN4406BR			470.000	4.80	-0.52	3.74	2.79	2.11	1.57	TLC-AB-151110-25
	PMNN4416BR			470.000	4.78	-0.52	3.18	2.37	1.80	1.34	TLC-AB-151110-26
	PMNN4407BR			470.000	4.80	-0.52	4.11	3.08	2.32	1.74	FIE-AB-151110-28
	PMNN4415A			470.000	4.78	-0.46	3.35	2.51	1.87	1.40	FIE-AB-151110-29
	PMNN4435AR			470.000	4.80	-0.59	3.33	2.49	1.91	1.43	FIE-AB-151110-30
	PMNN4418BR			470.000	4.80	-0.47	3.47	2.59	1.93	1.44	FIE-AB-151110-31
	PMNN4409BR			470.000	4.80	-0.50	3.52	2.62	1.97	1.47	FIE-AB-151110-32
	PMNN4490A			470.000	4.76	-0.38	3.26	2.44	1.79	1.34	FIE-AB-151110-33
	PMNN4493A			470.000	4.80	-0.35	3.24	2.42	1.76	1.31	FIE-AB-151111-01
	PMNN4463A			470.000	4.80	-0.57	2.93	2.19	1.67	1.25	FIE-AB-151111-02

Assessments at the Body with Body worn PMLN4651A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 21

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	PMLN4651A	PMLN5727A	406.125							
				420.800	4.80	-0.33	3.33	2.42	1.80	1.31	FIE-AB-151113-08
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
				512.000							
PMAE4071A	PMNN4491A	PMLN4651A	PMLN5727A	470.000	4.80	-0.49	6.81	4.89	3.81	2.74	FIE-AB-151113-09
				490.000							
				498.000	4.80	-0.55	5.90	4.23	3.35	2.40	FIE-AB-151113-10
				512.000							
PMAE4069A	PMNN4491A	PMLN4651A	PMLN5727A	406.125							
				420.800	4.80	-0.24	2.94	2.13	1.55	1.13	TLC-AB-151113-12
				440.000							
				450.000							
PMAE4070A	PMNN4491A	PMLN4651A	PMLN5727A	440.000							
				450.000							
				459.100							
				470.000	4.80	-0.44	5.78	4.14	3.20	2.29	TLC-AB-151113-13
				490.000							
Assessment of Additional Batteries											
PMAE4071A	PMNN4417BR	PMLN4651A	PMLN5727A	470.000	4.80	-0.59	6.47	4.58	3.71	2.62	TLC-AB-151113-14
	PMNN4406BR			470.000	4.80	-0.03	5.45	3.93	2.74	1.98	TLC-AB-151113-15
	PMNN4416BR			470.000	4.80	-0.09	5.37	3.85	2.74	1.97	TLC-AB-151113-16
	PMNN4407BR			470.000	4.80	-0.59	6.41	4.56	3.67	2.61	TLC-AB-151113-17
	PMNN4415A			470.000	4.80	-0.70	5.94	4.22	3.49	2.48	TLC-AB-151113-18
	PMNN4435AR			470.000	4.78	-0.64	4.91	3.55	2.86	2.07	TLC-AB-151113-19
	PMNN4418BR			470.000	4.79	-0.54	5.08	3.62	2.88	2.05	TLC-AB-151113-20
	PMNN4409BR			470.000	4.79	-0.54	5.63	4.01	3.19	2.28	TLC-AB-151113-21
	PMNN4490A			470.000	4.79	-0.35	5.48	3.89	2.98	2.11	TLC-AB-151113-22
	PMNN4493A			470.000	4.80	-0.49	5.42	3.90	3.03	2.18	TLC-AB-151113-23
	PMNN4463A			470.000	4.80	-0.66	5.27	3.81	3.07	2.22	TLC-AB-151113-24

Assessments at the Body with Body worn PMLN7008A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 22

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	PMLN7008A	PMLN5727A	406.125							
				420.800	4.80	-0.37	2.84	2.05	1.55	1.12	TLC-AB-151113-25
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
				512.000							
PMAE4071A	PMNN4491A	PMLN7008A	PMLN5727A	470.000	4.80	-0.55	6.60	4.77	3.75	2.71	TLC-AB-151113-26
				490.000							
				498.000	4.80	-0.53	5.86	4.25	3.31	2.40	FIE-AB-151113-27
				512.000							
PMAE4069A	PMNN4491A	PMLN7008A	PMLN5727A	406.125							
				420.800	4.80	-0.26	2.92	2.13	1.55	1.13	FIE-AB-151113-28
				440.000							
				450.000							
PMAE4070A	PMNN4491A	PMLN7008A	PMLN5727A	440.000							
				450.000							
				459.100							
				470.000	4.80	-0.55	5.68	4.14	3.22	2.35	FIE-AB-151113-29
				490.000							
Assessment of Additional Batteries											
PMAE4071A	PMNN4417BR	PMLN7008A	PMLN5727A	470.000	4.80	-0.66	6.70	4.79	3.90	2.79	FIE-AB-151113-30
	PMNN4406BR			470.000	4.80	-0.17	5.23	3.71	2.72	1.93	FIE-AB-151113-31
	PMNN4416BR			470.000	4.80	0.00	5.03	3.65	2.52	1.83	FIE-AB-151114-01
	PMNN4407BR			470.000	4.80	-0.63	6.88	4.93	3.98	2.85	FIE-AB-151114-02
	PMNN4415A			470.000	4.75	-0.45	5.92	4.22	3.32	2.36	FIE-AB-151114-03
	PMNN4435AR			470.000	4.75	-0.64	5.40	3.94	3.16	2.31	FIE-AB-151114-04
	PMNN4418BR			470.000	4.79	-0.57	5.69	4.09	3.25	2.34	FIE-AB-151114-05
	PMNN4409BR			470.000	4.79	-0.62	5.63	4.05	3.25	2.34	FIE-AB-151114-06
	PMNN4490A			470.000	4.70	-0.56	5.51	3.99	3.20	2.32	FIE-AB-151114-07
	PMNN4493A			470.000	4.80	-0.57	5.47	3.97	3.12	2.26	FIE-AB-151114-08
	PMNN4463A			470.000	4.80	-0.68	5.10	3.72	2.98	2.18	FIE-AB-151114-09

Assessments at the Body with Body worn PMLN7296A

DUT assessment with offered antennas, battery with vibrator (PMNN4488A) and, optional body worn accessory per KDB 643646. No optional batteries offered for this body worn. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 23

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4488A	PMLN7296A	PMLN5727A	406.125							
				420.800	4.75	-0.28	2.91	1.98	1.57	1.07	FIE-AB-151114-10
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
PMAE4071A	PMNN4488A	PMLN7296A	PMLN5727A	512.000							
				470.000	4.78	-0.46	4.83	3.41	2.70	1.90	TLC-AB-151115-02
				490.000							
				498.000							
PMAE4069A	PMNN4488A	PMLN7296A	PMLN5727A	512.000							
				406.125							
				420.800	4.76	-0.14	2.41	1.63	1.25	0.85	TLC-AB-151115-03
				440.000							
PMAE4070A	PMNN4488A	PMLN7296A	PMLN5727A	450.000							
				440.000							
				459.100							
				470.000	4.76	-0.38	3.99	2.81	2.20	1.55	TLC-AB-151115-04
				490.000							

Assessments at the Body with Body worn PMLN5864A w/NNTN5243A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 24

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	PMLN5864A w/NNTN5243A	PMLN5727A	406.125							
				420.800	4.80	-0.23	1.79	1.34	0.94	0.71	FIE-AB-151111-04
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
PMAE4071A	PMNN4491A	PMLN5864A w/NNTN5243A	PMLN5727A	470.000	4.80	-0.42	3.79	2.81	2.09	1.55	FIE-AB-151111-05
				490.000							
				498.000							
				512.000							
PMAE4069A	PMNN4491A	PMLN5864A w/NNTN5243A	PMLN5727A	406.125							
				420.800	4.79	-0.17	1.61	1.21	0.84	0.63	FIE-AB-151111-06
				440.000							
				450.000							
PMAE4070A	PMNN4491A	PMLN5864A w/NNTN5243A	PMLN5727A	440.000							
				450.000							
				459.100							
				470.000	4.80	-0.45	3.33	2.47	1.85	1.37	FIE-AB-151111-08
				490.000							
Assessment of Additional Batteries											
PMAE4071A	PMNN4417BR	PMLN5864A w/NNTN5243A	PMLN5727A	470.000	4.80	-0.50	3.88	2.89	2.18	1.62	FIE-AB-151111-09
	PMNN4406BR			470.000	4.80	-0.50	3.15	2.34	1.77	1.31	TLC-AB-151111-11
	PMNN4416BR			470.000	4.80	-0.47	3.45	2.57	1.92	1.43	TLC-AB-151111-12
	PMNN4407BR			470.000	4.80	-0.56	3.79	2.81	2.16	1.60	TLC-AB-151111-13
	PMNN4415A			470.000	4.80	-0.61	3.13	2.33	1.80	1.34	TLC-AB-151111-14
	PMNN4435AR			470.000	4.80	-0.62	3.39	2.51	1.96	1.45	TLC-AB-151111-15
	PMNN4418BR			470.000	4.80	-0.47	2.97	2.21	1.65	1.23	TLC-AB-151111-16
	PMNN4409BR			470.000	4.80	-0.40	2.98	2.22	1.63	1.22	TLC-AB-151111-17
	PMNN4490A			470.000	4.80	-0.31	3.36	2.50	1.80	1.34	TLC-AB-151111-18
	PMNN4493A			470.000	4.80	-0.39	2.97	2.21	1.62	1.21	TLC-AB-151111-19
	PMNN4463A			470.000	4.80	-0.63	2.88	2.14	1.66	1.24	TLC-AB-151111-20

Assessments at the Body with Body worn PMLN5866A w/NNTN5243A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 25

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	PMLN5866A w/NNTN5243A	PMLN5727A	406.125							
				420.800	4.80	-0.28	2.09	1.56	1.11	0.83	FIE-AB-151112-02
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
PMAE4071A	PMNN4491A	PMLN5866A w/NNTN5243A	PMLN5727A	470.000	4.80	-0.48	4.74	3.49	2.65	1.95	FIE-AB-151112-03
				490.000							
				498.000							
				512.000							
PMAE4069A	PMNN4491A	PMLN5866A w/NNTN5243A	PMLN5727A	406.125							
				420.800	4.80	-0.12	1.78	1.33	0.91	0.68	FIE-AB-151112-04
				440.000							
PMAE4070A	PMNN4491A	PMLN5866A w/NNTN5243A	PMLN5727A	450.000							
				459.100							
				470.000	4.80	-0.37	3.90	2.87	2.12	1.56	FIE-AB-151112-05
				490.000							
Assessment of Additional Batteries											
PMAE4071A	PMNN4417BR	PMLN5866A w/NNTN5243A	PMLN5727A	470.000	4.80	-0.58	4.61	3.40	2.63	1.94	FIE-AB-151112-06
	PMNN4406BR			470.000	4.80	-0.50	4.23	3.15	2.37	1.77	FIE-AB-151112-07
	PMNN4416BR			470.000	4.80	-0.29	3.98	2.95	2.13	1.58	FIE-AB-151112-08
	PMNN4407BR			470.000	4.80	-0.54	4.53	3.35	2.56	1.90	FIE-AB-151112-09
	PMNN4415A			470.000	4.80	-0.52	4.06	2.99	2.29	1.69	TLC-AB-151112-11
	PMNN4435AR			470.000	4.80	-0.66	3.75	2.76	2.18	1.61	TLC-AB-151112-12
	PMNN4418BR			470.000	4.80	-0.49	3.93	2.90	2.20	1.62	TLC-AB-151112-13
	PMNN4409BR			470.000	4.80	-0.48	3.94	2.91	2.20	1.63	TLC-AB-151112-14
	PMNN4490A			470.000	4.80	-0.43	4.11	3.02	2.27	1.67	TLC-AB-151112-15
	PMNN4493A			470.000	4.80	-0.37	3.88	2.88	2.11	1.57	TLC-AB-151112-16
	PMNN4463A			470.000	4.80	-0.56	3.80	2.80	2.16	1.59	TLC-AB-151112-17

Assessments at the Body with Body worn PMLN5870A w/NNTN5243A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 26

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	PMLN5870A w/NNTN5243A	PMLN5727A	406.125							
				420.800	4.80	-0.35	2.81	2.08	1.52	1.13	TLC-AB-151111-21
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
PMAE4071A	PMNN4491A	PMLN5870A w/NNTN5243A	PMLN5727A	470.000	4.80	-0.54	5.51	4.07	3.12	2.30	TLC-AB-151111-22
				490.000							
				498.000							
				512.000							
PMAE4069A	PMNN4491A	PMLN5870A w/NNTN5243A	PMLN5727A	406.125							
				420.800	4.80	-0.19	2.38	1.76	1.24	0.92	TLC-AB-151111-23
				440.000							
PMAE4070A	PMNN4491A	PMLN5870A w/NNTN5243A	PMLN5727A	440.000							
				450.000							
				459.100							
				470.000	4.80	-0.46	4.63	3.42	2.57	1.90	TLC-AB-151111-24
PMAE4071A	PMNN4417BR	PMLN5870A w/NNTN5243A	PMLN5727A	470.000	4.80	-0.58	5.52	4.08	3.15	2.33	TLC-AB-151111-25
	PMNN4406BR			470.000	4.80	-0.28	4.84	3.60	2.58	1.92	TLC-AB-151111-26
	PMNN4416BR			470.000	4.80	-0.55	5.37	3.98	3.05	2.26	TLC-AB-151111-27
	PMNN4407BR			470.000	4.80	-0.56	5.61	4.16	3.19	2.37	TLC-AB-151111-28
	PMNN4415A			470.000	4.80	-0.52	4.95	3.67	2.79	2.07	FIE-AB-151111-29
	PMNN4435AR			470.000	4.80	-0.47	4.48	3.33	2.50	1.86	FIE-AB-151111-30
	PMNN4418BR			470.000	4.80	-0.47	4.35	3.21	2.42	1.79	FIE-AB-151111-31
	PMNN4409BR			470.000	4.80	-0.50	4.85	3.59	2.72	2.01	FIE-AB-151111-32
	PMNN4490A			470.000	4.80	-0.41	4.23	3.14	2.32	1.73	FIE-AB-151111-33
	PMNN4493A			470.000	4.80	-0.45	4.37	3.23	2.42	1.79	FIE-AB-151111-34
	PMNN4463A			470.000	4.80	-0.55	4.06	3.00	2.30	1.70	FIE-AB-151112-01

Assessment of Additional Batteries

Assessments at the Body with Body worn PMLN5870A w/RLN6487A & RLN6488A

DUT assessment with offered antennas, default battery and, optional body worn accessory per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 17 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 27

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4079A	PMNN4491A	PMLN5870A w/RLN6487A & RLN6488A	PMLN5727A	406.125							
				420.800	4.80	-0.35	2.36	1.76	1.28	0.95	TLC-AB-151112-18
				440.000							
				450.000							
				459.100							
				470.000							
				490.000							
				498.000							
PMAE4071A	PMNN4491A	PMLN5870A w/RLN6487A & RLN6488A	PMLN5727A	512.000							
				470.000	4.80	-0.49	5.67	4.17	3.17	2.33	TLC-AB-151112-19
				490.000							
				498.000							
PMAE4069A	PMNN4491A	PMLN5870A w/RLN6487A & RLN6488A	PMLN5727A	512.000							
				406.125							
				420.800	4.80	-0.74	1.93	1.42	1.14	0.84	TLC-AB-151112-20
				440.000							
PMAE4070A	PMNN4491A	PMLN5870A w/RLN6487A & RLN6488A	PMLN5727A	450.000							
				440.000							
				459.100							
				470.000	4.80	-0.45	4.73	3.49	2.62	1.94	TLC-AB-151112-21
				490.000							
Assessment of Additional Batteries											
PMAE4071A	PMNN4417BR	PMLN5870A w/RLN6487A & RLN6488A	PMLN5727A	470.000	4.80	-0.54	5.46	4.02	3.09	2.28	TLC-AB-151112-22
	PMNN4406BR			470.000	4.80	0.11	4.89	3.65	2.45	1.83	TLC-AB-151112-23
	PMNN4416BR			470.000	4.80	0.15	4.91	3.65	2.46	1.83	TLC-AB-151112-24
	PMNN4407BR			470.000	4.80	-0.55	6.12	4.52	3.47	2.57	TLC-AB-151112-25
	PMNN4415A			470.000	4.78	-0.38	4.03	2.98	2.21	1.63	FIE-AB-151112-27
	PMNN4435AR			470.000	4.80	-0.60	3.96	2.92	2.27	1.68	FIE-AB-151112-28
	PMNN4418BR			470.000	4.80	-0.56	4.80	3.54	2.73	2.01	FIE-AB-151112-29
	PMNN4409BR			470.000	4.77	-0.52	4.29	3.17	2.43	1.80	FIE-AB-151113-01
	PMNN4490A			470.000	4.75	-0.38	4.60	3.40	2.54	1.87	FIE-AB-151113-02
	PMNN4493A			470.000	4.80	-0.32	4.22	3.11	2.27	1.67	FIE-AB-151113-03
	PMNN4463A			470.000	4.80	-0.56	4.05	2.99	2.30	1.70	FIE-AB-151113-06

Assessment at the Body with other audio accessories

Assessment for additional audio accessories as per “KDB 643646 Body SAR Test Consideration for Audio Accessories without Built-in Antenna; Sec 1, A”. SAR plots of the highest result per Table (bolded) are presented in Appendix E.

Table 28

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4070A	PMNN4417BR	RLN4570A	PMMN4071A w/RLN4885B	459.100	4.72	-0.55	9.02	6.53	5.21	3.77	TLC-AB-151115-05
			PMMN4073A w/RLN4885B	459.100	4.75	-0.66	9.20	6.67	5.41	3.92	TLC-AB-151115-06
			PMMN4075A	459.100	4.77	-0.58	8.69	6.21	5.00	3.57	TLC-AB-151115-07
			PMLN5724A	459.100	4.78	-0.64	9.35	6.71	5.44	3.90	TLC-AB-151115-08
			PMLN7269A	459.100	4.77	-0.57	8.75	6.25	5.02	3.59	TLC-AB-151115-09
			PMLN6754A	459.100	4.79	-0.53	7.07	5.03	4.00	2.85	TLC-AB-151119-12
			PMLN6757A	459.100	4.80	-0.55	9.73	6.96	5.52	3.95	TLC-AB-151116-01
			PMLN5732A	459.100	4.80	-0.57	8.60	6.13	4.90	3.49	TLC-AB-151116-02
			PMLN6761A	459.100	4.78	-0.58	9.88	7.05	5.67	4.05	TLC-AB-151116-03
			PMLN5731A	459.100	4.80	-0.52	8.55	6.13	4.82	3.45	TLC-AB-151116-04
			PMLN6635A	459.100	4.80	-0.57	8.89	6.37	5.07	3.63	TLC-AB-151116-05
			PMLN6759A	459.100	4.80	-0.62	7.87	5.58	4.54	3.22	TLC-AB-151116-06
			PMLN6760A	459.100	4.79	-0.52	10.20	7.29	5.76	4.12	TLC-AB-151116-07
			PMLN6763A	459.100	4.79	-0.66	9.70	6.97	5.66	4.07	TLC-AB-151116-09

Assessment of wireless BT configuration

Assessment using the overall highest SAR configuration at the body from above without an audio accessory attached. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 29

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4070A	PMNN4417BR	RLN4570A	None	440.000							
				450.000	4.80	-0.41	11.10	8.01	6.10	4.40	TLC-AB-151116-11
				459.100	4.80	-0.65	10.70	7.78	6.21	4.52	TLC-AB-151116-10
				470.000	4.80	-0.62	9.75	7.07	5.62	4.08	TLC-AB-151116-12
				490.000							

13.2 WLAN assessment at the Body for 802.11 b/g/n

The tables below represent the output power measurements for WLAN 2.4 GHz 802.11b/g/n for assessments at the Body using battery PMNN4491A because it is the thinnest battery (refer to Exhibit 7B for battery illustration). These power measurements were used to determine the necessary modes for SAR testing according to KDB 248227 D01 SAR Measurement Procedures for 802.11a/b/g/Transmitters.

The battery was used during conducted power measurements for all test channels within FCC allocated frequency range (2.412-2.462 GHz) which are listed in Table 30. The channel with the highest conducted power will be identified as the default channel per KDB 643646 (SAR Test for PTT Radios). SAR plots of the highest results per Table (bolded) are presented in Appendix E.

SAR is not required for 802.11 g/n when the highest reported SAR for DSSS is adjusted by the ratio of OFDM to DSSS specified maximum output power and the adjusted SAR is $\leq 1.2\text{W/kg}$.

Table 30

Mode	Channel #	Channel Frequency	Modulation	Battery: PMNN4491A	Antenna Max Power [mW]
				Antenna port[mW]	
802.11b (1Mbps)	1	2412	DSSS	54.30	69.90
	6	2437		48.70	
	11	2462		50.10	
802.11g (6Mbps)	1	2412	OFDM	15.80	18.60
	6	2437		12.80	
	11	2462		13.20	
802.11n (MCS0)	1	2412	OFDM	9.50	12.60
	6	2437		8.30	
	11	2462		8.00	

802.11b was chosen over 802.11 g & n for testing because it has the highest max power

Assessments at the Body with all offered Body worn

DUT assessment with WLAN internal antenna, all offered batteries without any cable accessory attachment against phantom with all offered body worn. Refer to Table 30 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 31

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
85012026001 WLAN internal Antenna	PMNN4491A	HLN6602A	None	2412.000	0.0542	-0.09	0.04	0.02	0.047	0.024	KKL-AB-151113-12
		RLN4570A		2412.000	0.0542	-0.24	0.03	0.02	0.041	0.020	KKL-AB-151113-13
		RLN4815A		2412.000	0.0542	-0.66	0.01	0.01	0.021	0.011	KKL-AB-151113-14
		PMLN4651A		2412.000	0.0542	-0.16	0.03	0.02	0.044	0.023	KKL-AB-151113-15
		PMLN7008A		2412.000	0.0542	-0.26	0.04	0.02	0.055	0.029	KKL-AB-151116-08
		PMLN5864A w/ NTN5243A		2412.000	0.0542	-0.04	0.04	0.02	0.047	0.025	AZ(KA)-AB-151113-18
		PMLN5870A w/NTN5243A		2412.000	0.0542	0.00	0.04	0.02	0.046	0.026	AZ(KA)-AB-151113-19
		PMLN5866A w/ NTN5243A		2412.000	0.0542	0.01	0.04	0.02	0.046	0.025	AZ(KA)-AB-151113-20
		PMLN5870A w/RLN6487A & RLN6488A		2412.000	0.0542	0.41	0.03	0.02	0.036	0.019	KKL-AB-151116-03
	PMNN4488A	PMLN7296A		2412.000	0.0560	-0.90	0.01	0.00	0.017	0.007	KKL-AB-151113-17

Table 31 Continued

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
Assessment of Additional Batteries											
85012026001 WLAN internal Antenna	PMNN4417BR	PMLN7008A	None	2412.000	0.0539	-0.46	0.04	0.02	0.053	0.027	AZ(KA)-AB-151114-01
	PMNN4406BR			2412.000	0.0563	-0.36	0.04	0.02	0.054	0.028	AZ(KA)-AB-151114-02
	PMNN4416BR			2412.000	0.0543	-0.24	0.04	0.02	0.052	0.027	AZ(KA)-AB-151114-03
	PMNN4407BR			2412.000	0.0534	0.13	0.04	0.02	0.047	0.026	AZ(KA)-AB-151114-04
	PMNN4415A			2412.000	0.0552	-0.06	0.03	0.01	0.033	0.018	AZ(KA)-AB-151114-05
	PMNN4435AR			2412.000	0.0584	-0.51	0.03	0.01	0.034	0.018	AZ(KA)-AB-151114-06
	PMNN4418BR			2412.000	0.0535	0.04	0.03	0.02	0.042	0.022	AZ(KA)-AB-151114-07
	PMNN4409BR			2412.000	0.0544	-0.01	0.04	0.02	0.045	0.025	AZ(KA)-AB-151114-08
	PMNN4490A			2412.000	0.0532	-0.55	0.01	0.00	0.019	0.007	KKL-AB-151116-04
	PMNN4493A			2412.000	0.0540	0.15	0.03	0.02	0.036	0.021	KKL-AB-151116-05
	PMNN4463A			2412.000	0.0540	-0.11	0.03	0.02	0.037	0.020	KKL-AB-151116-06

13.3 LMR assessments at the Face for 406.125-512 MHz band

Battery PMNN4493A was selected as the default battery for assessments at the Face because it has the highest capacity (refer to Exhibit 7B for battery illustration). The default battery was used during conducted power measurements for all test channels within FCC allocated frequency range (406.125 – 512 MHz) which are listed in Table 32. The channel with the highest conducted power will be identified as the default channel per KDB 643646 (SAR Test for PTT Radios). SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 32

Test Freq (MHz)	Power (W)
406.125	4.80
420.800	4.80
440.000	4.73
450.000	4.77
459.100	4.78
470.000	4.79
490.000	4.72
498.000	4.76
512.000	4.62

DUT assessment with offered antennas, default battery with front of DUT positioned 2.5cm facing phantom per KDB 643646. Optional batteries were tested per the requirements of KDB 643646. Refer to Table 32 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 33

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#	
PMAE4079A	PMNN4493A	None	None	406.125	4.78	-0.47	4.80	3.50	2.69	1.96	TLC-FACE-151117-06	
				420.800								
				440.000								
				450.000								
				459.100								
				470.000								
				490.000								
				498.000								
PMAE4071A	PMNN4493A	None	None	512.000								
				470.000	4.80	-0.59	6.89	4.96	3.95	2.84	TLC-FACE-151117-07	
				490.000								
				498.000	4.80	-0.54	5.49	3.94	3.11	2.23	TLC-FACE-151117-08	
PMAE4069A	PMNN4493A	None	None	512.000								
				406.125	4.77	-0.37	4.56	3.29	2.50	1.80	TLC-FACE-151117-09	
				420.800								
				440.000								
PMAE4070A	PMNN4493A	None	None	450.000								
				440.000								
				450.000	4.78	-0.21	6.03	4.35	3.18	2.29	TLC-FACE-151117-11	
				459.100								
PMAE4071A	PMNN4417BR	None	None	470.000	4.78	-0.40	6.40	4.59	3.52	2.53	TLC-FACE-151117-10	
				490.000								
				Assessment of Additional Batteries								
				470.000	4.80	-0.55	6.76	4.86	3.84	2.76	TLC-FACE-151117-12	
				470.000	4.79	-0.61	6.32	4.53	3.64	2.61	TLC-FACE-151117-13	
				470.000	4.80	-0.50	6.42	4.59	3.60	2.58	TLC-FACE-151117-14	
				470.000	4.80	-0.61	6.86	4.92	3.95	2.83	TLC-FACE-151117-15	
				470.000	4.80	-0.50	7.64	5.58	4.29	3.13	KKL-FACE-151119-16	
				470.000	4.68	-0.43	6.37	4.57	3.61	2.59	TLC-FACE-151117-17	
				470.000	4.80	-0.63	6.67	4.79	3.86	2.77	FIE-FACE-151117-18	
				470.000	4.80	-0.63	6.70	4.81	3.87	2.78	FIE-FACE-151117-19	
				470.000	4.80	-0.52	6.74	4.83	3.80	2.72	FIE-FACE-151117-20	
				470.000	4.72	-0.52	6.52	4.67	3.74	2.68	FIE-FACE-151117-21	
470.000	4.80	-0.56	6.63	4.75	3.77	2.70	FIE-FACE-151117-22					
470.000	4.80	-0.69	6.28	4.50	3.68	2.64	FIE-FACE-151117-23					

13.4 WLAN assessment at the Face for 802.11 b/g/n

The tables below represent the output power measurements for WLAN 2.4 GHz 802.11b/g/n for assessments at the Face using battery PMNN4493A because it is has the highest capacity (refer to Exhibit 7B for battery illustration). These power measurements were used to determine the necessary modes for SAR testing according to KDB 248227 D01 SAR Measurement Procedures for 802.11a/b/g/Transmitters.

The battery was used during conducted power measurements for all test channels within FCC allocated frequency range (2.412-2.462GHz) which are listed in Table 34. The channel with the highest conducted power will be identified as the default channel per KDB 643646 (SAR Test for PTT Radios). SAR plots of the highest results per Table (bolded) are presented in Appendix E.

SAR is not required for 802.11 g/n when the highest reported SAR for DSSS is adjusted by the ratio of OFDM to DSSS specified maximum output power and the adjusted SAR is $\leq 1.2W/kg$.

Table 34

Mode	Channel #	Channel Frequency	Modulation	Battery: PMNN4493A	Antenna Max Power [mW]
				Antenna port[mW]	
802.11b (1Mbps)	1	2412	DSSS	55.70	69.90
	6	2437		48.10	
	11	2462		50.10	
802.11g (6Mbps)	1	2412	OFDM	14.70	18.60
	6	2437		12.80	
	11	2462		13.20	
802.11n (MCS0)	1	2412	OFDM	9.50	12.60
	6	2437		8.30	
	11	2462		8.00	

802.11b was chosen over 802.11 g & n for testing because it has the highest max power

DUT assessment with WLAN internal antenna using all offered batteries with front of the DUT 2.5 cm from phantom. Refer to Table 34 for highest output power channel. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 35

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
85012026001 WLAN internal Antenna	PMNN4493A	None	None	2412.000	0.0540	-0.02	0.03	0.01	0.038	0.017	AZ(KA)-FACE-151117-03
Assessment of Additional Batteries											
85012026001 WLAN internal Antenna	PMNN4417BR	None	None	2412.000	0.0539	-0.02	0.02	0.01	0.029	0.012	AZ(KA)-FACE-151117-04
	PMNN4406BR			2412.000	0.0563	0.04	0.02	0.01	0.026	0.011	AZ(KA)-FACE-151117-05
	PMNN4416BR			2412.000	0.0543	0.02	0.03	0.01	0.040	0.017	AZ(KA)-FACE-151117-06
	PMNN4407BR			2412.000	0.0534	-0.03	0.02	0.01	0.032	0.009	AZ(KA)-FACE-151117-07
	PMNN4491A			2412.000	0.0542	-0.04	0.04	0.02	0.051	0.022	AZ(KA)-FACE-151117-08
	PMNN4415A			2412.000	0.0552	-0.01	0.02	0.01	0.027	0.010	KKL-FACE-151117-09
	PMNN4435AR			2412.000	0.0584	-0.05	0.02	0.01	0.029	0.012	KKL-FACE-151117-10
	PMNN4418BR			2412.000	0.0535	0.00	0.03	0.01	0.042	0.018	KKL-FACE-151117-11
	PMNN4409BR			2412.000	0.0544	-0.03	0.02	0.01	0.030	0.013	KKL-FACE-151117-12
	PMNN4490A			2412.000	0.0532	-0.03	0.02	0.01	0.026	0.012	KKL-FACE-151117-13
	PMNN4488A			2412.000	0.0560	0.04	0.02	0.01	0.026	0.012	KKL-FACE-151117-14
	PMNN4463A			2412.000	0.0539	-0.10	0.01	0.00	0.013	0.005	KKL-FACE-151117-15

13.5 Assessment for Industry Canada

Based on the assessment results for body and face per KDB643646, additional tests were not required for Industry Canada frequency range (406.125-430 MHz) and (450-470 MHz) as testing performed is in compliance with Industry Canada frequency range.

13.6 Assessment at the Bluetooth band

Per guidelines in KDB 447498, the following formula was used to determine the test exclusion for standalone Bluetooth transmitter;

$$[(\text{max. power of channel, including tune-up tolerance, mW})/(\text{min. test separation distance, mm})] * [\sqrt{F_{(\text{GHz})}}] = 2.43 \text{ W/kg, which is } \leq 3 \text{ W/kg (1g)}$$

Where:

Max. Power = 7.7mW (10mW*77.01% duty cycle)

Min. test separation distance = 5mm for actual test separation < 5mm

F(GHz) = 2.48 GHz

Per the result from the calculation above, the standalone SAR assessment was not required for Bluetooth band. Therefore, SAR results for Bluetooth are not reported herein.

13.7 Assessment outside FCC Part 90

Assessment of outside FCC Part 90 using highest SAR configuration from above. SAR plots of the highest results per Table (bolded) are presented in Appendix E.

Table 36

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
Body											
PMAE4079A	PMNN4417BR	RLN4570A	None	403.000	4.80	-0.52	7.44	5.42	4.19	3.05	TLC-AB-151116-13
PMAE4079A	PMNN4417BR	RLN4570A	None	519.500	4.77	-0.85	7.43	5.40	4.55	3.30	TLC-AB-151116-14
PMAE4079A	PMNN4417BR	RLN4570A	None	527.000	4.78	-0.84	6.33	4.61	3.86	2.81	TLC-AB-151116-15
PMAE4071A	PMNN4417BR	RLN4570A	None	519.500	4.70	-0.49	9.27	6.77	5.30	3.87	FIE-AB-151116-16
PMAE4071A	PMNN4417BR	RLN4570A	None	527.000	4.70	-0.74	10.40	7.55	6.30	4.57	FIE-AB-151118-19
PMAE4069A	PMNN4417BR	RLN4570A	None	403.000	4.70	-0.52	7.14	5.15	4.11	2.96	FIE-AB-151116-18
Face											
PMAE4079A	PMNN4491A	None	None	403.000	4.70	-0.38	4.19	3.03	2.34	1.69	FIE-FACE-151118-02
PMAE4079A	PMNN4491A	None	None	519.500	4.75	-0.64	4.72	3.45	2.76	2.02	FIE-FACE-151118-06
PMAE4079A	PMNN4491A	None	None	527.000	4.80	-0.71	4.17	3.05	2.46	1.80	FIE-FACE-151118-07
PMAE4071A	PMNN4491A	None	None	519.500	4.74	-0.37	5.49	4.00	3.03	2.21	FIE-FACE-151118-08
PMAE4071A	PMNN4491A	None	None	527.000	4.76	-0.57	6.45	4.72	3.71	2.71	KKL-FACE-151118-09
PMAE4069A	PMNN4491A	None	None	403.000	4.67	-0.37	4.39	3.16	2.46	1.77	FIE-FACE-151118-03

13.8 Shortened Scan Assessment

A “shortened” scan using the highest SAR configuration overall from above was performed to validate the SAR drift of the full DASY5™ coarse and zoom scans. Note that the shortened scan represents the zoom scan performance result; this is obtained by first running a coarse scan to find the peak area and then, using a newly charged battery, a zoom scan only was performed. The results of the shortened cube scan presented in Appendix D demonstrate that the scaling methodology used to determine the calculated SAR results presented herein are valid. The SAR result from the Table below is provided in Appendix F.

Table 37

Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq (MHz)	Init Pwr (W)	SAR Drift (dB)	Meas. 1g-SAR (W/kg)	Meas. 10g-SAR (W/kg)	Max Calc. 1g-SAR (W/kg)	Max Calc. 10g-SAR (W/kg)	Run#
PMAE4070A	PMNN4417BR	RLN4570A	None	459.1000	4.78	-0.46	11.80	8.57	6.59	4.78	FIE-AB-151117-03

14.0 Simultaneous Transmission Exclusion for BT

Per guidelines in KDB 447498, the following formula was used to determine the test exclusion to an antenna that transmits simultaneously with other antennas for test distances $\leq 50\text{mm}$:

$$[(\text{max. power of channel, including tune-up tolerance, mW})/(\text{min. test separation distance, mm})] * [\sqrt{F(\text{GHz})}/X] = 0.32 \text{ W/kg, which is } \leq 0.4 \text{ W/kg (1g)}$$

Where:

$$X = 7.5 \text{ for 1g-SAR; } 18.75 \text{ for 10g}$$

$$\text{Max. Power} = 7.7\text{mW (10mW*77.01\% duty cycle)}$$

$$\text{Min. test separation distance} = 5\text{mm for actual test separation} < 5\text{mm}$$

$$F(\text{GHz}) = 2.48 \text{ GHz}$$

Per the result from the calculation above, simultaneous exclusion is applied and therefore SAR results are not reported herein.

15.0 Simultaneous Transmission between LMR, WLAN and BT

These devices use a single transmitter module and antenna for both WLAN and BT. WLAN and BT cannot transmit simultaneously. Simultaneous transmission for BT had been excluded as mentioned in section 14.0. The maximum sourced-based-time-averaged output power for 802.11 b is 69.9mW while BT is 7.7mW. Therefore the measured SAR from 802.11b is used in conjunction with LMR for simultaneous results.

The Table below summarizes the simultaneous transmissions between LMR and WLAN bands.

Table 38

		LMR Bands
	Freq. (MHz)	UHF (406.125-512 MHz)
WLAN Band	2412 - 2462	√

16.0 Results Summary

Based on the test guidelines from section 4.0 and satisfying frequencies within FCC bands and Industry Canada Frequency bands, the highest Operational Maximum Calculated 1-gram and 10-gram average SAR values found for this filing:

Table 39

Technologies	Frequency band (MHz)	Max Calc at Body (W/kg)		Max Calc at Face (W/kg)	
		1g-SAR	10g-SAR	1g-SAR	10g-SAR
FCC					
LMR	406.125 -512	6.59	4.78	4.29	3.13
WLAN	2412-2462	0.06	0.03	0.05	0.02
Industry Canada					
LMR	406.125-430	2.78	2.00	2.69	1.96
LMR	450-470	6.59	4.78	4.29	3.13
WLAN	2412-2462	0.06	0.03	0.05	0.02
Overall					
LMR	403-527	6.59	4.78	4.29	3.13
WLAN	2412-2484	0.06	0.03	0.05	0.02

All results are scaled to the maximum output power.

The highest combined 1g-SAR results for simultaneous is indicated in the following Table:

Table 40

Designator	Frequency bands	Combined 1g-SAR (W/kg)	Combined 10g-SAR (W/kg)
Body			
FCC	LMR (406.125-512 MHz) and WLAN band	6.65	4.81
Industry Canada	LMR (406.125-430 MHz) and WLAN band	2.84	2.03
	LMR (450-470 MHz) and WLAN band	6.65	4.81
Overall	LMR (403-527 MHz) and WLAN band	6.65	4.81
Face			
FCC	LMR (406.125-512 MHz) and WLAN band	4.34	3.15
Industry Canada	LMR (406.125-430 MHz) and WLAN band	2.74	1.98
	LMR (450-470 MHz) and WLAN band	4.34	3.15
Overall	LMR (403-527 MHz) and WLAN band	4.34	3.15

The test results clearly demonstrate compliance with FCC Occupational/Controlled RF Exposure limits of 8 W/kg averaged over 1 gram per the requirements of OET Bulletin 65. The 10 grams result is not applicable to FCC filing.

17.0 Variability Assessment

Per the guidelines in KDB 865664 SAR variability assessment is required because SAR results are above 4.0W/kg (Occupational). The Table below includes test results of the original measurement(s), the repeated measurement(s), and the ratio (SAR_{high}/SAR_{low}) for the applicable test configuration(s).

Table 41

Run#	Antenna	Battery	Carry Accessory	Cable Accessory	Test Freq. (MHz)	Adj Calc. 1g-SAR (W/kg)	Ratio	Comments
TLC-AB-151116-10	PMAE4070A	PMNN4417BR	RLN4570A	None	459.100	6.21	1.06	No additional repeated scans is required due to the Ratio (SAR _{high} /SAR _{low}) < 1.20
FIE-AB-151117-03						6.56		

18.0 System Uncertainty

A system uncertainty analysis is not required for this report per KDB 865664 because the highest report SAR value Occupational exposure is less than 7.5W/kg.

Per the guidelines of ISO 17025 a reported system uncertainty is required and therefore measurement uncertainty budget is included in Appendix A.

Appendix A

Measurement Uncertainty Budget

Table A.1: Uncertainty Budget for Device Under Test, for 450 MHz

<i>a</i>	<i>b</i>	<i>c</i>	<i>d</i>	<i>e = f(d,k)</i>	<i>f</i>	<i>g</i>	<i>h = c x f / e</i>	<i>i = c x g / e</i>	<i>k</i>
Uncertainty Component	IEEE 1528 section	Tol. (± %)	Prob Dist	Div.	<i>c_i</i> (1 g)	<i>c_i</i> (10 g)	1 g <i>u_i</i> (±%)	10 g <i>u_i</i> (±%)	<i>v_i</i>
Measurement System									
Probe Calibration	E.2.1	6.7	N	1.00	1	1	6.7	6.7	∞
Axial Isotropy	E.2.2	4.7	R	1.73	0.707	0.707	1.9	1.9	∞
Hemispherical Isotropy	E.2.2	9.6	R	1.73	0.707	0.707	3.9	3.9	∞
Boundary Effect	E.2.3	1.0	R	1.73	1	1	0.6	0.6	∞
Linearity	E.2.4	4.7	R	1.73	1	1	2.7	2.7	∞
System Detection Limits	E.2.5	1.0	R	1.73	1	1	0.6	0.6	∞
Readout Electronics	E.2.6	0.3	N	1.00	1	1	0.3	0.3	∞
Response Time	E.2.7	1.1	R	1.73	1	1	0.6	0.6	∞
Integration Time	E.2.8	1.1	R	1.73	1	1	0.6	0.6	∞
RF Ambient Conditions - Noise	E.6.1	3.0	R	1.73	1	1	1.7	1.7	∞
RF Ambient Conditions - Reflections	E.6.1	0.0	R	1.73	1	1	0.0	0.0	∞
Probe Positioner Mech. Tolerance	E.6.2	0.4	R	1.73	1	1	0.2	0.2	∞
Probe Positioning w.r.t Phantom	E.6.3	1.4	R	1.73	1	1	0.8	0.8	∞
Max. SAR Evaluation (ext., int., avg.)	E.5	3.4	R	1.73	1	1	2.0	2.0	∞
Test sample Related									
Test Sample Positioning	E.4.2	3.2	N	1.00	1	1	3.2	3.2	29
Device Holder Uncertainty	E.4.1	4.0	N	1.00	1	1	4.0	4.0	8
SAR drift	6.6.2	5.0	R	1.73	1	1	2.9	2.9	∞
Phantom and Tissue Parameters									
Phantom Uncertainty	E.3.1	4.0	R	1.73	1	1	2.3	2.3	∞
Liquid Conductivity (target)	E.3.2	5.0	R	1.73	0.64	0.43	1.8	1.2	∞
Liquid Conductivity (measurement)	E.3.3	3.3	N	1.00	0.64	0.43	2.1	1.4	∞
Liquid Permittivity (target)	E.3.2	5.0	R	1.73	0.6	0.49	1.7	1.4	∞
Liquid Permittivity (measurement)	E.3.3	1.9	N	1.00	0.6	0.49	1.1	0.9	∞
Combined Standard Uncertainty							11	11	477
Expanded Uncertainty (95% CONFIDENCE LEVEL)							23	22	

Notes for uncertainty budget Tables:

- a) Column headings *a-k* are given for reference.
- b) Tol. - tolerance in influence quantity.
- c) Prob. Dist. – Probability distribution
- d) N, R - normal, rectangular probability distributions
- e) Div. - divisor used to translate tolerance into normally distributed standard uncertainty
- f) *c_i* - sensitivity coefficient that should be applied to convert the variability of the uncertainty component into a variability of SAR.
- g) *u_i* – SAR uncertainty
- h) *v_i* - degrees of freedom for standard uncertainty and effective degrees of freedom for the expanded uncertainty

Table A.2: Uncertainty Budget for Device Under Test, for 2450 MHz

<i>a</i>	<i>b</i>	<i>c</i>	<i>d</i>	<i>e = f(d,k)</i>	<i>f</i>	<i>g</i>	<i>h = c x f / e</i>	<i>i = c x g / e</i>	<i>k</i>
Uncertainty Component	IEEE 1528 section	Tol. (± %)	Prob Dist	Div.	ci (1 g)	ci (10 g)	1 g u_i (±%)	10 g u_i (±%)	v_i
Measurement System									
Probe Calibration	E.2.1	6.0	N	1.00	1	1	6.0	6.0	∞
Axial Isotropy	E.2.2	4.7	R	1.73	0.707	0.707	1.9	1.9	∞
Hemispherical Isotropy	E.2.2	9.6	R	1.73	0.707	0.707	3.9	3.9	∞
Boundary Effect	E.2.3	1.0	R	1.73	1	1	0.6	0.6	∞
Linearity	E.2.4	4.7	R	1.73	1	1	2.7	2.7	∞
System Detection Limits	E.2.5	1.0	R	1.73	1	1	0.6	0.6	∞
Readout Electronics	E.2.6	0.3	N	1.00	1	1	0.3	0.3	∞
Response Time	E.2.7	1.1	R	1.73	1	1	0.6	0.6	∞
Integration Time	E.2.8	1.1	R	1.73	1	1	0.6	0.6	∞
RF Ambient Conditions - Noise	E.6.1	3.0	R	1.73	1	1	1.7	1.7	∞
RF Ambient Conditions - Reflections	E.6.1	0.0	R	1.73	1	1	0.0	0.0	∞
Probe Positioner Mech. Tolerance	E.6.2	0.4	R	1.73	1	1	0.2	0.2	∞
Probe Positioning w.r.t Phantom	E.6.3	1.4	R	1.73	1	1	0.8	0.8	∞
Max. SAR Evaluation (ext., int., avg.)	E.5	3.4	R	1.73	1	1	2.0	2.0	∞
Test sample Related									
Test Sample Positioning	E.4.2	3.2	N	1.00	1	1	3.2	3.2	29
Device Holder Uncertainty	E.4.1	4.0	N	1.00	1	1	4.0	4.0	8
SAR drift	6.6.2	5.0	R	1.73	1	1	2.9	2.9	∞
Phantom and Tissue Parameters									
Phantom Uncertainty	E.3.1	4.0	R	1.73	1	1	2.3	2.3	∞
Liquid Conductivity (target)	E.3.2	5.0	R	1.73	0.64	0.43	1.8	1.2	∞
Liquid Conductivity (measurement)	E.3.3	3.3	N	1.00	0.64	0.43	2.1	1.4	∞
Liquid Permittivity (target)	E.3.2	5.0	R	1.73	0.6	0.49	1.7	1.4	∞
Liquid Permittivity (measurement)	E.3.3	1.9	N	1.00	0.6	0.49	1.1	0.9	∞
Combined Standard Uncertainty			RSS				11	11	419
Expanded Uncertainty (95% CONFIDENCE LEVEL)			<i>k</i> =2				22	22	

Notes for uncertainty budget Tables:

- a) Column headings *a-k* are given for reference.
- b) Tol. - tolerance in influence quantity.
- c) Prob. Dist. – Probability distribution
- d) N, R - normal, rectangular probability distributions
- e) Div. - divisor used to translate tolerance into normally distributed standard uncertainty
- f) *ci* - sensitivity coefficient that should be applied to convert the variability of the uncertainty component into a variability of SAR.
- g) *ui* – SAR uncertainty
- h) *vi* - degrees of freedom for standard uncertainty and effective degrees of freedom for the expanded uncertainty

Table A.3: Uncertainty Budget for System Validation (dipole & flat phantom) for 450 MHz

<i>a</i>	<i>b</i>	<i>c</i>	<i>d</i>	<i>e = f(d,k)</i>	<i>f</i>	<i>g</i>	<i>h = c x f / e</i>	<i>i = c x g / e</i>	<i>k</i>
Uncertainty Component	IEEE 1528 section	Tol. (± %)	Prob Dist	Div.	<i>c_i</i> (1 g)	<i>c_i</i> (10 g)	1 g <i>U_i</i> (±%)	10 g <i>U_i</i> (±%)	<i>v_i</i>
Measurement System									
Probe Calibration	E.2.1	6.7	N	1.00	1	1	6.7	6.7	∞
Axial Isotropy	E.2.2	4.7	R	1.73	1	1	2.7	2.7	∞
Spherical Isotropy	E.2.2	9.6	R	1.73	0	0	0.0	0.0	∞
Boundary Effect	E.2.3	1.0	R	1.73	1	1	0.6	0.6	∞
Linearity	E.2.4	4.7	R	1.73	1	1	2.7	2.7	∞
System Detection Limits	E.2.5	1.0	R	1.73	1	1	0.6	0.6	∞
Readout Electronics	E.2.6	0.3	N	1.00	1	1	0.3	0.3	∞
Response Time	E.2.7	1.1	R	1.73	1	1	0.6	0.6	∞
Integration Time	E.2.8	0.0	R	1.73	1	1	0.0	0.0	∞
RF Ambient Conditions - Noise	E.6.1	3.0	R	1.73	1	1	1.7	1.7	∞
RF Ambient Conditions - Reflections	E.6.1	0.0	R	1.73	1	1	0.0	0.0	∞
Probe Positioner Mechanical Tolerance	E.6.2	0.4	R	1.73	1	1	0.2	0.2	∞
Probe Positioning w.r.t. Phantom	E.6.3	1.4	R	1.73	1	1	0.8	0.8	∞
Max. SAR Evaluation (ext., int., avg.)	E.5	3.4	R	1.73	1	1	2.0	2.0	∞
Dipole									
Dipole Axis to Liquid Distance	8, E.4.2	2.0	R	1.73	1	1	1.2	1.2	∞
Input Power and SAR Drift Measurement	8, 6.6.2	5.0	R	1.73	1	1	2.9	2.9	∞
Phantom and Tissue Parameters									
Phantom Uncertainty	E.3.1	4.0	R	1.73	1	1	2.3	2.3	∞
Liquid Conductivity (target)	E.3.2	5.0	R	1.73	0.64	0.43	1.8	1.2	∞
Liquid Conductivity (measurement)	E.3.3	3.3	R	1.73	0.64	0.43	1.2	0.8	∞
Liquid Permittivity (target)	E.3.2	5.0	R	1.73	0.6	0.49	1.7	1.4	∞
Liquid Permittivity (measurement)	E.3.3	1.9	R	1.73	0.6	0.49	0.6	0.5	∞
Combined Standard Uncertainty			RSS				10	9	99999
Expanded Uncertainty (95% CONFIDENCE LEVEL)			<i>k</i> =2				19	18	

Notes for uncertainty budget Tables:

- a) Column headings *a-k* are given for reference.
- b) Tol. - tolerance in influence quantity.
- c) Prob. Dist. – Probability distribution
- d) N, R - normal, rectangular probability distributions
- e) Div. - divisor used to translate tolerance into normally distributed standard uncertainty
- f) *c_i* - sensitivity coefficient that should be applied to convert the variability of the uncertainty component into a variability of SAR.
- g) *u_i* – SAR uncertainty
- h) *v_i* - degrees of freedom for standard uncertainty and effective degrees of freedom for the expanded uncertainty

Table A.4: Uncertainty Budget for System Validation (dipole & flat phantom) for 2450 MHz

<i>a</i>	<i>b</i>	<i>c</i>	<i>d</i>	<i>e = f(d,k)</i>	<i>f</i>	<i>g</i>	<i>h = c x f / e</i>	<i>i = c x g / e</i>	<i>k</i>
Uncertainty Component	IEEE 1528 section	Tol. (± %)	Prob Dist	Div.	<i>c_i</i> (1 g)	<i>c_i</i> (10 g)	1 g <i>U_i</i> (±%)	10 g <i>U_i</i> (±%)	<i>v_i</i>
Measurement System									
Probe Calibration	E.2.1	6.0	N	1.00	1	1	6.0	6.0	∞
Axial Isotropy	E.2.2	4.7	R	1.73	1	1	2.7	2.7	∞
Spherical Isotropy	E.2.2	9.6	R	1.73	0	0	0.0	0.0	∞
Boundary Effect	E.2.3	1.0	R	1.73	1	1	0.6	0.6	∞
Linearity	E.2.4	4.7	R	1.73	1	1	2.7	2.7	∞
System Detection Limits	E.2.5	1.0	R	1.73	1	1	0.6	0.6	∞
Readout Electronics	E.2.6	0.3	N	1.00	1	1	0.3	0.3	∞
Response Time	E.2.7	1.1	R	1.73	1	1	0.6	0.6	∞
Integration Time	E.2.8	0.0	R	1.73	1	1	0.0	0.0	∞
RF Ambient Conditions - Noise	E.6.1	3.0	R	1.73	1	1	1.7	1.7	∞
RF Ambient Conditions - Reflections	E.6.1	0.0	R	1.73	1	1	0.0	0.0	∞
Probe Positioner Mechanical Tolerance	E.6.2	0.4	R	1.73	1	1	0.2	0.2	∞
Probe Positioning w.r.t. Phantom	E.6.3	1.4	R	1.73	1	1	0.8	0.8	∞
Max. SAR Evaluation (ext., int., avg.)	E.5	3.4	R	1.73	1	1	2.0	2.0	∞
Dipole									
Dipole Axis to Liquid Distance	8, E.4.2	2.0	R	1.73	1	1	1.2	1.2	∞
Input Power and SAR Drift Measurement	8, 6.6.2	5.0	R	1.73	1	1	2.9	2.9	∞
Phantom and Tissue Parameters									
Phantom Uncertainty	E.3.1	4.0	R	1.73	1	1	2.3	2.3	∞
Liquid Conductivity (target)	E.3.2	5.0	R	1.73	0.64	0.43	1.8	1.2	∞
Liquid Conductivity (measurement)	E.3.3	3.3	R	1.73	0.64	0.43	1.2	0.8	∞
Liquid Permittivity (target)	E.3.2	5.0	R	1.73	0.6	0.49	1.7	1.4	∞
Liquid Permittivity (measurement)	E.3.3	1.9	R	1.73	0.6	0.49	0.6	0.5	∞
Combined Standard Uncertainty			RSS				9	9	99999
Expanded Uncertainty (95% CONFIDENCE LEVEL)			<i>k</i> =2				18	17	

Notes for uncertainty budget Tables:

- a) Column headings *a-k* are given for reference.
- b) Tol. - tolerance in influence quantity.
- c) Prob. Dist. – Probability distribution
- d) N, R - normal, rectangular probability distributions
- e) Div. - divisor used to translate tolerance into normally distributed standard uncertainty
- f) *c_i* - sensitivity coefficient that should be applied to convert the variability of the uncertainty component into a variability of SAR.
- g) *u_i* – SAR uncertainty
- h) *v_i* - degrees of freedom for standard uncertainty and effective degrees of freedom for the expanded uncertainty

Appendix B

Probe Calibration Certificates

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
C Service suisse d'étalonnage
S Servizio svizzero di taratura
Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates.

Accreditation No.: **SCS 0108**

Client **Motorola Solutions MY**

Certificate No: **ES3-3122_Jun15**

CALIBRATION CERTIFICATE

Object: **ES3DV3 - SN:3122**

Calibration procedure(s): **QA CAL-01.v9, QA CAL-12.v9, QA CAL-23.v5, QA CAL-25.v6
Calibration procedure for dosimetric E-field probes**

Calibration date: **June 19, 2015**

This calibration certificate documents the traceability to national standards, which realize the physical units of measurements (SI).
The measurements and the uncertainties with confidence probability are given on the following pages and are part of the certificate.

All calibrations have been conducted in the closed laboratory facility; environment temperature (22 ± 3)°C and humidity < 70%.

Calibration Equipment used (M&TE critical for calibration):

Primary Standards	ID	Cal Date (Certificate No.)	Scheduled Calibration
Power meter E4419B	GB41293874	01-Apr-15 (No. 217-02128)	Mar-16
Power sensor E4412A	MY41498087	01-Apr-15 (No. 217-02128)	Mar-16
Reference 3 dB Attenuator	SN: S5054 (3c)	01-Apr-15 (No. 217-02129)	Mar-16
Reference 20 dB Attenuator	SN: S5277 (20x)	01-Apr-15 (No. 217-02132)	Mar-16
Reference 30 dB Attenuator	SN: S5129 (30b)	01-Apr-15 (No. 217-02133)	Mar-16
Reference Probe ES3DV2	SN: 3013	30-Dec-14 (No. ES3-3013_Dec14)	Dec-15
DAE4	SN: 660	14-Jan-15 (No. DAE4-660_Jan15)	Jan-16
Secondary Standards	ID	Check Date (in house)	Scheduled Check
RF generator HP 8648C	US3642U01700	4-Aug-99 (in house check Apr-13)	In house check: Apr-16
Network Analyzer HP 8753E	US37300585	18-Oct-01 (in house check Oct-14)	In house check: Oct-15

	Name	Function	Signature
Calibrated by:	Jeton Kasrati	Laboratory Technician	
Approved by:	Kolja Pekovic	Technical Manager	

Issued: June 20, 2015

This calibration certificate shall not be reproduced except in full without written approval of the laboratory.

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kallbrierdienst
C Service suisse d'étalonnage
S Servizio svizzero di taratura
Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Glossary:

TSL	tissue simulating liquid
NORM _{x,y,z}	sensitivity in free space
ConvF	sensitivity in TSL / NORM _{x,y,z}
DCP	diode compression point
CF	crest factor (1/duty_cycle) of the RF signal
A, B, C, D	modulation dependent linearization parameters
Polarization φ	φ rotation around probe axis
Polarization θ	θ rotation around an axis that is in the plane normal to probe axis (at measurement center), i.e., θ = 0 is normal to probe axis
Connector Angle	information used in DASY system to align probe sensor X to the robot coordinate system

Calibration is Performed According to the Following Standards:

- a) IEEE Std 1528-2013, "IEEE Recommended Practice for Determining the Peak Spatial-Averaged Specific Absorption Rate (SAR) in the Human Head from Wireless Communications Devices: Measurement Techniques", June 2013
- b) IEC 62209-1, "Procedure to measure the Specific Absorption Rate (SAR) for hand-held devices used in close proximity to the ear (frequency range of 300 MHz to 3 GHz)", February 2005

Methods Applied and Interpretation of Parameters:

- **NORM_{x,y,z}**: Assessed for E-field polarization θ = 0 (f ≤ 900 MHz in TEM-cell; f > 1800 MHz: R22 waveguide). NORM_{x,y,z} are only intermediate values, i.e., the uncertainties of NORM_{x,y,z} does not affect the E²-field uncertainty inside TSL (see below ConvF).
- **NORM(f)_{x,y,z} = NORM_{x,y,z} * frequency_response** (see Frequency Response Chart). This linearization is implemented in DASY4 software versions later than 4.2. The uncertainty of the frequency response is included in the stated uncertainty of ConvF.
- **DCP_{x,y,z}**: DCP are numerical linearization parameters assessed based on the data of power sweep with CW signal (no uncertainty required). DCP does not depend on frequency nor media.
- **PAR**: PAR is the Peak to Average Ratio that is not calibrated but determined based on the signal characteristics
- **A_{x,y,z}; B_{x,y,z}; C_{x,y,z}; D_{x,y,z}; VR_{x,y,z}; A, B, C, D** are numerical linearization parameters assessed based on the data of power sweep for specific modulation signal. The parameters do not depend on frequency nor media. VR is the maximum calibration range expressed in RMS voltage across the diode.
- **ConvF and Boundary Effect Parameters**: Assessed in flat phantom using E-field (or Temperature Transfer Standard for f ≤ 800 MHz) and inside waveguide using analytical field distributions based on power measurements for f > 800 MHz. The same setups are used for assessment of the parameters applied for boundary compensation (alpha, depth) of which typical uncertainty values are given. These parameters are used in DASY4 software to improve probe accuracy close to the boundary. The sensitivity in TSL corresponds to NORM_{x,y,z} * ConvF whereby the uncertainty corresponds to that given for ConvF. A frequency dependent ConvF is used in DASY version 4.4 and higher which allows extending the validity from ± 50 MHz to ± 100 MHz.
- **Spherical isotropy (3D deviation from isotropy)**: in a field of low gradients realized using a flat phantom exposed by a patch antenna.
- **Sensor Offset**: The sensor offset corresponds to the offset of virtual measurement center from the probe tip (on probe axis). No tolerance required.
- **Connector Angle**: The angle is assessed using the information gained by determining the NORM_x (no uncertainty required).

ES3DV3 - SN:3122

June 19, 2015

Probe ES3DV3

SN:3122

Manufactured: July 11, 2006
Calibrated: June 19, 2015

Calibrated for DASY/EASY Systems
(Note: non-compatible with DASY2 system!)

ES3DV3- SN:3122

June 19, 2015

DASY/EASY - Parameters of Probe: ES3DV3 - SN:3122

Basic Calibration Parameters

	Sensor X	Sensor Y	Sensor Z	Unc (k=2)
Norm ($\mu\text{V}/(\text{V/m})^{2.5}$) ^A	1.34	1.22	1.42	$\pm 10.1\%$
DCP (mV) ^B	102.6	103.7	101.0	

Modulation Calibration Parameters

UID	Communication System Name		A dB	B dB $\sqrt{\mu\text{V}}$	C	D dB	VR mV	Unc ^C (k=2)
0	CW	X	0.0	0.0	1.0	0.00	209.7	$\pm 3.0\%$
		Y	0.0	0.0	1.0		202.5	
		Z	0.0	0.0	1.0		200.4	
10021-DAB	GSM-FDD (TDMA, GMSK)	X	27.38	99.6	27.9	9.39	147.3	$\pm 2.5\%$
		Y	27.71	99.5	27.9		147.9	
		Z	26.04	99.6	28.1		137.2	
10023-DAB	GPRS-FDD (TDMA, GMSK, TN 0)	X	27.85	100.0	28.2	9.57	143.3	$\pm 2.5\%$
		Y	26.86	99.4	28.1		145.7	
		Z	25.87	99.3	28.0		131.5	
10024-DAB	GPRS-FDD (TDMA, GMSK, TN 0-1)	X	38.48	99.1	25.1	6.56	119.9	$\pm 1.9\%$
		Y	41.84	99.6	25.1		149.5	
		Z	29.41	94.8	23.6		137.4	
10025-DAB	EDGE-FDD (TDMA, 8PSK, TN 0)	X	13.71	94.1	35.6	12.62	94.9	$\pm 2.7\%$
		Y	15.75	99.6	38.3		92.3	
		Z	12.29	91.8	34.9		67.0	
10026-DAB	EDGE-FDD (TDMA, 8PSK, TN 0-1)	X	15.93	94.8	32.6	9.55	121.3	$\pm 2.5\%$
		Y	19.12	99.6	34.3		147.2	
		Z	19.09	99.8	34.3		135.4	
10027-DAB	GPRS-FDD (TDMA, GMSK, TN 0-1-2)	X	57.39	99.7	23.3	4.80	132.9	$\pm 1.9\%$
		Y	54.04	99.8	23.5		131.2	
		Z	59.21	99.7	23.1		122.7	
10028-DAB	GPRS-FDD (TDMA, GMSK, TN 0-1-2-3)	X	62.60	99.8	22.5	3.55	139.9	$\pm 2.2\%$
		Y	62.85	99.6	22.4		138.5	
		Z	84.57	99.8	21.6		129.1	
10029-DAB	EDGE-FDD (TDMA, 8PSK, TN 0-1-2)	X	16.17	94.0	30.7	7.78	137.1	$\pm 2.7\%$
		Y	19.76	99.6	33.0		134.5	
		Z	15.07	93.3	30.5		125.4	
10039-CAB	CDMA2000 (1xRTT, RC1)	X	4.90	66.8	18.9	4.57	144.7	$\pm 1.2\%$
		Y	4.88	67.3	19.3		145.2	
		Z	4.65	66.0	18.3		136.8	
10056-DAB	EDGE-FDD (TDMA, 8PSK, TN 0-1-2-3)	X	14.14	91.7	29.2	6.52	142.1	$\pm 1.9\%$
		Y	16.83	98.5	31.7		141.2	
		Z	11.43	87.2	27.3		131.6	
10081-CAB	CDMA2000 (1xRTT, RC3)	X	3.96	65.9	18.2	3.97	138.0	$\pm 0.7\%$
		Y	3.99	66.5	18.8		138.7	
		Z	3.77	65.0	17.6		131.9	

ES3DV3- SN:3122

June 19, 2015

10090-DAB	GPRS-FDD (TDMA, GMSK, TN 0-4)	X	42.71	99.9	25.1	6.56	147.2	±1.9 %
		Y	39.29	99.6	25.2		119.4	
		Z	40.45	99.7	25.0		135.9	
10099-DAB	EDGE-FDD (TDMA, 8PSK, TN 0-4)	X	10.62	86.0	29.5	9.55	96.1	±3.0 %
		Y	15.83	97.2	34.3		96.8	
		Z	10.00	85.3	29.3		91.4	
10290-AAB	CDMA2000, RC1, SO55, Full Rate	X	4.46	67.1	18.6	3.91	143.1	±0.9 %
		Y	4.40	67.5	19.0		143.6	
		Z	4.15	68.0	17.9		134.7	
10291-AAB	CDMA2000, RC3, SO55, Full Rate	X	3.63	66.2	18.1	3.46	137.6	±0.7 %
		Y	3.65	66.8	18.7		136.2	
		Z	3.40	65.0	17.3		130.5	
10292-AAB	CDMA2000, RC3, SO32, Full Rate	X	3.58	66.3	18.2	3.39	137.5	±0.7 %
		Y	3.63	67.1	18.8		137.8	
		Z	3.39	65.3	17.5		130.2	
10293-AAB	CDMA2000, RC3, SO3, Full Rate	X	3.68	66.4	18.3	3.50	137.4	±0.7 %
		Y	3.67	66.8	18.7		138.4	
		Z	3.43	65.0	17.3		130.3	
10295-AAB	CDMA2000, RC1, SO3, 1/8th Rate 25 fr.	X	14.16	89.1	34.0	12.49	103.9	±2.2 %
		Y	18.23	99.8	38.9		102.8	
		Z	14.30	90.6	35.0		94.2	
10403-AAB	CDMA2000 (1xEV-DO, Rev. 0)	X	4.62	66.7	17.9	3.76	127.8	±0.7 %
		Y	4.64	67.4	18.4		127.7	
		Z	4.57	66.9	17.8		142.5	
10404-AAB	CDMA2000 (1xEV-DO, Rev. A)	X	4.75	67.7	18.4	3.77	149.9	±0.7 %
		Y	4.74	68.3	18.9		149.9	
		Z	4.41	66.6	17.7		140.6	
10406-AAB	CDMA2000, RC3, SO32, SCH0, Full Rate	X	6.18	67.6	19.1	5.22	132.8	±1.2 %
		Y	6.23	68.4	19.6		132.7	
		Z	6.19	68.1	19.1		148.3	

The reported uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor k=2, which for a normal distribution corresponds to a coverage probability of approximately 95%.

^a The uncertainties of NormX,Y,Z do not affect the E²-field uncertainty inside TSL (see Pages 6 and 7)

^b Numerical linearization parameter: uncertainty not required.

^c Uncertainty is determined using the max. deviation from linear response applying rectangular distribution and is expressed for the square of the field value.

ES3DV3- SN:3122

June 19, 2015

DASY/EASY - Parameters of Probe: ES3DV3 - SN:3122

Calibration Parameter Determined in Head Tissue Simulating Media

f (MHz) ^c	Relative Permittivity ^f	Conductivity (S/m) ^e	ConvF X	ConvF Y	ConvF Z	Alpha ^g	Depth ^h (mm)	Unct. (k=2)
150	52.3	0.76	7.00	7.00	7.00	0.08	1.20	± 13.3 %
300	45.3	0.87	6.79	6.79	6.79	0.15	1.20	± 13.3 %
450	43.5	0.87	6.79	6.79	6.79	0.21	1.30	± 13.3 %
750	41.9	0.89	6.39	6.39	6.39	0.33	1.76	± 12.0 %
900	41.5	0.97	6.02	6.02	6.02	0.46	1.51	± 12.0 %
1810	40.0	1.40	5.07	5.07	5.07	0.59	1.40	± 12.0 %
1900	40.0	1.40	5.02	5.02	5.02	0.80	1.16	± 12.0 %
2450	39.2	1.80	4.46	4.46	4.46	0.80	1.31	± 12.0 %

^c Frequency validity above 300 MHz of ± 100 MHz only applies for DASY v6.4 and higher (see Page 2), else it is restricted to ± 50 MHz. The uncertainty is the RSS of the ConvF uncertainty at calibration frequency and the uncertainty for the indicated frequency band. Frequency validity below 300 MHz is ± 10, 25, 40, 50 and 70 MHz for ConvF assessments at 30, 64, 128, 150 and 220 MHz respectively. Above 5 GHz frequency validity can be extended to ± 110 MHz.

^f At frequencies below 3 GHz, the validity of tissue parameters (ϵ and σ) can be relaxed to ± 10% if liquid compensation formula is applied to measured SAR values. At frequencies above 3 GHz, the validity of tissue parameters (ϵ and σ) is restricted to ± 5%. The uncertainty is the RSS of the ConvF uncertainty for indicated target tissue parameters.

^h Alpha/Depth are determined during calibration. SPEAG warrants that the remaining deviation due to the boundary effect after compensation is always less than ± 1% for frequencies below 3 GHz and below ± 2% for frequencies between 3-6 GHz at any distance larger than half the probe tip diameter from the boundary.

ES3DV3- SN:3122

June 19, 2015

DASY/EASY - Parameters of Probe: ES3DV3 - SN:3122

Calibration Parameter Determined in Body Tissue Simulating Media

f (MHz) ^c	Relative Permittivity ^f	Conductivity (S/m) ^f	ConvF X	ConvF Y	ConvF Z	Alpha ^g	Depth (mm) ^g	Uncl. (k=2)
150	61.9	0.80	6.58	6.58	6.58	0.06	1.20	± 13.3 %
300	58.2	0.92	6.71	6.71	6.71	0.12	1.30	± 13.3 %
450	56.7	0.94	6.78	6.78	6.78	0.15	1.30	± 13.3 %
750	55.5	0.96	6.06	6.06	6.06	0.55	1.38	± 12.0 %
900	55.0	1.05	5.88	5.88	5.88	0.46	1.45	± 12.0 %
1810	53.3	1.52	4.74	4.74	4.74	0.38	1.85	± 12.0 %
1900	53.3	1.52	4.63	4.63	4.63	0.43	1.76	± 12.0 %
2450	52.7	1.95	4.28	4.28	4.28	0.60	1.20	± 12.0 %

^c Frequency validity above 300 MHz of ± 100 MHz only applies for DASY v4.4 and higher (see Page 2), else it is restricted to ± 50 MHz. The uncertainty is the RSS of the ConvF uncertainty at calibration frequency and the uncertainty for the indicated frequency band. Frequency validity below 300 MHz is ± 10, 25, 40, 50 and 70 MHz for ConvF assessments at 30, 64, 128, 150 and 220 MHz respectively. Above 5 GHz frequency validity can be extended to ± 110 MHz.


^f At frequencies below 3 GHz, the validity of tissue parameters (ϵ and σ) can be relaxed to ± 10% if liquid compensation formula is applied to measured SAR values. At frequencies above 3 GHz, the validity of tissue parameters (ϵ and σ) is restricted to ± 5%. The uncertainty is the RSS of the ConvF uncertainty for indicated target tissue parameters.

^g Alpha/Depth are determined during calibration. SPEAG warrants that the remaining deviation due to the boundary effect after compensation is always less than ± 1% for frequencies below 3 GHz and below ± 2% for frequencies between 3-6 GHz at any distance larger than half the probe tip diameter from the boundary.

ES3DV3- SN:3122

June 19, 2015

Frequency Response of E-Field (TEM-Cell:ifi110 EXX, Waveguide: R22)


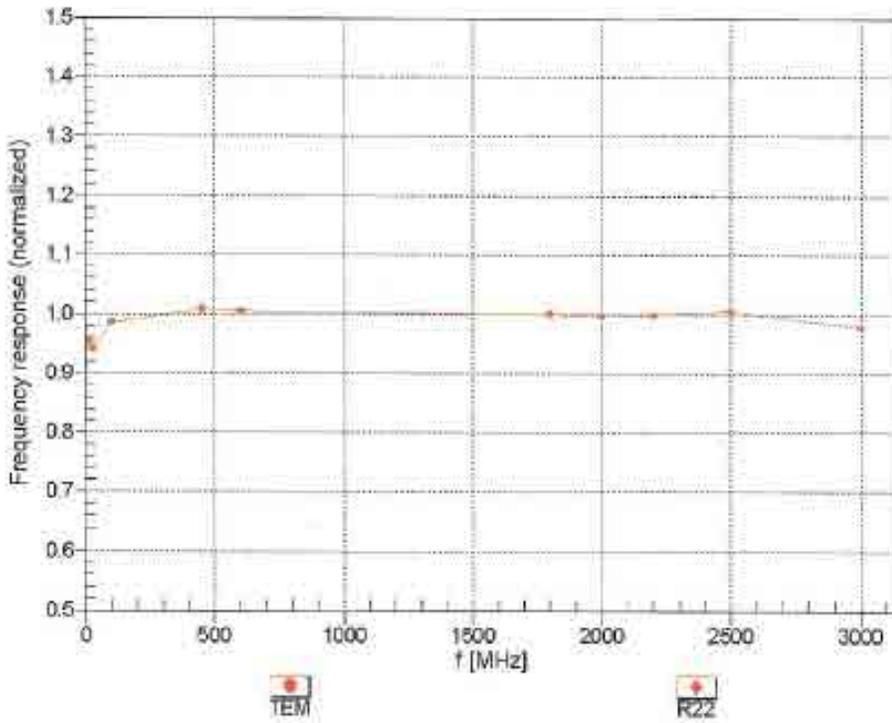


Uncertainty of Frequency Response of E-field: $\pm 6.3\%$ (k=2)

Receiving Pattern (ϕ), $\theta = 0^\circ$

f=600 MHz,TEM

f=1800 MHz,R22

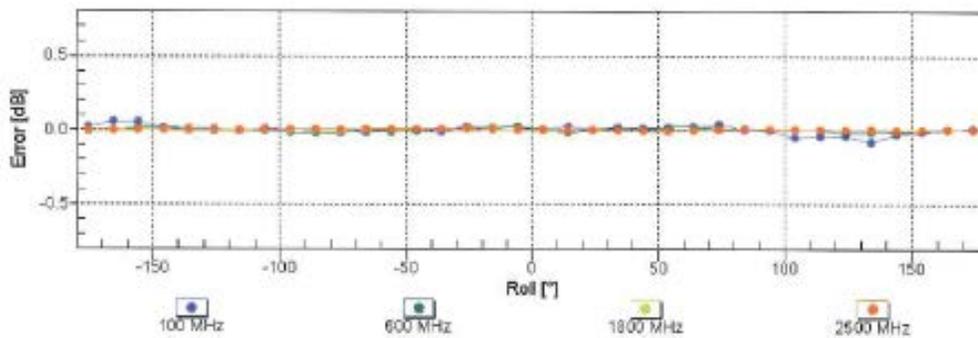
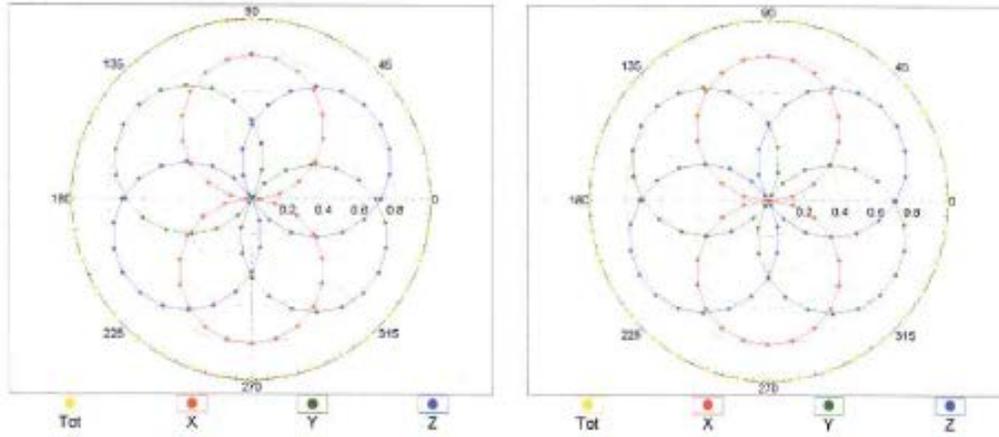


Uncertainty of Axial Isotropy Assessment: $\pm 0.5\%$ ($k=2$)

ES3DV3- SN:3122


June 19, 2015

Dynamic Range f(SAR_{head}) (TEM cell , f_{eval}= 1900 MHz)

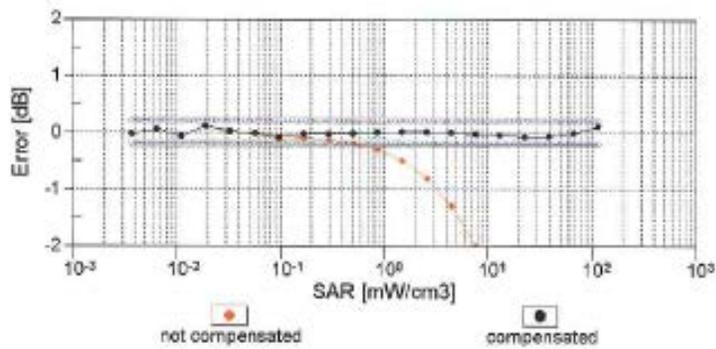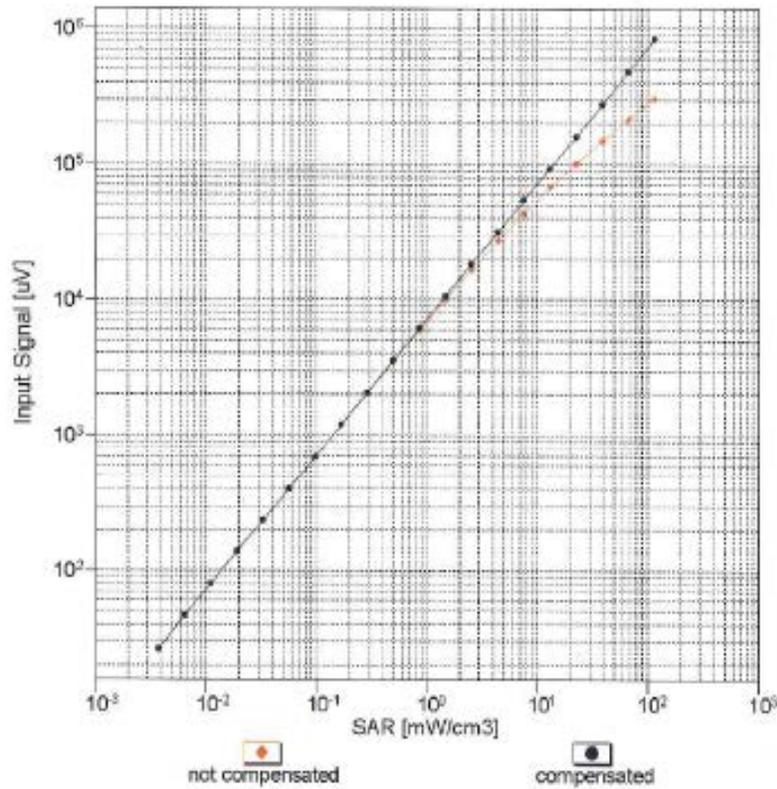


Uncertainty of Linearity Assessment: ± 0.6% (k=2)

Conversion Factor Assessment

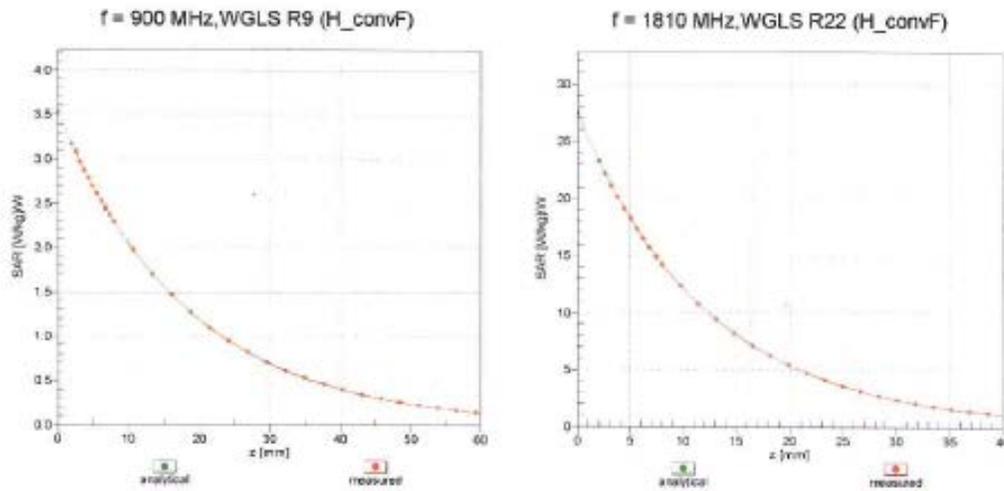

Deviation from Isotropy in Liquid Error (ϕ, θ), f = 900 MHz

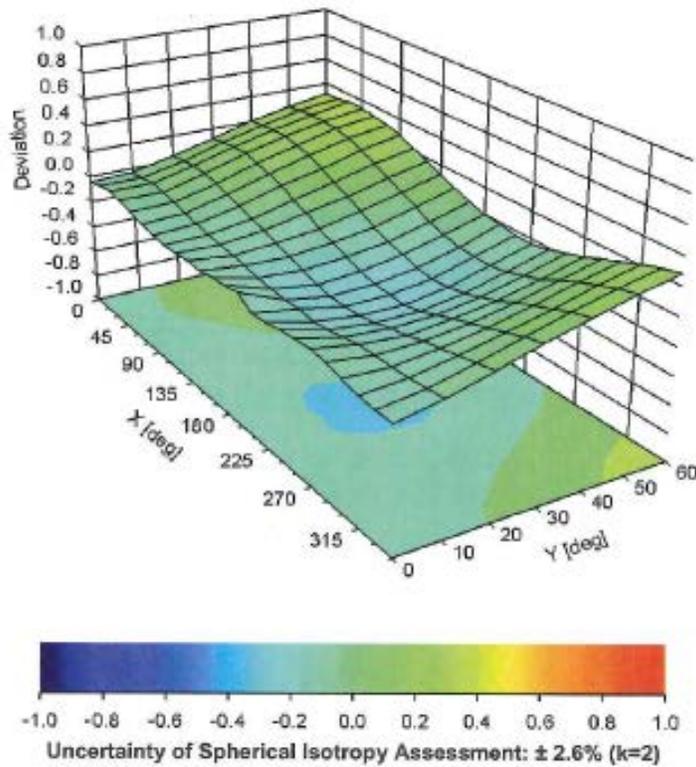

ES3DV3- SN:3122

June 19, 2015

DASY/EASY - Parameters of Probe: ES3DV3 - SN:3122

Other Probe Parameters

Sensor Arrangement	Triangular
Connector Angle (°)	24.1
Mechanical Surface Detection Mode	enabled
Optical Surface Detection Mode	disabled
Probe Overall Length	337 mm
Probe Body Diameter	10 mm
Tip Length	10 mm
Tip Diameter	4 mm
Probe Tip to Sensor X Calibration Point	2 mm
Probe Tip to Sensor Y Calibration Point	2 mm
Probe Tip to Sensor Z Calibration Point	2 mm
Recommended Measurement Distance from Surface	3 mm

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zaughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
C Service suisse d'étalonnage
S Servizio svizzero di taratura
S Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Client **Motorola Solutions MY**

Certificate No: **EX3-7364_Jun15**

CALIBRATION CERTIFICATE

Object **EX3DV4 - SN:7364**

Calibration procedure(s) **QA CAL-01.v9, QA CAL-12.v9, QA CAL-14 v4, QA CAL-23.v5,
QA CAL-25.v6
Calibration procedure for dosimetric E-field probes**

Calibration date: **June 23, 2015**

This calibration certificate documents the traceability to national standards, which realize the physical units of measurements (SI).
The measurements and the uncertainties with confidence probability are given on the following pages and are part of the certificate.

All calibrations have been conducted in the closed laboratory facility: environment temperature (22 ± 3)°C and humidity < 70%.

Calibration Equipment used (M&TE critical for calibration)

Primary Standards	ID	Cal Date (Certificate No.)	Scheduled Calibration
Power meter E4419B	GB41293874	01-Apr-15 (No. 217-02128)	Mar-16
Power sensor E4412A	MY41498087	01-Apr-15 (No. 217-02128)	Mar-16
Reference 3 dB Attenuator	SN: S5054 (3e)	01-Apr-15 (No. 217-02128)	Mar-16
Reference 20 dB Attenuator	SN: S5277 (20x)	01-Apr-15 (No. 217-02132)	Mar-16
Reference 30 dB Attenuator	SN: S5129 (30b)	01-Apr-15 (No. 217-02133)	Mar-16
Reference Probe ES3DV2	SN: 3013	30-Dec-14 (No. ES3-3013_Dec14)	Dec-15
DAE4	SN: 660	14-Jan-15 (No. DAE4-660_Jan15)	Jan-16
Secondary Standards	ID	Check Date (in house)	Scheduled Check
RF generator HP 8648C	US3642U01700	4-Aug-99 (in house check Apr-13)	In house check: Apr-15
Network Analyzer HP 8753E	US37390585	18-Oct-01 (in house check Oct-14)	In house check: Oct-15

Calibrated by:	Name Claudio Leuber	Function Laboratory Technician	Signature
Approved by:	Name Kelja Pirkovic	Function Technical Manager	

Issued: June 24, 2015

This calibration certificate shall not be reproduced except in full without written approval of the laboratory.

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
S Service suisse d'étalonnage
C Servizio svizzero di taratura
S Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Glossary:

TSL	tissue simulating liquid
NORM _{x,y,z}	sensitivity in free space
ConvF	sensitivity in TSL / NORM _{x,y,z}
DCP	diode compression point
CF	crest factor (1/duty_cycle) of the RF signal
A, B, C, D	modulation dependent linearization parameters
Polarization φ	φ rotation around probe axis
Polarization θ	θ rotation around an axis that is in the plane normal to probe axis (at measurement center), i.e., $\theta = 0$ is normal to probe axis
Connector Angle	information used in DASY system to align probe sensor X to the robot coordinate system

Calibration is Performed According to the Following Standards:

- a) IEEE Std 1528-2013, "IEEE Recommended Practice for Determining the Peak Spatial-Averaged Specific Absorption Rate (SAR) in the Human Head from Wireless Communications Devices: Measurement Techniques", June 2013
- b) IEC 62209-1, "Procedure to measure the Specific Absorption Rate (SAR) for hand-held devices used in close proximity to the ear (frequency range of 300 MHz to 3 GHz)", February 2005

Methods Applied and Interpretation of Parameters:

- **NORM_{x,y,z}**: Assessed for E-field polarization $\theta = 0$ ($f \leq 900$ MHz in TEM-cell; $f > 1800$ MHz: R22 waveguide). NORM_{x,y,z} are only intermediate values, i.e., the uncertainties of NORM_{x,y,z} does not affect the E²-field uncertainty inside TSL (see below ConvF).
- **NORM(f)_{x,y,z} = NORM_{x,y,z} * frequency_response** (see Frequency Response Chart). This linearization is implemented in DASY4 software versions later than 4.2. The uncertainty of the frequency response is included in the stated uncertainty of ConvF.
- **DCP_{x,y,z}**: DCP are numerical linearization parameters assessed based on the data of power sweep with CW signal (no uncertainty required). DCP does not depend on frequency nor media.
- **PAR**: PAR is the Peak to Average Ratio that is not calibrated but determined based on the signal characteristics
- **A_{x,y,z}; B_{x,y,z}; C_{x,y,z}; D_{x,y,z}; VR_{x,y,z}**: A, B, C, D are numerical linearization parameters assessed based on the data of power sweep for specific modulation signal. The parameters do not depend on frequency nor media. VR is the maximum calibration range expressed in RMS voltage across the diode.
- **ConvF and Boundary Effect Parameters**: Assessed in flat phantom using E-field (or Temperature Transfer Standard for $f \leq 800$ MHz) and inside waveguide using analytical field distributions based on power measurements for $f > 800$ MHz. The same setups are used for assessment of the parameters applied for boundary compensation (alpha, depth) of which typical uncertainty values are given. These parameters are used in DASY4 software to improve probe accuracy close to the boundary. The sensitivity in TSL corresponds to NORM_{x,y,z} * ConvF whereby the uncertainty corresponds to that given for ConvF. A frequency dependent ConvF is used in DASY version 4.4 and higher which allows extending the validity from ± 50 MHz to ± 100 MHz.
- **Spherical Isotropy (3D deviation from isotropy)**: in a field of low gradients realized using a flat phantom exposed by a patch antenna.
- **Sensor Offset**: The sensor offset corresponds to the offset of virtual measurement center from the probe tip (on probe axis). No tolerance required.
- **Connector Angle**: The angle is assessed using the information gained by determining the NORM_x (no uncertainty required).

EX3DV4 – SN:7364

June 23, 2015

Probe EX3DV4

SN:7364

Manufactured: February 5, 2015

Calibrated: June 23, 2015

Calibrated for DASY/EASY Systems

(Note: non-compatible with DASY2 system!)

EX3DV4- SN:7364

June 23, 2015

DASY/EASY - Parameters of Probe: EX3DV4 - SN:7364

Basic Calibration Parameters

	Sensor X	Sensor Y	Sensor Z	Unc (k=2)
Norm ($\mu\text{V}/(\text{V}/\text{m})^2$) ^A	0.48	0.46	0.59	$\pm 10.1\%$
DCP (mV) ^B	97.7	96.3	97.3	

Modulation Calibration Parameters

UID	Communication System Name		A dB	B dB/ μV	C	D dB	VR mV	Unc ^C (k=2)
0	CW	X	0.0	0.0	1.0	0.00	115.0	$\pm 3.5\%$
		Y	0.0	0.0	1.0		110.5	
		Z	0.0	0.0	1.0		124.6	
10011-CAB	UMTS-FDD (WCDMA)	X	3.42	67.2	18.6	2.91	122.6	$\pm 0.5\%$
		Y	3.14	64.8	18.9		117.5	
		Z	3.48	67.3	18.5		135.3	
10012-CAB	IEEE 802.11b WiFi 2.4 GHz (DSSS, 1 Mbps)	X	2.86	68.1	18.5	1.87	122.4	$\pm 0.5\%$
		Y	2.39	63.9	15.8		117.3	
		Z	3.01	69.0	18.8		135.0	
10013-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS-OFDM, 6 Mbps)	X	10.47	68.7	22.2	9.46	115.4	$\pm 2.7\%$
		Y	10.30	68.1	21.6		107.3	
		Z	10.58	69.3	22.6		126.2	
10059-CAB	IEEE 802.11b WiFi 2.4 GHz (DSSS, 2 Mbps)	X	3.03	69.0	19.0	2.12	120.5	$\pm 0.5\%$
		Y	2.58	65.1	16.6		115.0	
		Z	2.93	68.2	18.4		133.3	
10080-CAB	IEEE 802.11b WiFi 2.4 GHz (DSSS, 5.5 Mbps)	X	3.74	77.3	22.8	2.83	148.9	$\pm 0.5\%$
		Y	2.75	70.3	19.2		141.7	
		Z	3.40	75.1	21.8		118.0	
10061-CAB	IEEE 802.11b WiFi 2.4 GHz (DSSS, 11 Mbps)	X	3.83	73.4	21.4	3.60	145.6	$\pm 0.7\%$
		Y	3.06	68.2	18.5		139.1	
		Z	3.96	74.0	21.7		117.9	
10062-CAB	IEEE 802.11a/b WiFi 5 GHz (OFDM, 6 Mbps)	X	10.17	68.5	21.5	8.68	116.8	$\pm 2.5\%$
		Y	9.91	67.6	20.8		107.4	
		Z	10.39	69.3	22.0		132.5	
10063-CAB	IEEE 802.11a/b WiFi 5 GHz (OFDM, 9 Mbps)	X	10.01	68.4	21.4	8.63	116.3	$\pm 2.5\%$
		Y	9.85	67.7	20.9		108.8	
		Z	10.24	69.2	22.0		131.7	
10064-CAB	IEEE 802.11a/b WiFi 5 GHz (OFDM, 12 Mbps)	X	10.46	68.7	21.9	9.09	117.4	$\pm 2.7\%$
		Y	10.34	68.2	21.3		110.7	
		Z	10.69	69.6	22.5		132.1	
10065-CAB	IEEE 802.11a/b WiFi 5 GHz (OFDM, 18 Mbps)	X	10.10	68.4	21.7	9.00	113.5	$\pm 2.5\%$
		Y	10.01	68.0	21.2		107.5	
		Z	10.29	69.2	22.2		127.6	
10066-CAB	IEEE 802.11a/b WiFi 5 GHz (OFDM, 24 Mbps)	X	10.32	68.7	22.1	9.38	113.2	$\pm 2.5\%$
		Y	10.20	68.1	21.6		106.0	
		Z	10.49	69.4	22.6		125.8	

Certificate No: EX3-7364_Jun15

Page 4 of 18

EX3DV4- SN:7364

June 23, 2015

10067-CAB	IEEE 802.11a/n WiFi 5 GHz (OFDM, 36 Mbps)	X	10.83	69.1	22.8	10.12	111.9	±3.0 %
		Y	10.70	68.6	22.3		105.5	
		Z	11.04	70.0	23.5		125.5	
10068-CAB	IEEE 802.11a/n WiFi 5 GHz (OFDM, 48 Mbps)	X	10.64	69.0	22.9	10.24	108.5	±3.3 %
		Y	11.07	70.0	23.2		145.3	
		Z	10.83	69.9	23.5		121.7	
10069-CAB	IEEE 802.11a/n WiFi 5 GHz (OFDM, 54 Mbps)	X	10.95	69.2	23.2	10.56	109.6	±3.5 %
		Y	11.38	70.3	23.6		146.1	
		Z	11.13	70.1	23.8		122.0	
10071-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 9 Mbps)	X	10.46	68.7	22.4	9.83	110.6	±2.5 %
		Y	10.36	68.2	21.9		105.8	
		Z	10.71	69.6	23.1		124.2	
10072-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 12 Mbps)	X	10.01	68.4	22.2	9.62	106.7	±3.0 %
		Y	10.38	69.2	22.4		144.1	
		Z	10.18	69.1	22.7		119.4	
10073-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 18 Mbps)	X	10.78	70.9	23.9	9.94	149.7	±3.0 %
		Y	10.27	69.1	22.6		139.1	
		Z	10.17	69.3	23.1		115.9	
10074-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 24 Mbps)	X	10.82	71.0	24.2	10.30	144.0	±3.3 %
		Y	10.30	69.2	22.9		133.6	
		Z	10.22	69.5	23.4		111.6	
10075-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 36 Mbps)	X	10.91	71.3	24.8	10.77	136.9	±3.3 %
		Y	10.34	69.2	23.3		129.4	
		Z	10.31	69.7	23.9		108.0	
10076-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 48 Mbps)	X	10.84	71.1	24.9	10.94	134.9	±3.3 %
		Y	10.25	69.0	23.3		125.9	
		Z	10.28	69.7	24.1		106.3	
10077-CAB	IEEE 802.11g WiFi 2.4 GHz (DSSS/OFDM, 54 Mbps)	X	10.61	71.1	24.9	11.00	133.2	±3.5 %
		Y	10.23	69.1	23.4		124.7	
		Z	11.06	72.3	25.6		148.3	
10097-CAB	UMTS-FDD (HSDPA)	X	4.64	66.4	18.3	3.98	129.4	±0.7 %
		Y	4.47	65.1	17.4		126.4	
		Z	4.82	67.2	18.8		144.7	
10096-CAB	UMTS-FDD (HSUPA, Subtest 2)	X	4.66	66.5	18.4	3.98	130.1	±0.7 %
		Y	4.50	65.3	17.5		126.7	
		Z	4.78	67.0	18.7		145.5	
10100-CAB	LTE-FDD (SC-FDMA, 100% RB, 20 MHz, QPSK)	X	6.59	67.6	19.7	5.67	136.1	±1.4 %
		Y	6.37	66.4	18.8		131.7	
		Z	6.14	66.0	18.9		107.5	
10101-CAB	LTE-FDD (SC-FDMA, 100% RB, 20 MHz, 16-QAM)	X	7.68	67.9	20.1	6.42	146.1	±1.7 %
		Y	7.50	67.0	19.4		140.3	
		Z	7.24	66.6	19.5		115.2	
10102-CAB	LTE-FDD (SC-FDMA, 100% RB, 20 MHz, 64-QAM)	X	8.00	68.2	20.4	6.60	146.5	±1.7 %
		Y	7.78	67.2	19.6		141.8	
		Z	7.54	66.9	19.7		117.4	

EX3DV4- SN:7364

June 23, 2015

10108-CAC	LTE-FDD (SC-FDMA, 100% RB, 10 MHz, QPSK)	X	8.41	67.0	19.5	5.80	133.0	±1.2 %
		Y	6.24	66.1	18.8		128.4	
		Z	6.04	65.7	18.9		106.2	
10109-CAC	LTE-FDD (SC-FDMA, 100% RB, 10 MHz, 16-QAM)	X	7.40	67.6	20.0	6.43	141.0	±1.7 %
		Y	7.23	66.7	19.3		135.5	
		Z	8.98	66.3	19.4		111.0	
10110-CAC	LTE-FDD (SC-FDMA, 100% RB, 5 MHz, QPSK)	X	6.05	66.5	19.2	5.75	129.1	±1.4 %
		Y	5.89	65.5	18.5		124.3	
		Z	6.26	67.4	19.8		145.9	
10111-CAC	LTE-FDD (SC-FDMA, 100% RB, 5 MHz, 16-QAM)	X	7.12	67.4	20.0	6.44	136.5	±1.4 %
		Y	6.94	66.5	19.2		130.6	
		Z	6.69	66.0	19.3		107.3	
10112-CAC	LTE-FDD (SC-FDMA, 100% RB, 10 MHz, 64-QAM)	X	7.64	67.8	20.2	6.59	142.4	±1.7 %
		Y	7.46	66.9	19.5		136.7	
		Z	7.21	66.5	19.6		111.3	
10113-CAC	LTE-FDD (SC-FDMA, 100% RB, 5 MHz, 64-QAM)	X	7.32	67.5	20.1	6.62	137.7	±1.7 %
		Y	7.15	66.6	19.4		131.4	
		Z	6.92	66.2	19.4		108.9	
10114-CAB	IEEE 802.11n (HT Greenfield, 13.5 Mbps, BPSK)	X	10.23	68.5	21.0	8.10	124.2	±2.5 %
		Y	10.04	67.9	20.5		117.0	
		Z	10.56	69.5	21.7		142.7	
10115-CAB	IEEE 802.11n (HT Greenfield, 81 Mbps, 16-QAM)	X	10.80	69.1	21.5	8.46	128.6	±2.5 %
		Y	10.61	68.5	21.0		120.9	
		Z	11.08	70.0	22.1		145.6	
10116-CAB	IEEE 802.11n (HT Greenfield, 135 Mbps, 64-QAM)	X	10.31	68.7	21.1	8.15	125.0	±2.5 %
		Y	10.13	68.1	20.6		118.2	
		Z	10.59	69.6	21.7		142.4	
10117-CAB	IEEE 802.11n (HT Mixed, 13.5 Mbps, BPSK)	X	10.27	68.6	21.1	8.07	125.9	±2.5 %
		Y	10.08	68.0	20.5		119.0	
		Z	10.52	69.4	21.6		142.8	
10118-CAB	IEEE 802.11n (HT Mixed, 81 Mbps, 16-QAM)	X	10.91	69.2	21.7	8.59	128.3	±2.5 %
		Y	10.70	68.6	21.1		121.2	
		Z	11.21	70.2	22.3		146.3	
10119-CAB	IEEE 802.11n (HT Mixed, 135 Mbps, 64-QAM)	X	10.27	68.6	21.1	8.13	125.1	±2.5 %
		Y	10.10	68.0	20.5		118.1	
		Z	10.57	69.6	21.7		142.8	
10140-CAB	LTE-FDD (SC-FDMA, 100% RB, 15 MHz, 16-QAM)	X	7.93	68.3	20.4	6.49	147.7	±1.7 %
		Y	7.73	67.4	19.6		142.8	
		Z	7.42	66.8	19.6		116.6	
10141-CAB	LTE-FDD (SC-FDMA, 100% RB, 15 MHz, 64-QAM)	X	8.04	68.2	20.3	6.53	149.1	±1.7 %
		Y	7.84	67.4	19.6		143.2	
		Z	7.58	66.9	19.7		117.6	
10142-CAC	LTE-FDD (SC-FDMA, 100% RB, 3 MHz, QPSK)	X	5.83	66.2	19.1	5.73	125.7	±1.2 %
		Y	5.68	65.2	18.4		121.2	
		Z	6.04	67.0	19.6		142.9	

EX3DV4- SN:7364

June 23, 2015

10143-CAC	LTE-FDD (SC-FDMA, 100% RB, 3 MHz, 16-QAM)	X	6.82	67.3	19.9	6.35	131.4	±1.4 %
		Y	6.65	66.3	19.1		126.5	
		Z	7.04	68.1	20.4		148.1	
10144-CAC	LTE-FDD (SC-FDMA, 100% RB, 3 MHz, 64-QAM)	X	7.15	67.5	20.1	6.65	132.6	±1.4 %
		Y	6.96	66.6	19.4		127.2	
		Z	7.36	68.4	20.7		149.1	
10145-CAC	LTE-FDD (SC-FDMA, 100% RB, 1.4 MHz, QPSK)	X	5.54	65.9	19.0	5.76	120.5	±1.2 %
		Y	5.42	65.1	18.3		116.1	
		Z	5.76	66.9	19.6		135.7	
10146-CAC	LTE-FDD (SC-FDMA, 100% RB, 1.4 MHz, 16-QAM)	X	6.48	67.3	19.9	6.41	124.0	±1.4 %
		Y	6.28	66.2	19.1		119.2	
		Z	6.70	68.1	20.4		140.0	
10147-CAC	LTE-FDD (SC-FDMA, 100% RB, 1.4 MHz, 64-QAM)	X	6.74	67.4	20.1	6.72	124.3	±1.7 %
		Y	6.55	66.4	19.4		119.3	
		Z	6.97	68.3	20.7		140.2	
10149-CAB	LTE-FDD (SC-FDMA, 50% RB, 20 MHz, 16-QAM)	X	7.35	67.4	19.9	6.42	138.2	±1.4 %
		Y	7.17	66.5	19.2		133.3	
		Z	6.97	66.3	19.4		109.6	
10150-CAB	LTE-FDD (SC-FDMA, 50% RB, 20 MHz, 64-QAM)	X	7.61	67.7	20.1	6.60	140.5	±1.4 %
		Y	7.45	66.9	19.5		135.0	
		Z	7.22	66.5	19.6		112.4	
10154-CAC	LTE-FDD (SC-FDMA, 50% RB, 10 MHz, QPSK)	X	6.03	66.4	19.2	5.75	127.0	±1.4 %
		Y	5.85	65.3	18.4		122.3	
		Z	6.24	67.3	19.8		145.2	
10155-CAC	LTE-FDD (SC-FDMA, 50% RB, 10 MHz, 16-QAM)	X	7.06	67.2	19.8	6.43	134.1	±1.4 %
		Y	6.91	66.4	19.2		128.7	
		Z	6.69	66.1	19.3		107.1	
10156-CAC	LTE-FDD (SC-FDMA, 50% RB, 5 MHz, QPSK)	X	5.76	66.0	19.1	5.79	123.3	±1.2 %
		Y	5.63	65.1	18.3		118.7	
		Z	5.97	67.0	19.7		139.3	
10157-CAC	LTE-FDD (SC-FDMA, 50% RB, 5 MHz, 16-QAM)	X	6.80	67.2	19.9	6.49	128.7	±1.4 %
		Y	6.62	66.3	19.2		123.2	
		Z	6.99	68.0	20.4		144.9	
10158-CAC	LTE-FDD (SC-FDMA, 50% RB, 10 MHz, 64-QAM)	X	7.30	67.4	20.0	6.62	134.5	±1.4 %
		Y	7.12	66.5	19.3		129.0	
		Z	6.91	66.3	19.5		107.5	
10159-CAC	LTE-FDD (SC-FDMA, 50% RB, 5 MHz, 64-QAM)	X	6.91	67.4	20.0	6.56	129.3	±1.4 %
		Y	6.69	66.3	19.2		123.1	
		Z	7.12	68.2	20.5		145.9	
10160-CAB	LTE-FDD (SC-FDMA, 50% RB, 15 MHz, QPSK)	X	6.54	67.1	19.6	5.82	132.9	±1.4 %
		Y	6.29	65.9	18.7		126.6	
		Z	6.71	67.9	20.0		149.3	
10161-CAB	LTE-FDD (SC-FDMA, 50% RB, 15 MHz, 16-QAM)	X	7.41	67.6	20.0	6.43	139.7	±1.7 %
		Y	7.22	66.6	19.3		133.2	
		Z	6.97	66.2	19.3		110.0	

EX3DV4- SN:7364

June 23, 2015

10162-CAB	LTE-FDD (SC-FDMA, 50% RB, 15 MHz, 64-QAM)	X	7.66	67.9	20.2	6.58	141.5	±1.7 %
		Y	7.48	67.0	19.5		134.6	
		Z	7.18	66.4	19.5		112.1	
10166-CAC	LTE-FDD (SC-FDMA, 50% RB, 1.4 MHz, QPSK)	X	4.96	65.8	18.8	5.46	115.4	±0.9 %
		Y	4.76	64.5	17.9		110.2	
		Z	5.13	66.5	19.3		130.4	
10167-CAC	LTE-FDD (SC-FDMA, 50% RB, 1.4 MHz, 16-QAM)	X	5.82	66.9	19.6	6.21	117.4	±1.2 %
		Y	5.60	65.7	18.8		109.9	
		Z	6.07	67.9	20.3		132.7	
10168-CAC	LTE-FDD (SC-FDMA, 50% RB, 1.4 MHz, 64-QAM)	X	6.28	67.1	20.0	6.79	117.2	±1.4 %
		Y	6.06	66.0	19.2		111.0	
		Z	6.49	67.9	20.6		132.0	
10169-CAB	LTE-FDD (SC-FDMA, 1 RB, 20 MHz, QPSK)	X	4.78	65.8	19.1	5.73	109.6	±1.2 %
		Y	4.92	66.1	19.0		145.3	
		Z	4.94	66.5	19.6		123.2	
10170-CAB	LTE-FDD (SC-FDMA, 1 RB, 20 MHz, 16-QAM)	X	5.36	66.3	19.7	6.52	107.4	±1.4 %
		Y	5.59	67.0	19.8		142.7	
		Z	5.61	67.4	20.4		121.7	
10171-AAB	LTE-FDD (SC-FDMA, 1 RB, 20 MHz, 64-QAM)	X	5.38	66.5	19.7	6.49	107.3	±1.4 %
		Y	5.59	67.1	19.8		144.6	
		Z	5.64	67.6	20.4		121.5	
10175-CAC	LTE-FDD (SC-FDMA, 1 RB, 10 MHz, QPSK)	X	4.71	65.4	18.6	5.72	107.7	±1.2 %
		Y	4.91	66.0	18.9		144.8	
		Z	4.91	66.3	19.4		122.3	
10176-CAC	LTE-FDD (SC-FDMA, 1 RB, 10 MHz, 16-QAM)	X	5.78	68.1	20.6	6.52	149.6	±1.4 %
		Y	5.57	66.9	19.7		142.9	
		Z	5.65	67.6	20.5		121.7	
10177-CAE	LTE-FDD (SC-FDMA, 1 RB, 5 MHz, QPSK)	X	5.05	67.1	19.7	5.73	150.0	±1.2 %
		Y	4.91	66.0	18.9		144.6	
		Z	4.93	66.5	19.5		122.4	
10178-CAC	LTE-FDD (SC-FDMA, 1 RB, 5 MHz, 16-QAM)	X	5.80	68.2	20.7	6.52	149.3	±1.4 %
		Y	5.59	67.0	19.8		142.5	
		Z	5.63	67.5	20.4		121.7	
10179-CAC	LTE-FDD (SC-FDMA, 1 RB, 10 MHz, 64-QAM)	X	5.80	68.3	20.7	6.50	149.2	±1.4 %
		Y	5.62	67.2	19.9		144.8	
		Z	5.61	67.5	20.4		121.4	
10180-CAC	LTE-FDD (SC-FDMA, 1 RB, 5 MHz, 64-QAM)	X	5.80	68.3	20.7	6.50	148.6	±1.4 %
		Y	5.60	67.1	19.8		144.4	
		Z	5.63	67.5	20.4		121.6	
10181-CAB	LTE-FDD (SC-FDMA, 1 RB, 15 MHz, QPSK)	X	5.04	67.0	19.7	5.72	149.4	±1.2 %
		Y	4.94	66.2	19.1		145.5	
		Z	4.92	66.4	19.5		122.1	
10182-CAB	LTE-FDD (SC-FDMA, 1 RB, 15 MHz, 16-QAM)	X	5.79	68.2	20.7	6.52	148.9	±1.4 %
		Y	5.57	66.9	19.7		142.2	
		Z	5.63	67.5	20.5		121.0	

EX3DV4- SN:7364

June 23, 2015

10183-AAA	LTE-FDD (SC-FDMA, 1 RB, 15 MHz, 64-QAM)	X	5.81	68.4	20.8	6.50	148.4	±1.4 %
		Y	5.62	67.2	19.9		144.3	
		Z	5.62	67.5	20.4		121.1	
10184-CAC	LTE-FDD (SC-FDMA, 1 RB, 3 MHz, QPSK)	X	5.06	67.1	19.8	5.73	149.2	±1.2 %
		Y	4.91	66.0	18.9		144.9	
		Z	4.94	66.5	19.5		122.0	
10185-CAC	LTE-FDD (SC-FDMA, 1 RB, 3 MHz, 16-QAM)	X	5.77	68.1	20.6	6.51	148.4	±1.4 %
		Y	5.57	66.9	19.8		142.5	
		Z	5.62	67.5	20.4		121.5	
10186-AAC	LTE-FDD (SC-FDMA, 1 RB, 3 MHz, 64-QAM)	X	5.81	68.4	20.8	6.50	148.0	±1.7 %
		Y	5.63	67.3	19.9		144.7	
		Z	5.60	67.5	20.3		121.0	
10187-CAC	LTE-FDD (SC-FDMA, 1 RB, 1.4 MHz, QPSK)	X	5.07	67.1	19.8	5.73	149.3	±1.2 %
		Y	4.94	66.2	19.0		145.6	
		Z	4.91	66.3	19.4		122.3	
10188-CAC	LTE-FDD (SC-FDMA, 1 RB, 1.4 MHz, 16-QAM)	X	5.79	68.2	20.7	6.52	148.1	±1.7 %
		Y	5.57	66.9	19.7		142.5	
		Z	5.61	67.4	20.4		121.2	
10189-AAC	LTE-FDD (SC-FDMA, 1 RB, 1.4 MHz, 64-QAM)	X	5.83	68.5	20.8	6.50	148.1	±1.4 %
		Y	5.60	67.1	19.8		144.5	
		Z	5.64	67.6	20.4		121.5	
10193-CAB	IEEE 802.11n (HT Greenfield, 6.5 Mbps, BPSK)	X	9.64	67.7	20.6	8.09	112.5	±2.2 %
		Y	9.63	67.5	20.3		109.6	
		Z	10.04	68.9	21.4		132.4	
10194-CAB	IEEE 802.11n (HT Greenfield, 39 Mbps, 16-QAM)	X	9.78	68.0	20.9	8.12	116.1	±2.2 %
		Y	9.67	67.5	20.4		110.9	
		Z	10.06	68.9	21.5		131.8	
10195-CAB	IEEE 802.11n (HT Greenfield, 65 Mbps, 64-QAM)	X	9.93	68.3	21.0	8.21	117.1	±2.5 %
		Y	9.81	67.7	20.5		112.3	
		Z	10.19	69.1	21.5		134.2	
10196-CAB	IEEE 802.11n (HT Mixed, 6.5 Mbps, BPSK)	X	9.73	68.0	20.8	8.10	116.3	±2.2 %
		Y	9.62	67.5	20.3		111.7	
		Z	10.01	68.9	21.4		132.6	
10197-CAB	IEEE 802.11n (HT Mixed, 39 Mbps, 16-QAM)	X	9.77	68.0	20.8	8.13	116.4	±2.2 %
		Y	9.75	67.7	20.5		111.4	
		Z	10.10	69.0	21.5		132.9	
10198-CAB	IEEE 802.11n (HT Mixed, 65 Mbps, 64-QAM)	X	9.96	68.2	21.0	8.27	117.4	±2.5 %
		Y	9.88	67.8	20.6		112.8	
		Z	10.29	69.3	21.7		135.1	
10219-CAB	IEEE 802.11n (HT Mixed, 7.2 Mbps, BPSK)	X	9.62	67.9	20.8	8.03	116.5	±2.2 %
		Y	9.53	67.4	20.3		111.0	
		Z	9.94	68.9	21.4		132.9	
10220-CAB	IEEE 802.11n (HT Mixed, 43.3 Mbps, 16-QAM)	X	9.81	68.1	20.9	8.13	117.2	±2.2 %
		Y	9.70	67.6	20.4		111.6	
		Z	10.10	69.0	21.5		134.0	

EX3DV4- SN:7364

June 23, 2015

10221-CAB	IEEE 802.11n (HT Mixed, 72.2 Mbps, 64-QAM)	X	9.97	68.2	21.0	8.27	118.3	±2.5 %
		Y	9.89	67.8	20.6		112.7	
		Z	10.29	69.2	21.7		135.4	
10222-CAB	IEEE 802.11n (HT Mixed, 15 Mbps, BPSK)	X	10.14	68.4	20.9	8.06	122.8	±2.5 %
		Y	10.02	67.9	20.5		116.9	
		Z	10.48	69.4	21.6		140.6	
10223-CAB	IEEE 802.11n (HT Mixed, 90 Mbps, 16-QAM)	X	10.72	69.0	21.4	8.48	126.2	±2.5 %
		Y	10.54	68.3	20.9		119.3	
		Z	11.04	69.9	22.1		143.9	
10224-CAB	IEEE 802.11n (HT Mixed, 150 Mbps, 64-QAM)	X	10.13	68.4	20.9	8.08	123.4	±2.5 %
		Y	10.01	68.0	20.5		115.7	
		Z	10.44	69.3	21.5		140.3	
10225-CAB	UMTS-FDD (HSPA+)	X	7.19	67.5	19.6	5.97	143.8	±1.4 %
		Y	7.05	66.7	19.0		138.4	
		Z	6.78	66.2	19.0		112.5	
10274-CAB	UMTS-FDD (HSUPA, Subtest 5, 3GPP Rel8.10)	X	6.03	66.9	18.8	4.87	136.9	±1.2 %
		Y	5.89	66.1	18.1		131.5	
		Z	5.76	66.1	18.5		109.1	
10275-CAB	UMTS-FDD (HSUPA, Subtest 5, 3GPP Rel8.4)	X	4.32	65.7	18.0	3.96	119.3	±0.9 %
		Y	4.16	64.5	17.1		112.7	
		Z	4.57	66.9	18.7		136.2	
10297-AAA	LTE-FDD (SC-FDMA, 50% RB, 20 MHz, QPSK)	X	6.29	66.6	19.2	5.81	126.9	±1.4 %
		Y	6.12	65.6	18.5		120.7	
		Z	6.52	67.5	19.8		142.9	
10298-AAB	LTE-FDD (SC-FDMA, 50% RB, 3 MHz, QPSK)	X	5.62	66.1	19.1	5.72	120.8	±1.2 %
		Y	5.44	65.0	18.3		115.1	
		Z	5.80	66.9	19.6		136.0	
10299-AAB	LTE-FDD (SC-FDMA, 50% RB, 3 MHz, 16-QAM)	X	6.55	67.1	19.8	6.39	125.4	±1.4 %
		Y	6.35	66.1	19.0		119.2	
		Z	6.82	68.2	20.5		140.5	
10300-AAB	LTE-FDD (SC-FDMA, 50% RB, 3 MHz, 64-QAM)	X	6.73	67.3	20.0	6.60	125.1	±1.4 %
		Y	6.53	66.3	19.2		118.8	
		Z	6.99	68.2	20.6		140.9	
10311-AAA	LTE-FDD (SC-FDMA, 100% RB, 15 MHz, QPSK)	X	6.94	67.4	19.7	6.06	135.3	±1.4 %
		Y	6.75	66.4	19.0		129.1	
		Z	6.55	66.2	19.2		106.3	
10315-AAB	IEEE 802.11b WiFi 2.4 GHz (DSSS, 1 Mbps, 96pc duty cycle)	X	2.71	67.3	17.7	1.71	120.4	±0.5 %
		Y	2.36	64.0	15.7		114.8	
		Z	2.97	68.9	18.7		133.5	
10316-AAB	IEEE 802.11g WiFi 2.4 GHz (ERP-OFDM, 6 Mbps, 96pc duty cycle)	X	9.89	68.1	21.1	8.36	116.2	±2.5 %
		Y	9.75	67.5	20.5		108.9	
		Z	10.15	69.0	21.6		131.4	
10317-AAB	IEEE 802.11a WiFi 5 GHz (OFDM, 6 Mbps, 96pc duty cycle)	X	9.89	68.1	21.1	8.36	116.7	±2.5 %
		Y	9.76	67.6	20.6		110.0	
		Z	10.16	69.0	21.7		132.3	

EX3DV4- SN:7364

June 23, 2015

10415-AAA	IEEE 802.11b WiFi 2.4 GHz (DSSS, 1 Mbps, 99pc duty cycle)	X	2.58	66.6	17.4	1.54	122.6	±0.5 %
		Y	2.36	64.2	15.8		117.2	
		Z	2.79	68.0	18.2		136.1	
10416-AAA	IEEE 802.11g WiFi 2.4 GHz (ERP-OFDM, 6 Mbps, 99pc duty cycle)	X	9.83	68.1	21.0	8.23	117.6	±2.2 %
		Y	9.72	67.6	20.5		110.8	
		Z	10.12	69.0	21.6		132.8	
10417-AAA	IEEE 802.11a/h WiFi 5 GHz (OFDM, 6 Mbps, 99pc duty cycle)	X	9.82	68.1	20.9	8.23	117.7	±2.2 %
		Y	9.76	67.7	20.5		111.5	
		Z	10.11	69.0	21.6		133.6	
10418-AAA	IEEE 802.11g WiFi 2.4 GHz (DSSS-OFDM, 6 Mbps, 99pc duty cycle, Long preamble)	X	9.69	68.0	20.9	8.14	116.6	±2.2 %
		Y	9.59	67.5	20.4		110.3	
		Z	9.95	68.8	21.4		131.4	
10419-AAA	IEEE 802.11g WiFi 2.4 GHz (DSSS-OFDM, 6 Mbps, 99pc duty cycle, Short preamble)	X	9.76	68.1	20.9	8.19	117.3	±2.2 %
		Y	9.70	67.6	20.5		111.1	
		Z	10.04	68.9	21.5		132.4	
10422-AAA	IEEE 802.11n (HT Greenfield, 7.2 Mbps, BPSK)	X	10.03	68.4	21.1	8.32	119.6	±2.5 %
		Y	9.90	67.7	20.6		112.8	
		Z	10.29	69.2	21.7		133.6	
10423-AAA	IEEE 802.11n (HT Greenfield, 43.3 Mbps, 16-QAM)	X	10.19	68.5	21.3	8.47	120.0	±2.5 %
		Y	10.08	68.0	20.8		112.9	
		Z	10.43	69.3	21.6		134.2	
10424-AAA	IEEE 802.11n (HT Greenfield, 72.2 Mbps, 64-QAM)	X	10.08	68.4	21.2	8.40	119.6	±2.5 %
		Y	9.96	67.8	20.7		112.6	
		Z	10.33	69.2	21.6		133.7	
10425-AAA	IEEE 802.11n (HT Greenfield, 15 Mbps, BPSK)	X	10.62	68.9	21.4	8.41	126.1	±2.7 %
		Y	10.42	68.2	20.8		117.7	
		Z	10.92	69.8	22.0		142.2	
10426-AAA	IEEE 802.11n (HT Greenfield, 90 Mbps, 16-QAM)	X	10.66	69.0	21.5	8.45	126.5	±2.7 %
		Y	10.43	68.2	20.8		118.2	
		Z	10.95	69.8	22.0		142.5	
10427-AAA	IEEE 802.11n (HT Greenfield, 150 Mbps, 64-QAM)	X	10.65	69.0	21.4	8.41	126.9	±2.7 %
		Y	10.40	68.2	20.8		118.2	
		Z	10.92	69.8	22.0		142.7	
10434-AAA	W-CDMA (BS Test Model 1, 64 DPCH)	X	9.04	67.7	21.1	8.60	103.3	±2.7 %
		Y	9.68	69.3	21.7		143.5	
		Z	9.37	68.8	21.8		116.7	

The reported uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor $k=2$, which for a normal distribution corresponds to a coverage probability of approximately 95%.

^A The uncertainties of Norm X, Y, Z do not affect the E^2 field uncertainty inside TSL (see Pages 12 and 13).

^B Numerical linearization parameter; uncertainty not required.

^C Uncertainty is determined using the max. deviation from linear response applying rectangular distribution and is expressed for the square of the field value.

DASY/EASY - Parameters of Probe: EX3DV4 - SN:7364

Calibration Parameter Determined in Head Tissue Simulating Media

f (MHz) ^c	Relative Permittivity ^e	Conductivity (S/m) ^e	ConvF X	ConvF Y	ConvF Z	Alpha ^d	Depth (mm)	Unct. (k=2)
150	52.3	0.76	12.95	12.95	12.95	0.00	1.00	± 13.3 %
300	45.3	0.87	11.95	11.95	11.95	0.10	1.10	± 13.3 %
450	43.5	0.87	10.72	10.72	10.72	0.15	1.10	± 13.3 %
750	41.9	0.89	10.01	10.01	10.01	0.29	1.06	± 12.0 %
900	41.5	0.97	9.26	9.26	9.26	0.24	1.23	± 12.0 %
1810	40.0	1.40	7.93	7.93	7.93	0.33	0.80	± 12.0 %
1900	40.0	1.40	7.93	7.93	7.93	0.35	0.80	± 12.0 %
2450	39.2	1.80	7.18	7.18	7.18	0.27	0.98	± 12.0 %
2600	39.0	1.96	6.93	6.93	6.93	0.34	0.93	± 12.0 %
5200	36.0	4.66	5.22	5.22	5.22	0.35	1.80	± 13.1 %
5300	35.9	4.76	5.00	5.00	5.00	0.35	1.80	± 13.1 %
5500	35.6	4.96	4.75	4.75	4.75	0.40	1.80	± 13.1 %
5600	35.5	5.07	4.64	4.64	4.64	0.40	1.80	± 13.1 %
5800	35.3	5.27	4.52	4.52	4.52	0.40	1.80	± 13.1 %

^c Frequency validity above 300 MHz of ± 100 MHz only applies for DASY v4.4 and higher (see Page 2), else it is restricted to ± 50 MHz. The uncertainty is the RSS of the ConvF uncertainty at calibration frequency and the uncertainty for the indicated frequency band. Frequency validity below 300 MHz is ± 10, 25, 40, 50 and 70 MHz for ConvF assessments at 30, 64, 128, 150 and 220 MHz respectively. Above 5 GHz frequency validity can be extended to ± 110 MHz.

^e At frequencies below 3 GHz, the validity of tissue parameters (ε and σ) can be relaxed to ± 10% if liquid compensation formula is applied to measured SAR values. At frequencies above 3 GHz, the validity of tissue parameters (ε and σ) is restricted to ± 5%. The uncertainty is the RSS of the ConvF uncertainty for indicated target tissue parameters.

^d Alpha/Depth are determined during calibration. SPEAG warrants that the remaining deviation due to the boundary effect after compensation is always less than ± 1% for frequencies below 3 GHz and below ± 2% for frequencies between 3-6 GHz at any distance larger than half the probe tip diameter from the boundary.

EX3DV4--SN7364

June 23, 2015

DASY/EASY - Parameters of Probe: EX3DV4 - SN:7364

Calibration Parameter Determined in Body Tissue Simulating Media

f (MHz) ^c	Relative Permittivity ^d	Conductivity (S/m) ^e	ConvF X	ConvF Y	ConvF Z	Alpha ^g	Depth ^h (mm)	Unct. (k=2)
150	61.9	0.80	12.28	12.28	12.28	0.00	1.00	± 13.3 %
300	58.2	0.92	11.24	11.24	11.24	0.08	1.10	± 13.3 %
450	56.7	0.94	11.02	11.02	11.02	0.09	1.10	± 13.3 %
750	55.5	0.96	9.42	9.42	9.42	0.27	1.06	± 12.0 %
900	55.0	1.05	9.20	9.20	9.20	0.27	1.22	± 12.0 %
1810	53.3	1.52	7.75	7.75	7.75	0.43	0.85	± 12.0 %
1900	53.3	1.52	7.57	7.57	7.57	0.47	0.80	± 12.0 %
2450	52.7	1.95	7.33	7.33	7.33	0.35	0.90	± 12.0 %
2600	52.5	2.16	7.17	7.17	7.17	0.31	0.95	± 12.0 %
5200	49.0	5.30	4.52	4.52	4.52	0.45	1.90	± 13.1 %
5300	48.9	5.42	4.29	4.29	4.29	0.45	1.90	± 13.1 %
5500	48.6	5.65	3.92	3.92	3.92	0.50	1.90	± 13.1 %
5600	48.5	5.77	3.74	3.74	3.74	0.50	1.90	± 13.1 %
5800	48.2	6.00	4.06	4.06	4.06	0.50	1.90	± 13.1 %

^c Frequency validity above 300 MHz of ± 100 MHz only applies for DASY v4.4 and higher (see Page 2), else it is restricted to ± 50 MHz. The uncertainty is the RSS of the ConvF uncertainty at calibration frequency and the uncertainty for the indicated frequency band. Frequency validity below 300 MHz is ± 10, 25, 40, 50 and 70 MHz for ConvF assessments at 30, 64, 128, 150 and 220 MHz respectively. Above 5 GHz frequency validity can be extended to ± 110 MHz.


^d At frequencies below 3 GHz, the validity of tissue parameters (ϵ and σ) can be relaxed to ± 10% if liquid compensation formula is applied to measured SAR values. At frequencies above 3 GHz, the validity of tissue parameters (ϵ and σ) is restricted to ± 5%. The uncertainty is the RSS of the ConvF uncertainty for indicated target tissue parameters.

^e Alpha/Depth are determined during calibration. SPEAG warrants that the remaining deviation due to the boundary effect after compensation is always less than ± 1% for frequencies below 3 GHz and below ± 2% for frequencies between 3-6 GHz at any distance larger than half the probe tip diameter from the boundary.

EX3DV4-SN:7364

June 23, 2015

Frequency Response of E-Field (TEM-Cell: ifi110 EXX, Waveguide: R22)

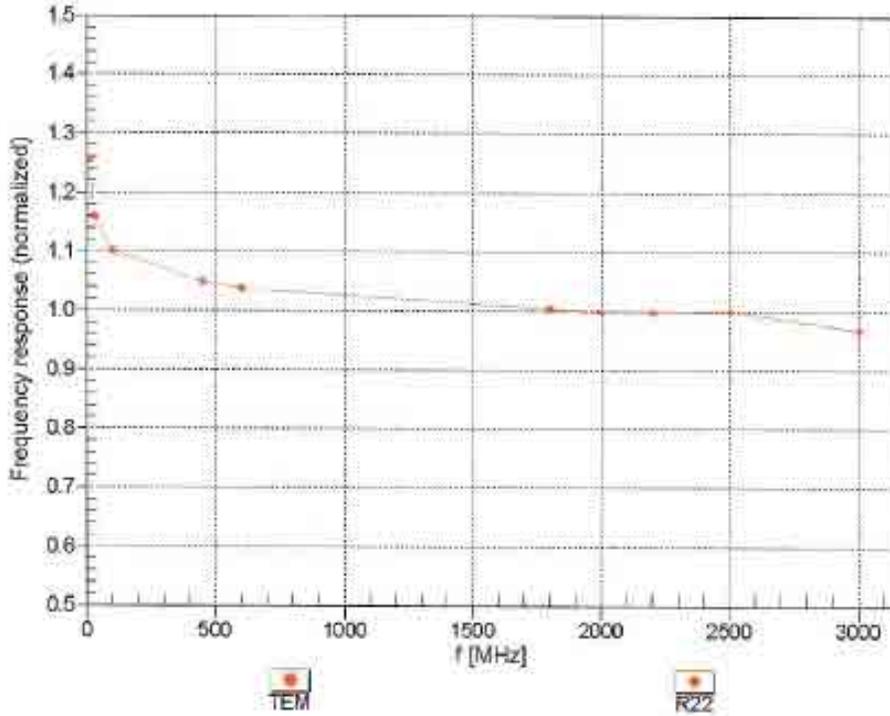

Uncertainty of Frequency Response of E-field: $\pm 6.3\%$ (k=2)



EX3DV4-SN:7364

June 23, 2015

Receiving Pattern (ϕ), $\theta = 0^\circ$

f=600 MHz,TEM

f=1800 MHz,R22

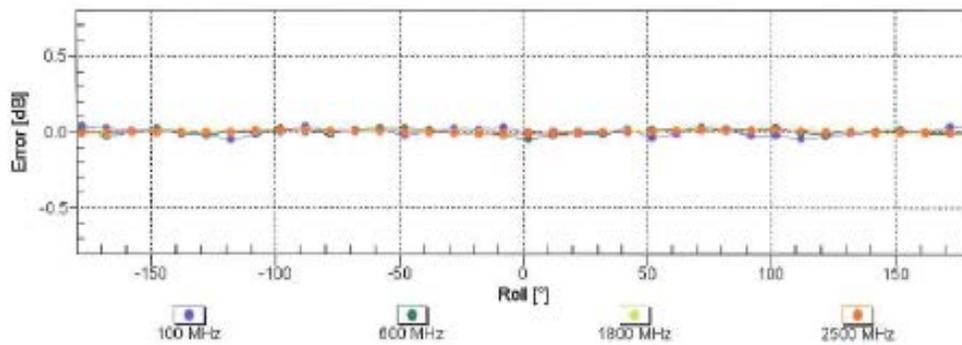
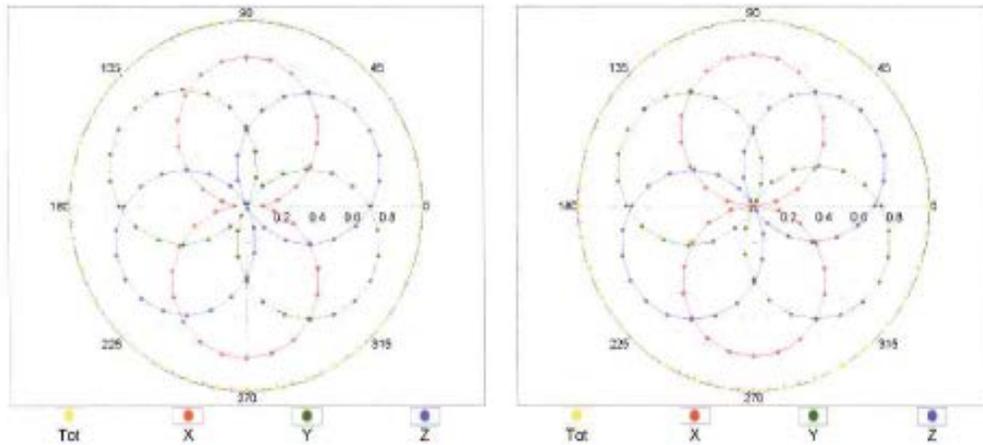


Uncertainty of Axial Isotropy Assessment: $\pm 0.5\%$ (k=2)

EX3DV4- SN:7364

June 23, 2015

Dynamic Range f(SAR_{head}) (TEM cell , f_{eval}= 1900 MHz)

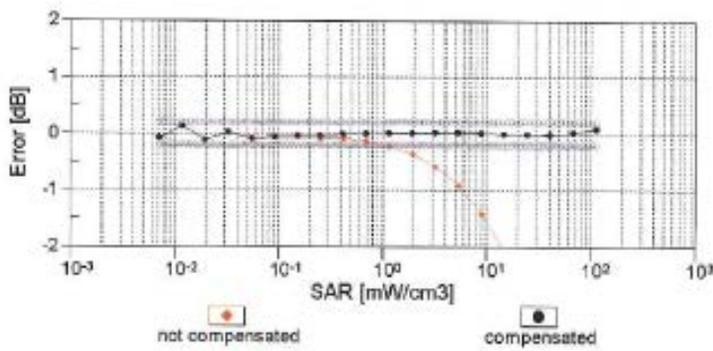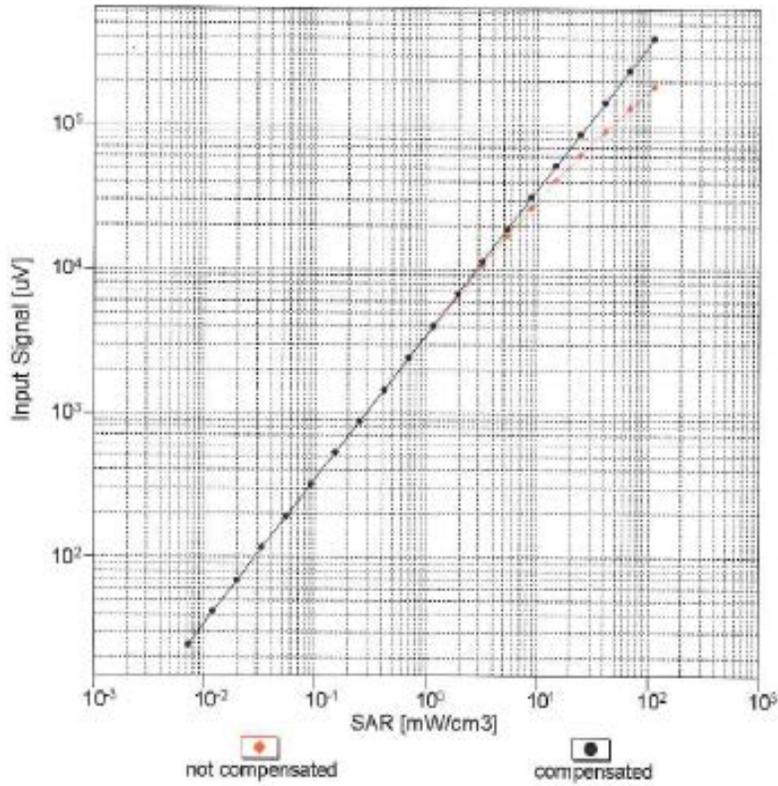


Uncertainty of Linearity Assessment: ± 0.6% (k=2)



EX3DV4- SN:7364

June 23, 2015

Conversion Factor Assessment

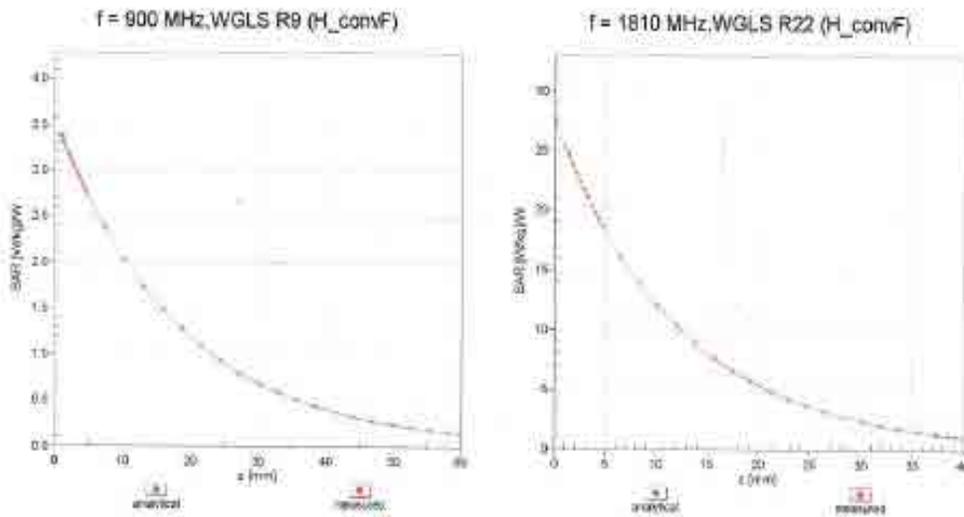

Deviation from Isotropy in Liquid Error (ϕ, θ), f = 900 MHz

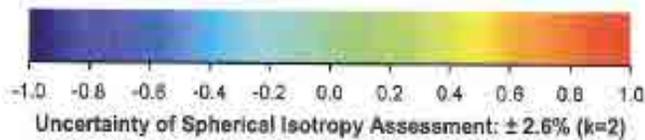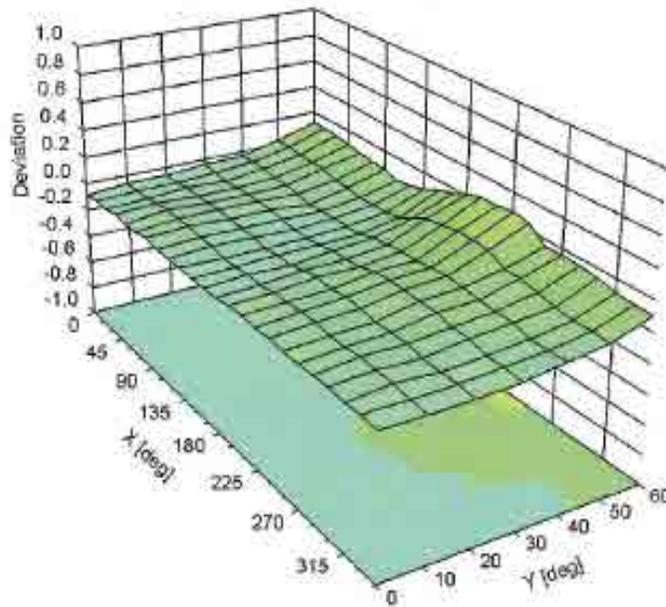

EX3DV4- SN:7364

June 23, 2015

DASY/EASY - Parameters of Probe: EX3DV4 - SN:7364

Other Probe Parameters

Sensor Arrangement	Triangular
Connector Angle (°)	132.1
Mechanical Surface Detection Mode	enabled
Optical Surface Detection Mode	disabled
Probe Overall Length	337 mm
Probe Body Diameter	10 mm
Tip Length	9 mm
Tip Diameter	2.5 mm
Probe Tip to Sensor X Calibration Point	1 mm
Probe Tip to Sensor Y Calibration Point	1 mm
Probe Tip to Sensor Z Calibration Point	1 mm
Recommended Measurement Distance from Surface	1.4 mm

Appendix C Dipole Calibration Certificates

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
C Service suisse d'étalonnage
S Servizio svizzero di taratura
S Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Client **Motorola Solutions MY**

Certificate No: **D450V3-1053_Mar15**

CALIBRATION CERTIFICATE

Object: **D450V3 - SN:1053**

Calibration procedure(s): **QA CAL-15.v8
Calibration procedure for dipole validation kits below 700 MHz**

Calibration date: **March 17, 2015**

This calibration certificate documents the traceability to national standards, which realize the physical units of measurements (SI).
The measurements and the uncertainties with confidence probability are given on the following pages and are part of the certificate.

All calibrations have been conducted in the closed laboratory facility: environment temperature (22 ± 3)°C and humidity < 70%.

Calibration Equipment used (M&TE critical for calibration)

Primary Standards	ID #	Cal Date (Certificate No.)	Scheduled Calibration
Power meter E4419B	GB41293874	03-Apr-14 (No. 217-01911)	Apr-15
Power sensor E4412A	MY41498267	03-Apr-14 (No. 217-01911)	Apr-15
Reference 3 dB Attenuator	SN: S5054 (3c)	03-Apr-14 (No. 217-01915)	Apr-15
Reference 20 dB Attenuator	SN: S5058 (20k)	03-Apr-14 (No. 217-01918)	Apr-15
Type-N mismatch combination	SN: 5047.2 / 06327	03-Apr-14 (No. 217-01921)	Apr-15
Reference Probe ET3DV8	SN: 1507	30-Dec-14 (No. ET3-1507_Dec14)	Dec-15
DAE4	SN: 654	30-Jun-14 (No. DAE4-654_Jun14)	Jun-15
Secondary Standards	ID #	Check Date (in house)	Scheduled Check
RF generator HP 8648C	US3642U01700	04-Aug-00 (in house check Apr-13)	In house check: Apr-16
Network Analyzer HP 8753E	US37390585 S4206	18-Oct-01 (in house check Oct-14)	In house check: Oct-16

Calibrated by: **Jeton Kasrati** (Name), **Laboratory Technician** (Function), *[Signature]* (Signature)

Approved by: **Katja Pokovic** (Name), **Technical Manager** (Function), *[Signature]* (Signature)

Issued: March 17, 2015

This calibration certificate shall not be reproduced except in full without written approval of the laboratory.

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
C Service suisse d'étalonnage
S Servizio svizzero di taratura
S Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Glossary:

TSL tissue simulating liquid
ConvF sensitivity in TSL / NORM x,y,z
N/A not applicable or not measured

Calibration is Performed According to the Following Standards:

- a) IEEE Std 1528-2013, "IEEE Recommended Practice for Determining the Peak Spatial-Averaged Specific Absorption Rate (SAR) in the Human Head from Wireless Communications Devices: Measurement Techniques", June 2013
- b) IEC 62209-1, "Procedure to measure the Specific Absorption Rate (SAR) for hand-held devices used in close proximity to the ear (frequency range of 300 MHz to 3 GHz)", February 2005
- c) KDB 865664, "SAR Measurement Requirements for 100 MHz to 6 GHz"

Additional Documentation:

- d) DASY4/5 System Handbook

Methods Applied and Interpretation of Parameters:

- *Measurement Conditions:* Further details are available from the Validation Report at the end of the certificate. All figures stated in the certificate are valid at the frequency indicated.
- *Antenna Parameters with TSL:* The dipole is mounted with the spacer to position its feed point exactly below the center marking of the flat phantom section, with the arms oriented parallel to the body axis.
- *Feed Point Impedance and Return Loss:* These parameters are measured with the dipole positioned under the liquid filled phantom. The impedance stated is transformed from the measurement at the SMA connector to the feed point. The Return Loss ensures low reflected power. No uncertainty required.
- *Electrical Delay:* One-way delay between the SMA connector and the antenna feed point. No uncertainty required.
- *SAR measured:* SAR measured at the stated antenna input power.
- *SAR normalized:* SAR as measured, normalized to an input power of 1 W at the antenna connector.
- *SAR for nominal TSL parameters:* The measured TSL parameters are used to calculate the nominal SAR result.

The reported uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor k=2, which for a normal distribution corresponds to a coverage probability of approximately 95%.

Measurement Conditions

DASY system configuration, as far as not given on page 1.

DASY Version	DASY5	V52.8.8
Extrapolation	Advanced Extrapolation	
Phantom	ELI4 Flat Phantom	Shell thickness: 2 ± 0.2 mm
Distance Dipole Center - TSL	15 mm	with Spacer
Zoom Scan Resolution	dx, dy, dz = 5 mm	
Frequency	450 MHz ± 1 MHz	

Head TSL parameters

The following parameters and calculations were applied.

	Temperature	Permittivity	Conductivity
Nominal Head TSL parameters	22.0 °C	43.5	0.87 mho/m
Measured Head TSL parameters	(22.0 ± 0.2) °C	43.9 ± 6 %	0.88 mho/m ± 6 %
Head TSL temperature change during test	< 0.5 °C	---	---

SAR result with Head TSL

SAR averaged over 1 cm ³ (1 g) of Head TSL	Condition	
SAR measured	250 W input power	1.12 W/kg
SAR for nominal Head TSL parameters	normalized to 1W	4.45 W/kg ± 18.1 % (k=2)

SAR averaged over 10 cm ³ (10 g) of Head TSL	condition	
SAR measured	250 W input power	0.747 W/kg
SAR for nominal Head TSL parameters	normalized to 1W	2.97 W/kg ± 17.6 % (k=2)

Body TSL parameters

The following parameters and calculations were applied.

	Temperature	Permittivity	Conductivity
Nominal Body TSL parameters	22.0 °C	56.7	0.94 mho/m
Measured Body TSL parameters	(22.0 ± 0.2) °C	56.7 ± 6 %	0.97 mho/m ± 6 %
Body TSL temperature change during test	< 0.5 °C	---	---

SAR result with Body TSL

SAR averaged over 1 cm ³ (1 g) of Body TSL	Condition	
SAR measured	250 W input power	1.13 W/kg
SAR for nominal Body TSL parameters	normalized to 1W	4.41 W/kg ± 18.1 % (k=2)

SAR averaged over 10 cm ³ (10 g) of Body TSL	condition	
SAR measured	250 W input power	0.746 W/kg
SAR for nominal Body TSL parameters	normalized to 1W	2.92 W/kg ± 17.6 % (k=2)

Appendix (Additional assessments outside the scope of SCS 0108)

Antenna Parameters with Head TSL

Impedance, transformed to feed point	57.2 Ω - 2.2 jΩ
Return Loss	- 23.1 dB

Antenna Parameters with Body TSL

Impedance, transformed to feed point	55.2 Ω - 5.3 jΩ
Return Loss	- 23.0 dB

General Antenna Parameters and Design

Electrical Delay (one direction)	1,350 ns
----------------------------------	----------

After long term use with 100W radiated power, only a slight warming of the dipole near the feedpoint can be measured.

The dipole is made of standard semirigid coaxial cable. The center conductor of the feeding line is directly connected to the second arm of the dipole. The antenna is therefore short-circuited for DC-signals. On some of the dipoles, small end caps are added to the dipole arms in order to improve matching when loaded according to the position as explained in the "Measurement Conditions" paragraph. The SAR data are not affected by this change. The overall dipole length is still according to the Standard.

No excessive force must be applied to the dipole arms, because they might bend or the soldered connections near the feedpoint may be damaged.

Additional EUT Data

Manufactured by	SPEAG
Manufactured on	December 16, 2005

DASY5 Validation Report for Head TSL

Date: 17.03.2015

Test Laboratory: SPEAG, Zurich, Switzerland

DUT: Dipole 450 MHz; Type: D450V3; Serial: D450V3 - SN:1053

Communication System: UID 0 - CW; Frequency: 450 MHz
 Medium parameters used: $f = 450 \text{ MHz}$; $\sigma = 0.88 \text{ S/m}$; $\epsilon_r = 43.9$; $\rho = 1000 \text{ kg/m}^3$
 Phantom section: Flat Section
 Measurement Standard: DASY5 (IEEE/IEC/ANSI C63.19-2011)

DASY52 Configuration:


- Probe: ET3DV6 - SN1507; ConvF(6.58, 6.58, 6.58); Calibrated: 30.12.2014;
- Sensor-Surface: 4mm (Mechanical Surface Detection)
- Electronics: DAE4 Sn654; Calibrated: 30.06.2014
- Phantom: ELI v4.0; Type: QDOVA001BB; Serial: TP:1003
- DASY52 52.8.8(1222); SEMCAD X 14.6.10(7331)

Dipole Calibration for Head Tissue/d=15mm, Pin=250mW/Zoom Scan (7x7x7)/Cube 0:

Measurement grid: $dx=5\text{mm}$, $dy=5\text{mm}$, $dz=5\text{mm}$
 Reference Value = 38.88 V/m; Power Drift = 0.03 dB
 Peak SAR (extrapolated) = 1.61 W/kg
SAR(1 g) = 1.12 W/kg; SAR(10 g) = 0.747 W/kg
 Maximum value of SAR (measured) = 1.20 W/kg



Impedance Measurement Plot for Head TSL

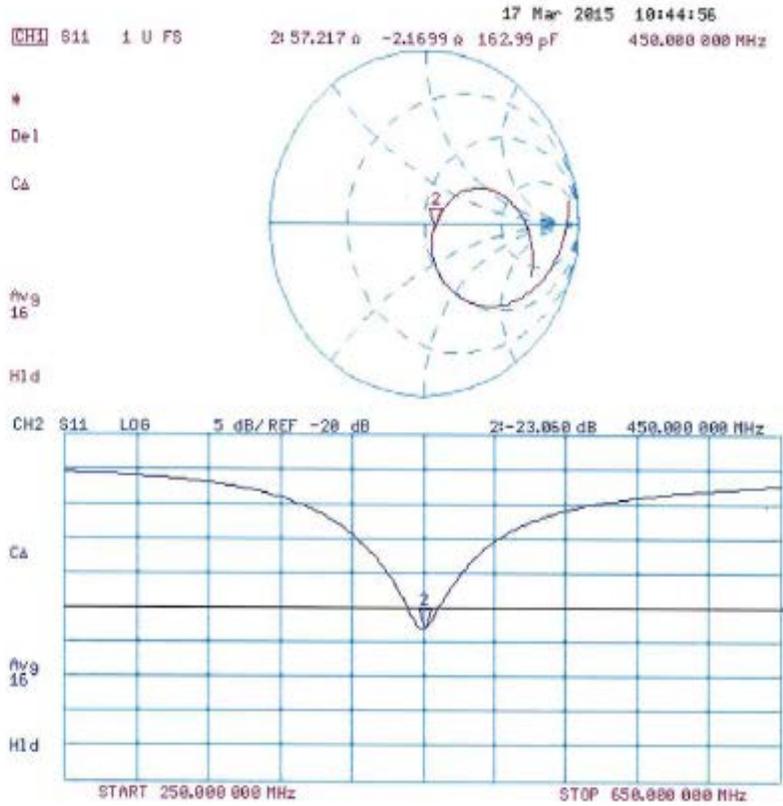

DASY5 Validation Report for Body TSL

Date: 17.03.2015

Test Laboratory: SPEAG, Zurich, Switzerland

DUT: Dipole 450 MHz; Type: D450V3; Serial: D450V3 - SN:1053

Communication System: UID 0 - CW; Frequency: 450 MHz

Medium parameters used: $f = 450 \text{ MHz}$; $\sigma = 0.97 \text{ S/m}$; $\epsilon_r = 56.7$; $\rho = 1000 \text{ kg/m}^3$

Phantom section: Flat Section

Measurement Standard: DASY5 (IEEE/IEC/ANSI C63.19-2011)

DASY52 Configuration:

- Probe: ET3DV6 - SN1507; ConvF(7.05, 7.05, 7.05); Calibrated: 30.12.2014;
- Sensor-Surface: 4mm (Mechanical Surface Detection)
- Electronics: DAE4 Sn654; Calibrated: 30.06.2014
- Phantom: ELI v4.0; Type: QDOVA001BB; Serial: TP:1003
- DASY52 52.8.8(1222); SEMCAD X 14.6.10(7331)

Dipole Calibration for Body Tissue/d=15mm, Pin=250mW/Zoom Scan (7x7x7)/Cube 0:

Measurement grid: dx=5mm, dy=5mm, dz=5mm

Reference Value = 36.35 V/m; Power Drift = -0.01 dB

Peak SAR (extrapolated) = 1.81 W/kg


SAR(1 g) = 1.13 W/kg; SAR(10 g) = 0.746 W/kg

Maximum value of SAR (measured) = 1.21 W/kg



0 dB = 1.21 W/kg = 0.83 dBW/kg

Impedance Measurement Plot for Body TSL

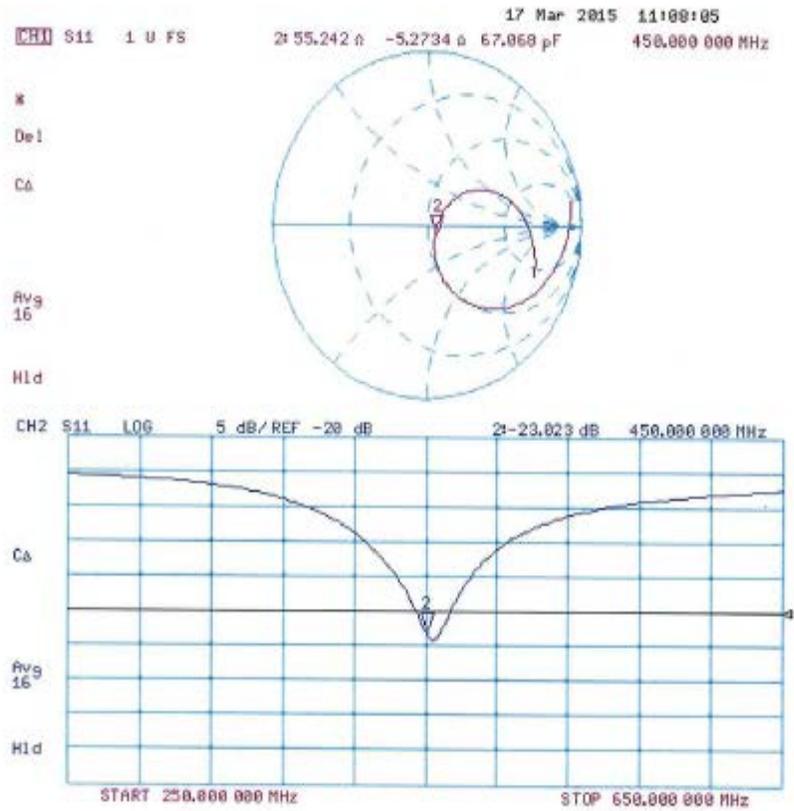

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
C Service suisse d'étalonnage
S Servizio svizzero di taratura
S Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Client **Motorola Solutions MY**

Certificate No: **D2450V2-781_Mar15**

CALIBRATION CERTIFICATE

Object: **D2450V2 - SN:781**

Calibration procedure(s): **QA CAL-05.v9
Calibration procedure for dipole validation kits above 700 MHz**

Calibration date: **March 20, 2015**

This calibration certificate documents the traceability to national standards, which realize the physical units of measurements (SI).
The measurements and the uncertainties with confidence probability are given on the following pages and are part of the certificate.

All calibrations have been conducted in the closed laboratory facility: environment temperature (22 ± 3)°C and humidity < 70%.

Calibration Equipment used (M&TE critical for calibration)

Primary Standards	ID #	Cal Date (Certificate No.)	Scheduled Calibration
Power meter EPM-442A	GB37480704	07-Oct-14 (No. 217-02020)	Oct-15
Power sensor HP 8481A	US37292783	07-Oct-14 (No. 217-02020)	Oct-15
Power sensor HP 8481A	MY41892317	07-Oct-14 (No. 217-02021)	Oct-15
Reference 20 dB Attenuator	SN: 5058 (20k)	03-Apr-14 (No. 217-01918)	Apr-15
Type-N mismatch combination	SN: 5047.2 / 06327	03-Apr-14 (No. 217-01921)	Apr-15
Reference Probe ES3DV3	SN: 3205	30-Dec-14 (No. ES3-3205_Dec14)	Dec-15
DAE4	SN: 601	18-Aug-14 (No. DAE4-601_Aug14)	Aug-15
Secondary Standards	ID #	Check Date (in house)	Scheduled Check
RF generator R&S SMT-06	100005	04-Aug-09 (in house check Oct-13)	In house check: Oct-16
Network Analyzer HP 8753E	US37390685 S4206	18-Oct-01 (in house check Oct-14)	In house check: Oct-15

Calibrated by: **Israël Elneouq** (Name) / **Laboratory Technician** (Function) / *Israël Elneouq* (Signature)

Approved by: **Katja Pokovic** (Name) / **Technical Manager** (Function) / *Katja Pokovic* (Signature)

Issued: March 20, 2015

This calibration certificate shall not be reproduced except in full without written approval of the laboratory.

**Calibration Laboratory of
Schmid & Partner
Engineering AG**
Zeughausstrasse 43, 8004 Zurich, Switzerland



S Schweizerischer Kalibrierdienst
S Service suisse d'étalonnage
C Servizio svizzero di taratura
S Swiss Calibration Service

Accredited by the Swiss Accreditation Service (SAS)
The Swiss Accreditation Service is one of the signatories to the EA
Multilateral Agreement for the recognition of calibration certificates

Accreditation No.: **SCS 0108**

Glossary:

TSL tissue simulating liquid
ConvF sensitivity in TSL / NORM x,y,z
N/A not applicable or not measured

Calibration is Performed According to the Following Standards:

- a) IEEE Std 1528-2013, "IEEE Recommended Practice for Determining the Peak Spatial-Averaged Specific Absorption Rate (SAR) in the Human Head from Wireless Communications Devices: Measurement Techniques", June 2013
- b) IEC 62209-1, "Procedure to measure the Specific Absorption Rate (SAR) for hand-held devices used in close proximity to the ear (frequency range of 300 MHz to 3 GHz)", February 2005
- c) KDB 865664, "SAR Measurement Requirements for 100 MHz to 6 GHz"

Additional Documentation:

- d) DASY4/5 System Handbook

Methods Applied and Interpretation of Parameters:

- *Measurement Conditions:* Further details are available from the Validation Report at the end of the certificate. All figures stated in the certificate are valid at the frequency indicated.
- *Antenna Parameters with TSL:* The dipole is mounted with the spacer to position its feed point exactly below the center marking of the flat phantom section, with the arms oriented parallel to the body axis.
- *Feed Point Impedance and Return Loss:* These parameters are measured with the dipole positioned under the liquid filled phantom. The impedance stated is transformed from the measurement at the SMA connector to the feed point. The Return Loss ensures low reflected power. No uncertainty required.
- *Electrical Delay:* One-way delay between the SMA connector and the antenna feed point. No uncertainty required.
- *SAR measured:* SAR measured at the stated antenna input power.
- *SAR normalized:* SAR as measured, normalized to an input power of 1 W at the antenna connector.
- *SAR for nominal TSL parameters:* The measured TSL parameters are used to calculate the nominal SAR result.

The reported uncertainty of measurement is stated as the standard uncertainty of measurement multiplied by the coverage factor k=2, which for a normal distribution corresponds to a coverage probability of approximately 95%.

Measurement Conditions

DASY system configuration, as far as not given on page 1.

DASY Version	DASY5	V52.8.8
Extrapolation	Advanced Extrapolation	
Phantom	Modular Flat Phantom	
Distance Dipole Center - TSL	10 mm	with Spacer
Zoom Scan Resolution	dx, dy, dz = 5 mm	
Frequency	2450 MHz ± 1 MHz	

Head TSL parameters

The following parameters and calculations were applied:

	Temperature	Permittivity	Conductivity
Nominal Head TSL parameters	22.0 °C	39.2	1.80 mho/m
Measured Head TSL parameters	(22.0 ± 0.2) °C	37.8 ± 6 %	1.83 mho/m ± 6 %
Head TSL temperature change during test	< 0.5 °C	----	----

SAR result with Head TSL

SAR averaged over 1 cm ³ (1 g) of Head TSL	Condition	
SAR measured	250 mW input power	13.3 W/kg
SAR for nominal Head TSL parameters	normalized to 1W	52.3 W/kg ± 17.0 % (k=2)

SAR averaged over 10 cm ³ (10 g) of Head TSL	condition	
SAR measured	250 mW input power	6.16 W/kg
SAR for nominal Head TSL parameters	normalized to 1W	24.4 W/kg ± 16.5 % (k=2)

Body TSL parameters

The following parameters and calculations were applied:

	Temperature	Permittivity	Conductivity
Nominal Body TSL parameters	22.0 °C	52.7	1.95 mho/m
Measured Body TSL parameters	(22.0 ± 0.2) °C	50.8 ± 6 %	2.02 mho/m ± 6 %
Body TSL temperature change during test	< 0.5 °C	----	----

SAR result with Body TSL

SAR averaged over 1 cm ³ (1 g) of Body TSL	Condition	
SAR measured	250 mW input power	13.3 W/kg
SAR for nominal Body TSL parameters	normalized to 1W	51.9 W/kg ± 17.0 % (k=2)

SAR averaged over 10 cm ³ (10 g) of Body TSL	condition	
SAR measured	250 mW input power	6.15 W/kg
SAR for nominal Body TSL parameters	normalized to 1W	24.2 W/kg ± 16.5 % (k=2)

Appendix (Additional assessments outside the scope of SCS 0108)

Antenna Parameters with Head TSL

Impedance, transformed to feed point	53.9 Ω + 1.2 jΩ
Return Loss	-29.2 dB

Antenna Parameters with Body TSL

Impedance, transformed to feed point	49.9 Ω + 3.2 jΩ
Return Loss	-30.0 dB

General Antenna Parameters and Design

Electrical Delay (one direction)	1.155 ns
----------------------------------	----------

After long term use with 100W radiated power, only a slight warming of the dipole near the feedpoint can be measured.

The dipole is made of standard semirigid coaxial cable. The center conductor of the feeding line is directly connected to the second arm of the dipole. The antenna is therefore short-circuited for DC-signals. On some of the dipoles, small end caps are added to the dipole arms in order to improve matching when loaded according to the position as explained in the "Measurement Conditions" paragraph. The SAR data are not affected by this change. The overall dipole length is still according to the Standard.

No excessive force must be applied to the dipole arms, because they might bend or the soldered connections near the feedpoint may be damaged.

Additional EUT Data

Manufactured by	SPEAG
Manufactured on	May 06, 2005

DASY5 Validation Report for Head TSL

Date: 20.03.2015

Test Laboratory: SPEAG, Zurich, Switzerland

DUT: Dipole 2450 MHz; Type: D2450V2; Serial: D2450V2 - SN:781

Communication System: UID 0 - CW; Frequency: 2450 MHz

Medium parameters used: $f = 2450$ MHz; $\sigma = 1.83$ S/m; $\epsilon_r = 37.8$; $\rho = 1000$ kg/m³

Phantom section: Flat Section

Measurement Standard: DASY5 (IEEE/IEC/ANSI C63.19-2011)

DASY52 Configuration:

- Probe: ES3DV3 - SN3205; ConvF(4.54, 4.54, 4.54); Calibrated: 30.12.2014;
- Sensor-Surface: 3mm (Mechanical Surface Detection)
- Electronics: DAE4 Sn601; Calibrated: 18.08.2014
- Phantom: Flat Phantom 5.0 (front); Type: QD000P50AA; Serial: 1001
- DASY52 52.8.8(1222); SEMCAD X 14.6.10(7331)

Dipole Calibration for Head Tissue/Pin=250 mW, d=10mm/Zoom Scan (7x7x7)/Cube 0:


Measurement grid: dx=5mm, dy=5mm, dz=5mm

Reference Value = 101.2 V/m; Power Drift = 0.01 dB

Peak SAR (extrapolated) = 27.9 W/kg


SAR(1 g) = 13.3 W/kg; SAR(10 g) = 6.16 W/kg

Maximum value of SAR (measured) = 17.4 W/kg

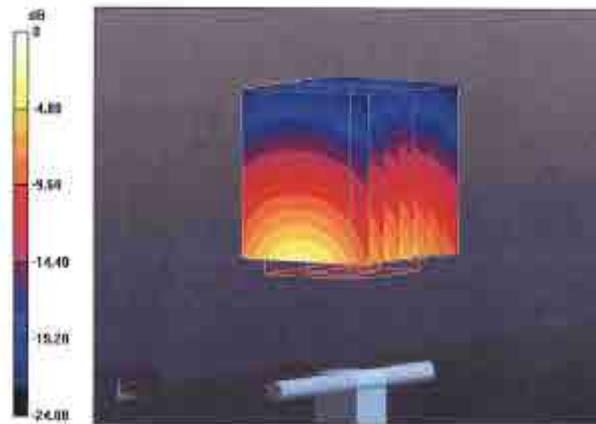

0 dB = 17.4 W/kg = 12.41 dBW/kg

Impedance Measurement Plot for Head TSL

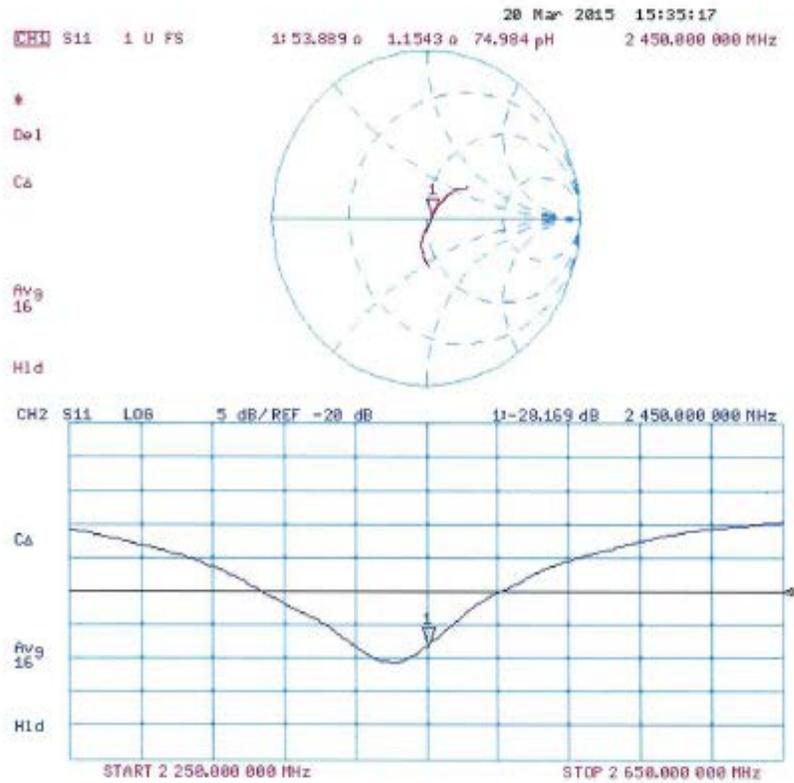

DASY5 Validation Report for Body TSL

Date: 19.03.2015

Test Laboratory: SPEAG, Zurich, Switzerland

DUT: Dipole 2450 MHz; Type: D2450V2; Serial: D2450V2 - SN:781


Communication System: UID 0 - CW; Frequency: 2450 MHz
 Medium parameters used: $f = 2450$ MHz; $\sigma = 2.02$ S/m; $\epsilon_r = 50.8$; $\rho = 1000$ kg/m³
 Phantom section: Flat Section
 Measurement Standard: DASY5 (IEEE/IEC/ANSI C63.19-2011)

DASY52 Configuration:


- Probe: ES3DV3 - SN3205; ConvF(4.32, 4.32, 4.32); Calibrated: 30.12.2014;
- Sensor-Surface: 3mm (Mechanical Surface Detection)
- Electronics: DAE4 Sn601; Calibrated: 18.08.2014
- Phantom: Flat Phantom 5.0 (back); Type: QD000P50AA; Serial: 1002
- DASY52 52.8.8(1222); SEMCAD X 14.6.10(7331)

Dipole Calibration for Body Tissue/Pin=250 mW, d=10mm/Zoom Scan (7x7x7)/Cube 0:

Measurement grid: dx=5mm, dy=5mm, dz=5mm
 Reference Value = 95.66 V/m; Power Drift = 0.03 dB
 Peak SAR (extrapolated) = 28.0 W/kg
SAR(1 g) = 13.3 W/kg; SAR(10 g) = 6.15 W/kg
 Maximum value of SAR (measured) = 17.4 W/kg

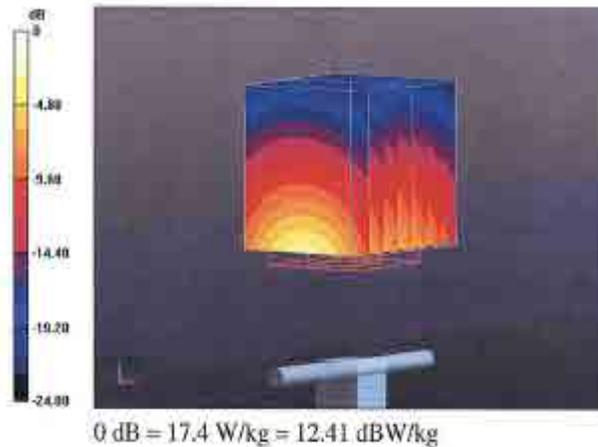

Impedance Measurement Plot for Body TSL

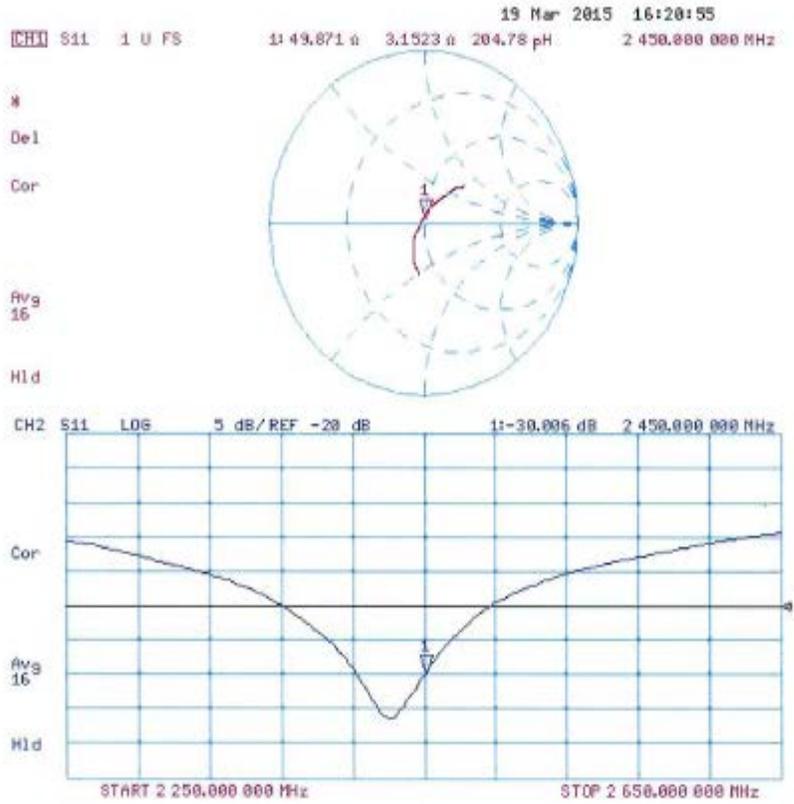

Dipole Data

As stated in KDB 865664, only dipoles used for longer calibration intervals required to provide supporting information and measurement to qualify for extended calibration interval.

Dipole D450V3 (serial number 1053) and D2450V2 (serial number 781) not exceed annual calibration date, hence no further justification required.