

Mode = TX

Report No.: 9808464

Tested By: Hong, Report No.: 9808464


Scan Settings (1 Range)

Frequencies			Receiver Settings					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	OpRge
450k	30M	5k	10k	PK	20ms	AUTO	LN OFF	60dB

Final Measurement: x QP

Transducer No.	Start	Stop	Name
3	9k	30M	EI078

Meas Time: 1 s
Subranges: 16
Acc Margin: 20dB

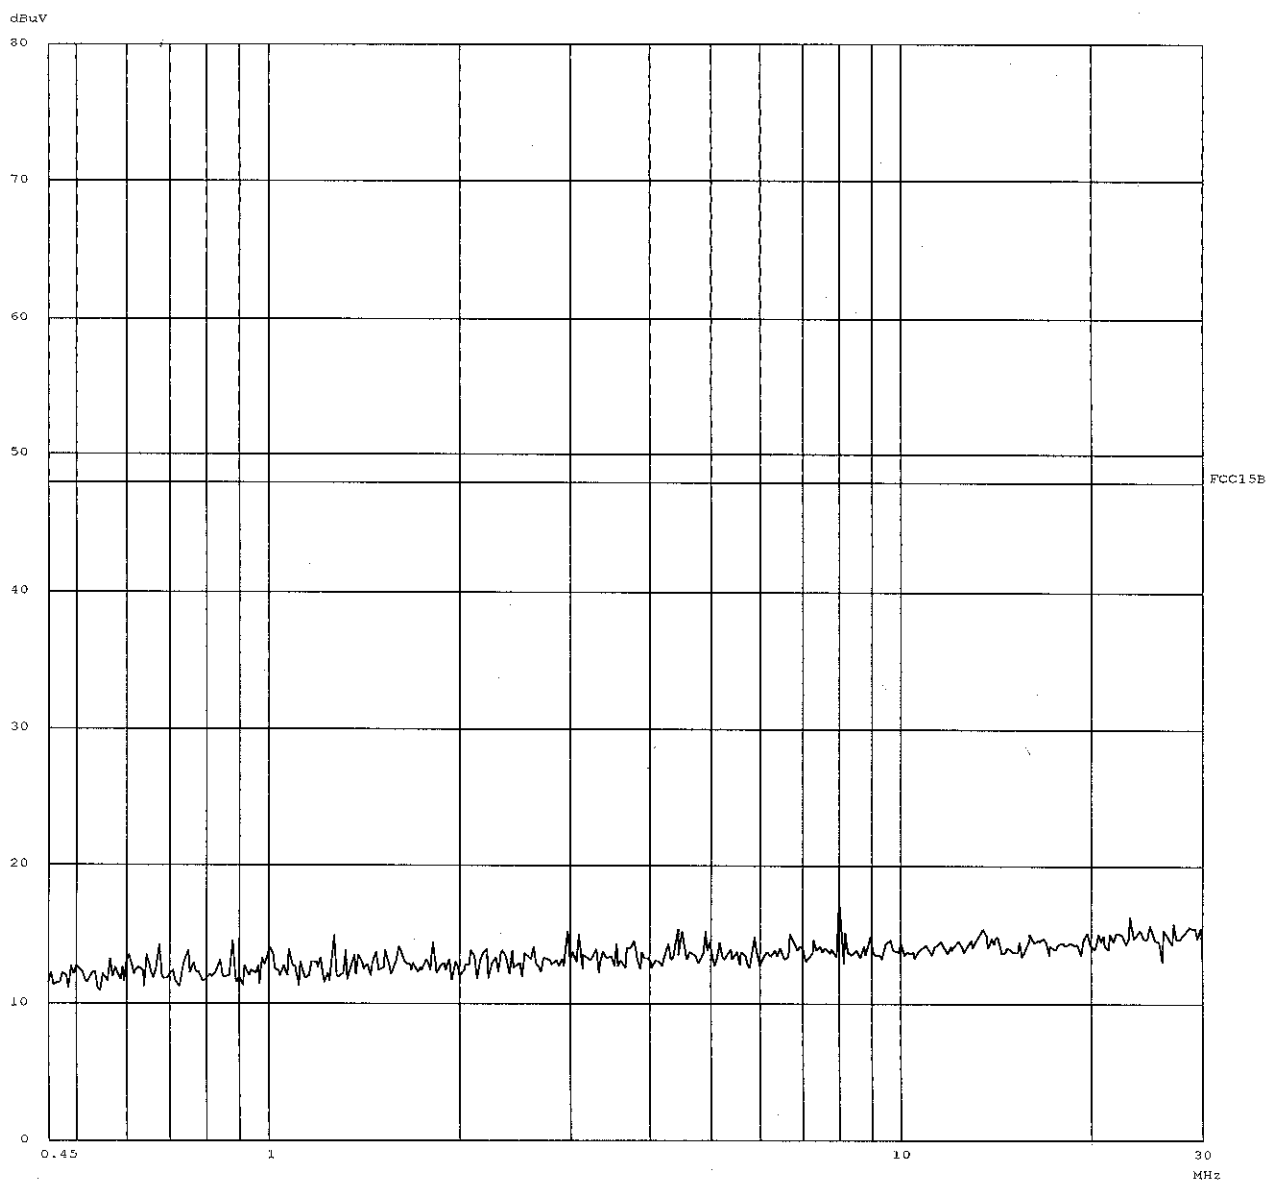

Ctrl. No.: N/A

Mode: TX

Report No.: 9808464

Tested By: Hong, Report No.: 9808464

Scan Settings (1 Range)

Frequencies			Receiver Settings					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	OpRge
450k	30M	5k	10k	PK	20ms	AUTO	LN OFF	60dB

Final Measurement Results:

no Results

Ctrl. No.: N/A

Mode = Charging

Report No.: 9808464

Tested By: Hong, Report No.: 9808464


Scan Settings (1 Range)

Frequencies		Receiver Settings						
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	OpRge
450k	30M	5k	10k	PK	20ms	AUTO	LN OFF	60dB

Final Measurement: x QP

Meas Time: 1 s
Subranges: 16
Acc Margin: 20dB

Transducer No.	Start	Stop	Name
3	9k	30M	EI078

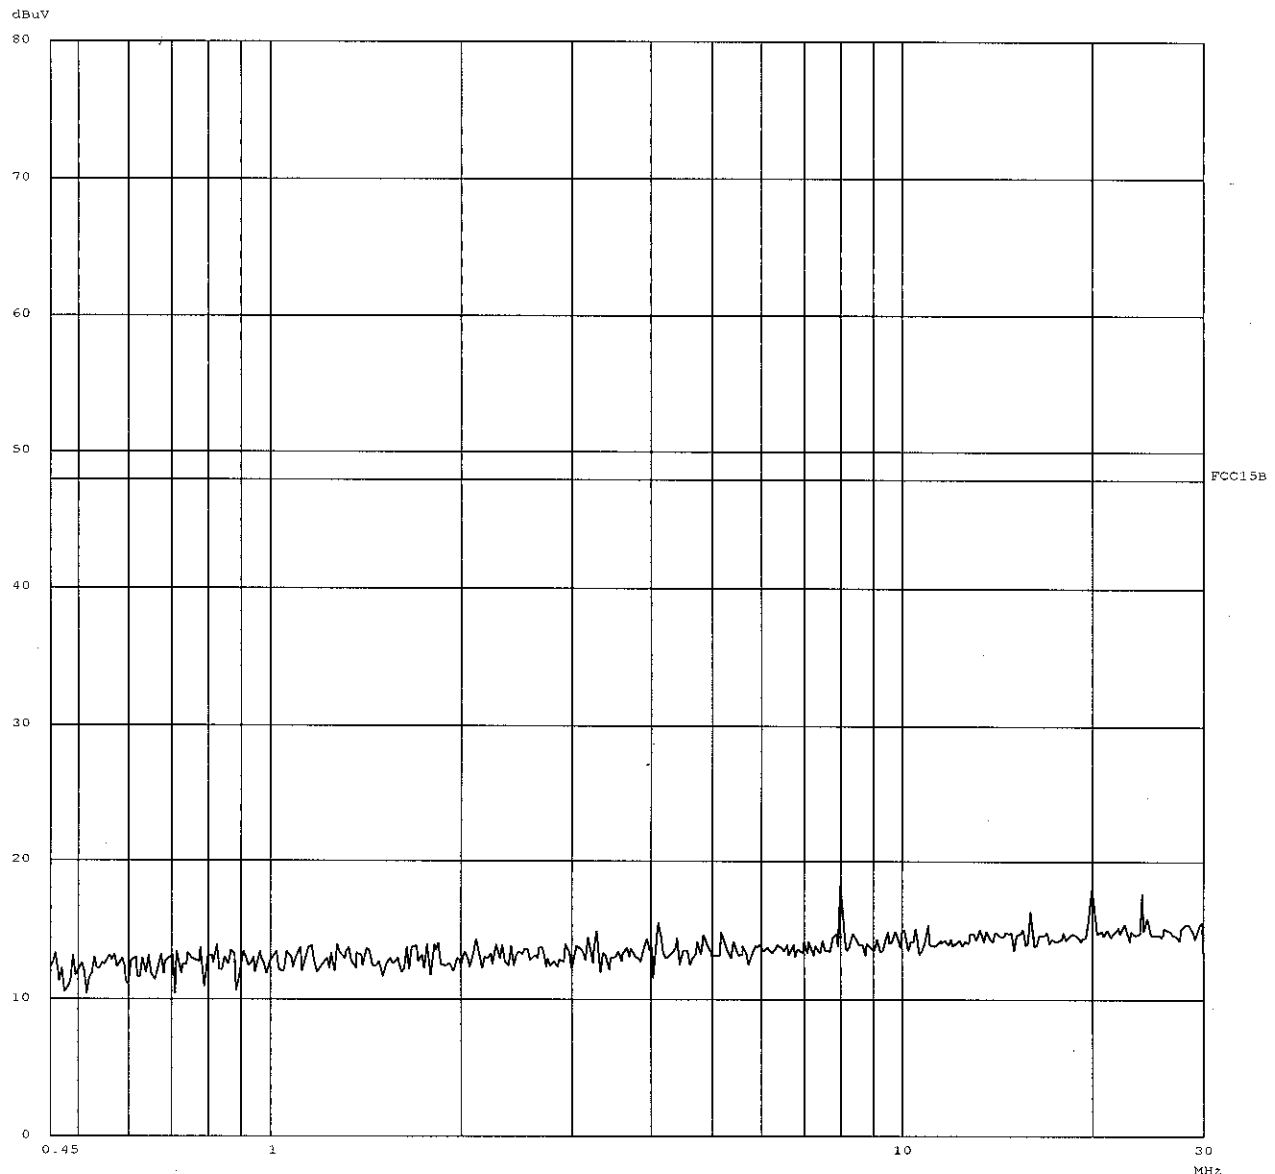

Mode: Charging

Report No.: 9808464

Tested By: Hong, Report No.: 9808464

Scan Settings (1 Range)

----- Frequencies -----			----- Receiver Settings -----					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	OpRge
450k	30M	5k	10k	PK	20ms	AUTO	LN OFF	60dB

Final Measurement Results:

no Results

Ctrl. No.: N/A


Mode = Stand by

Report No.: 9808464

Tested By: Hong, Report No.: 9808464
Scan Settings (1 Range)

Frequencies			Receiver Settings						
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	OpRge	
450k	30M	5k	10k	PK	20ms	AUTO	LN	OFF 60dB	

Final Measurement: x QP		Transducer No.	Start	Stop	Name
Meas Time:	1 s	3	9k	30M	EI078
Subranges:	16				
Acc Margin:	20dB				

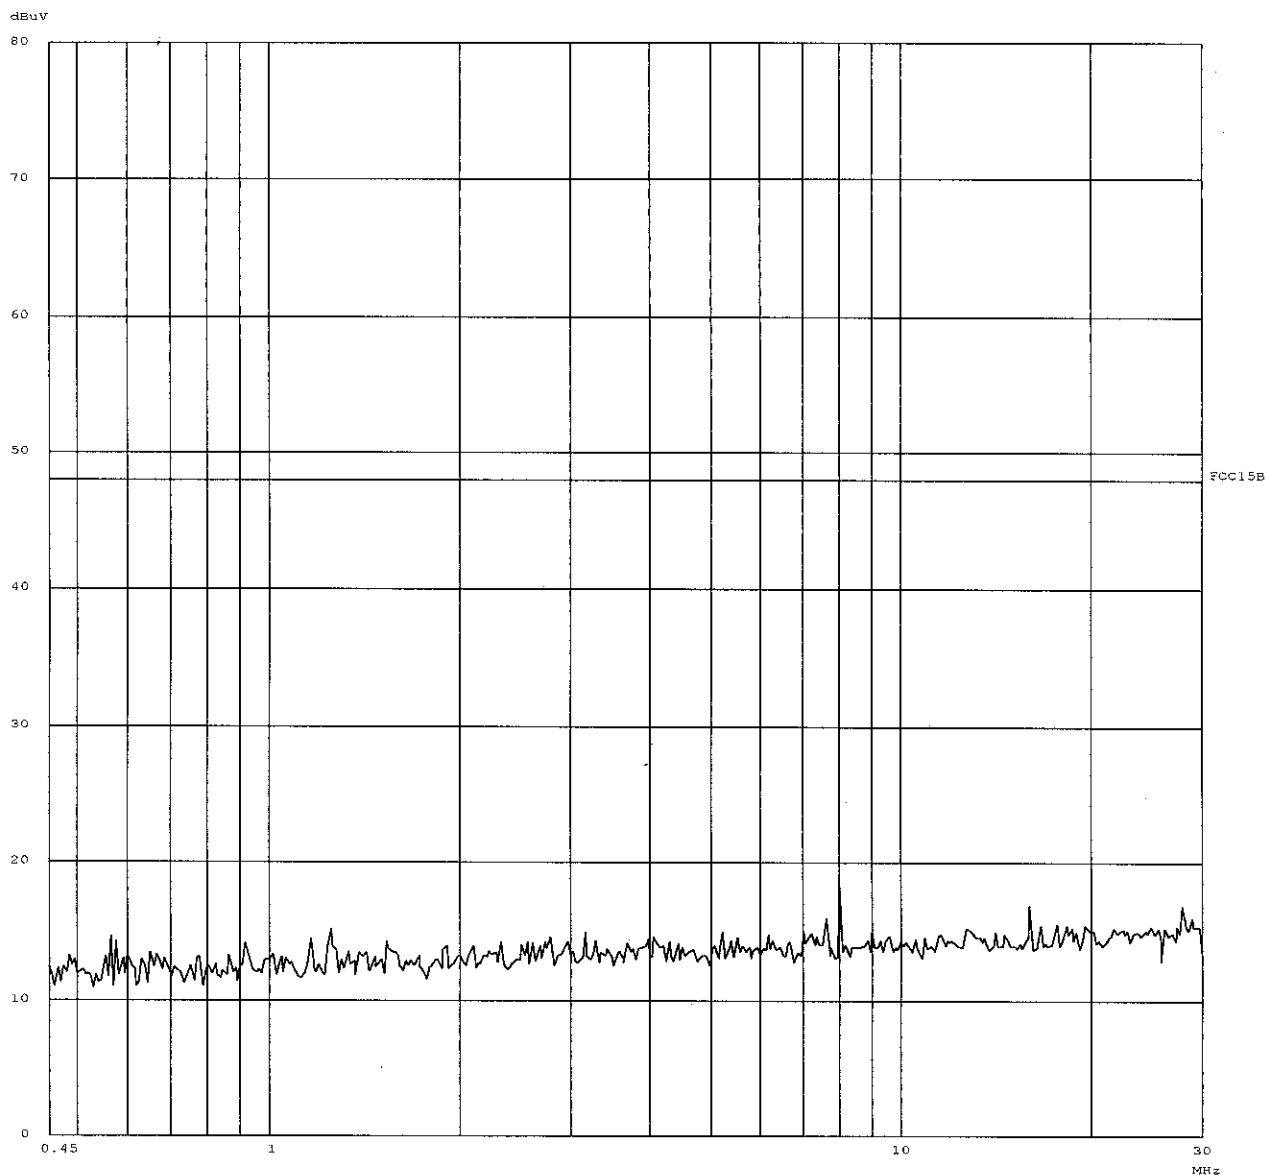

Mode = Stand by

Report No.: 9808464

Tested By: Hong, Report No.: 9808464

Scan Settings (1 Range)

----- Frequencies -----			----- Receiver Settings -----					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	OpRge
450k	30M	5k	10k	PK	20ms	AUTO	LN OFF	60dB

Final Measurement Results:

no Results

Ctrl. No.: N/A