

TIME OF ONE SMALL PULSE  
REF 110.0 dB $\mu$ V ATTEN 20 dB

MKR  $\Delta$  460.0  $\mu$ sec  
-0.20 dB

hp

10 dB/


DL  
70.0  
dB $\mu$ V

CORR'D

CENTER 433.692 001 MHz  
RES BW 3 MHz

VBW 3 MHz

SPAN 0 Hz  
SWP 20.0 msec

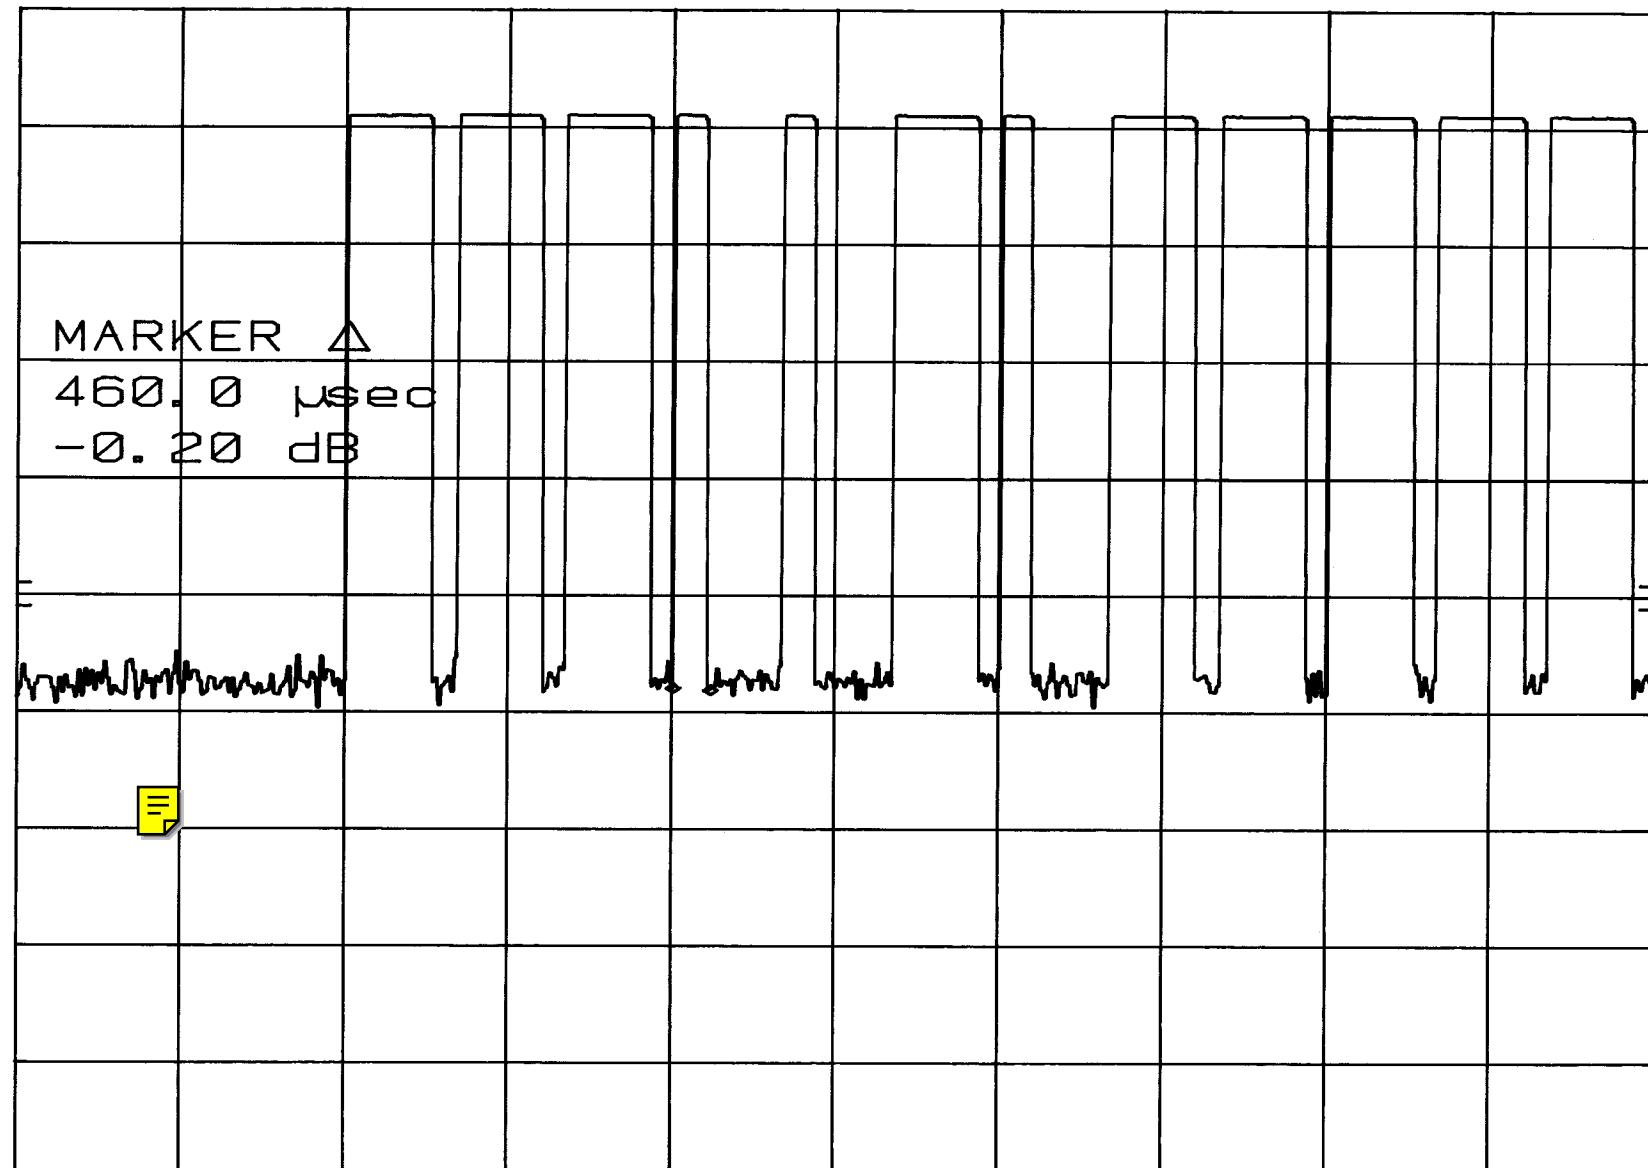

TIME OF ONE LARGE PULSE  
REF 110.0 dB $\mu$ V ATTEN 20 dB

MKR  $\Delta$  1.100 msec  
-0.40 dB

HP

10 dB/


DL  
70.0  
dB $\mu$ V

CORR'D

CENTER 433.692 001 MHz  
RES BW 3 MHz

VBW 3 MHz

SPAN 0 Hz  
SWP 20.0 msec

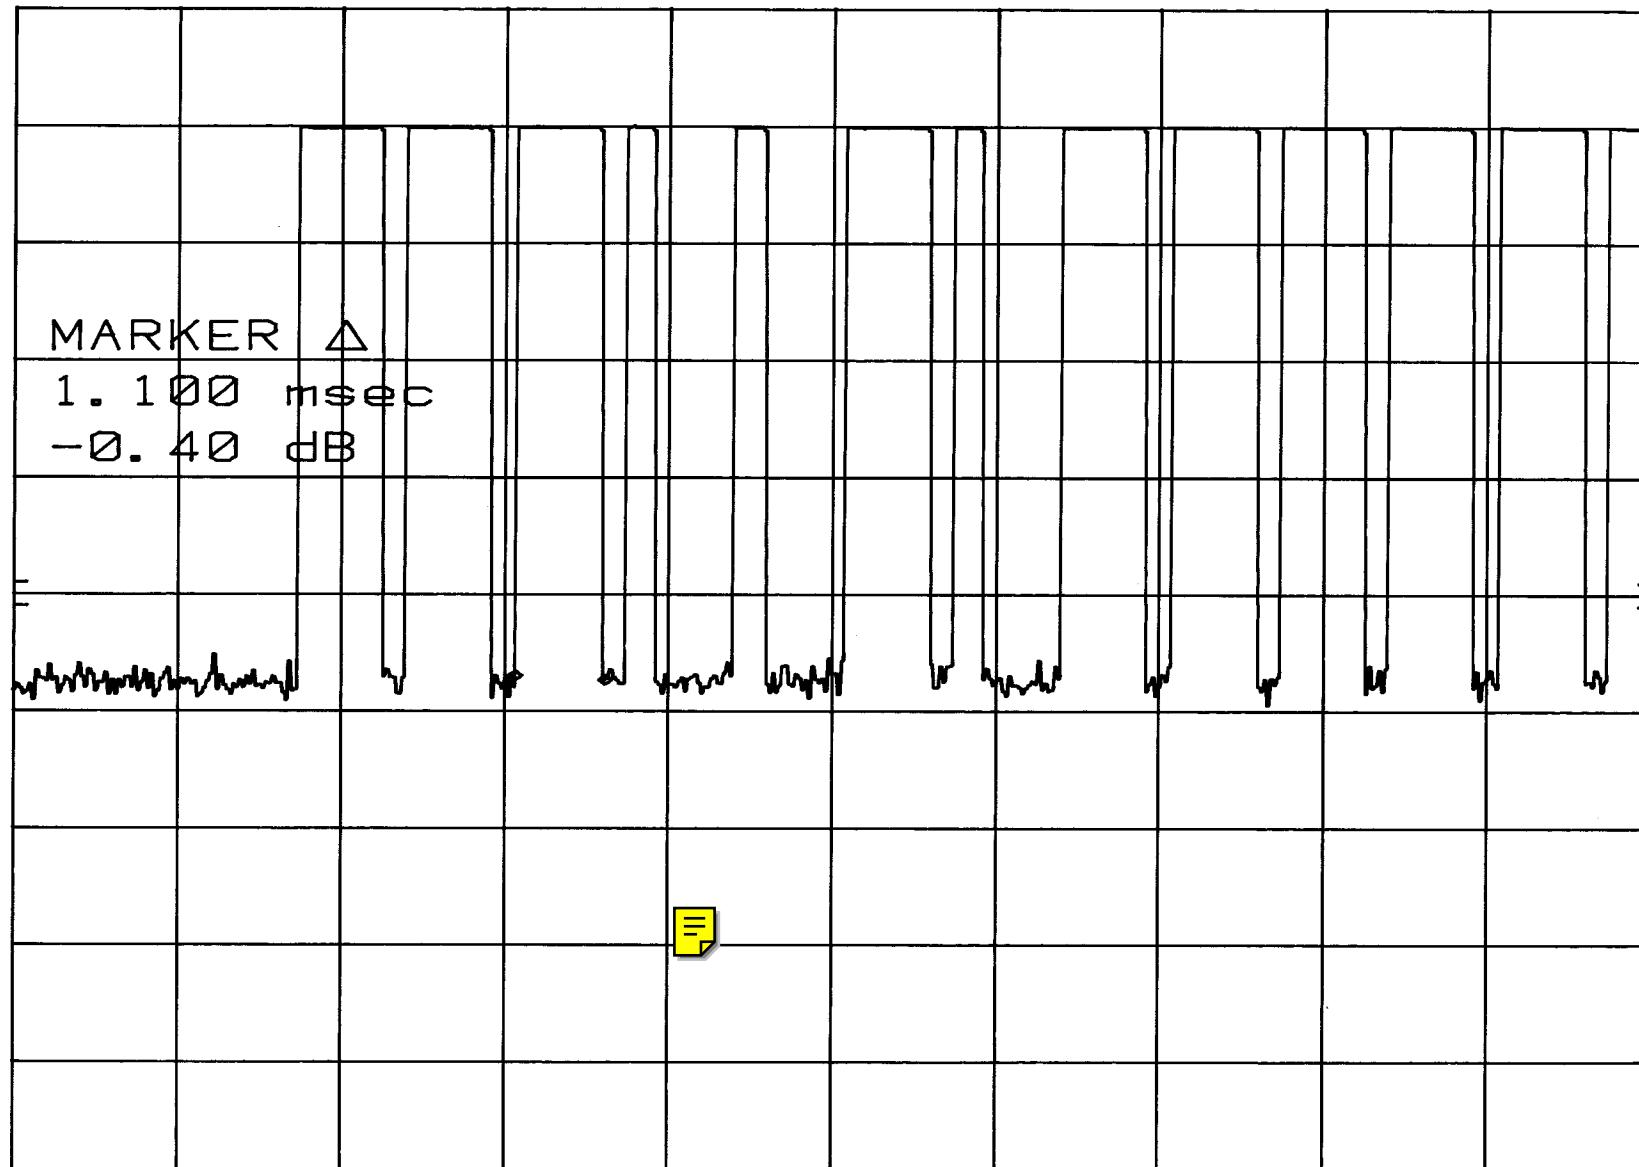

NUMBER OF PULSES

REF 100.0 dB $\mu$ V ATTEN 10 dB

MKR  $\Delta$  32.50 msec

48.00 dB

HP

10 dB/


DL  
60.0  
dB $\mu$ V

CORR'D

CENTER 433.692 001 MHz  
RES BW 3 MHz

VBW 3 MHz

SPAN 0 Hz  
SWP 50.0 msec

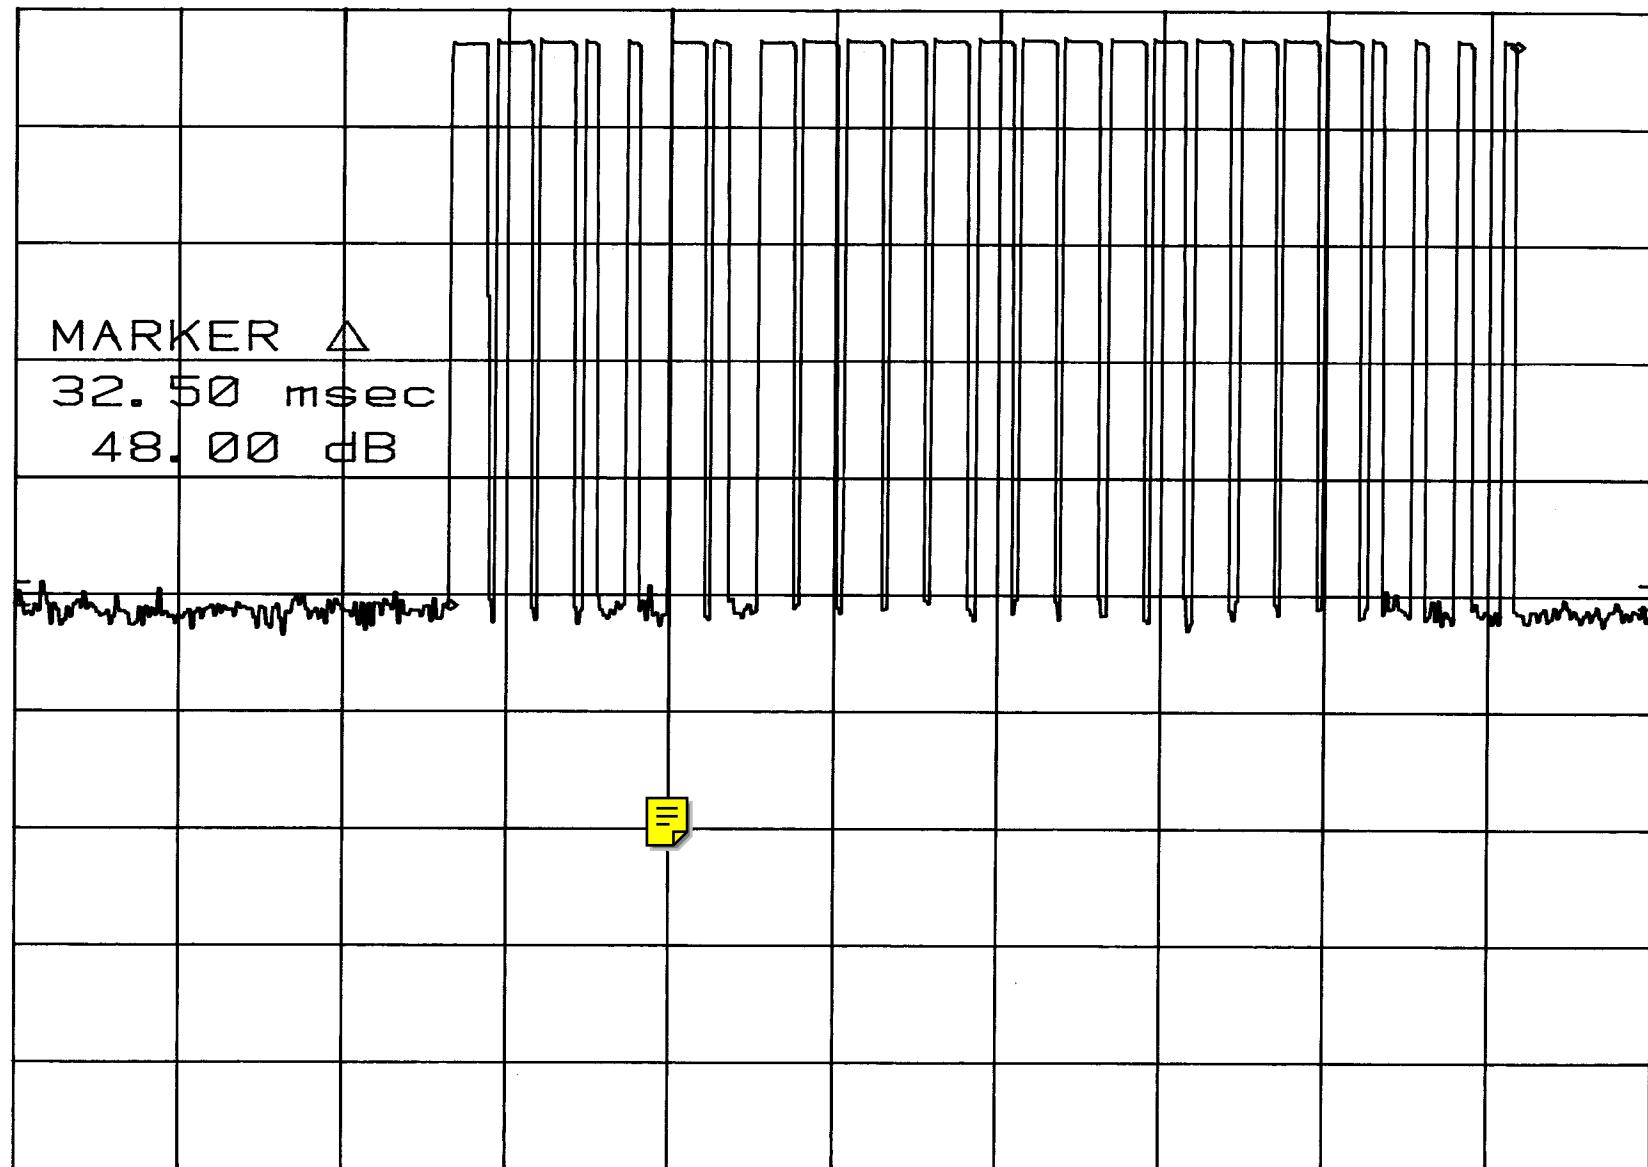

TRAINs



NUMBER OF PULSES IN 100 ms

HP

REF 100.0 dB  $\mu$ V ATTEN 10 dB

MKR  $\Delta$  32.50 msec

46.60 dB

10 dB/

DL  
60.0  
dB  $\mu$ V

MARKER

32.50 msec  
46.60 dB

CORR'D

CENTER 433.692 001 MHz  
RES BW 1 MHz

VBW 1 MHz

SPAN 0 Hz

SWP 100 msec

F