

# **Contents**

10.APPENDIX.....	171
10.1 Photographs of Test Setup.....	171
10.2 Photographs of the EUT .....	177

# 10.APPENDIX

## 10.1 Photographs of Test Setup

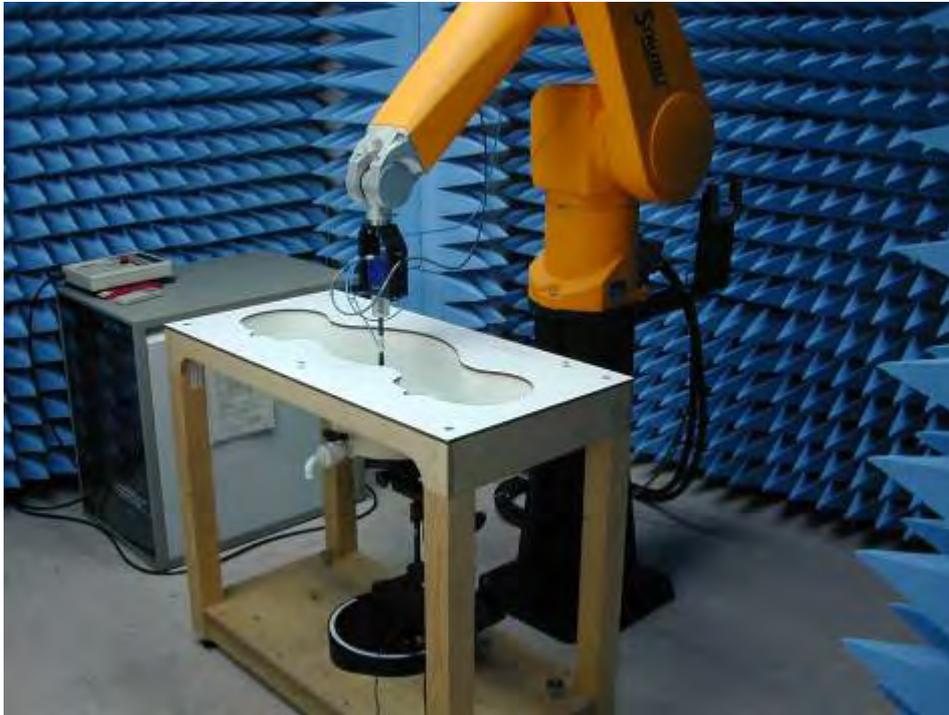


Fig.1 Photograph of the SAR measurement System

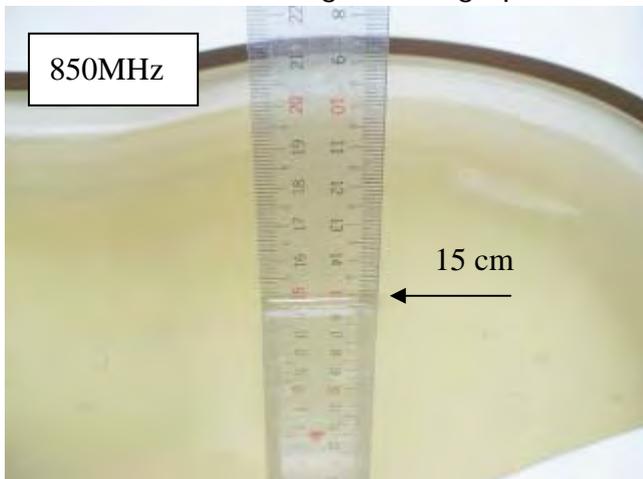


Fig.2.1 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Left-head Side

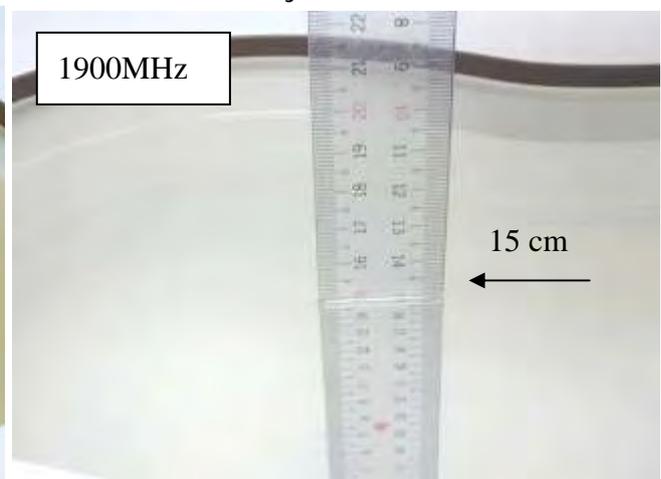


Fig.2.2 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Right-head Side

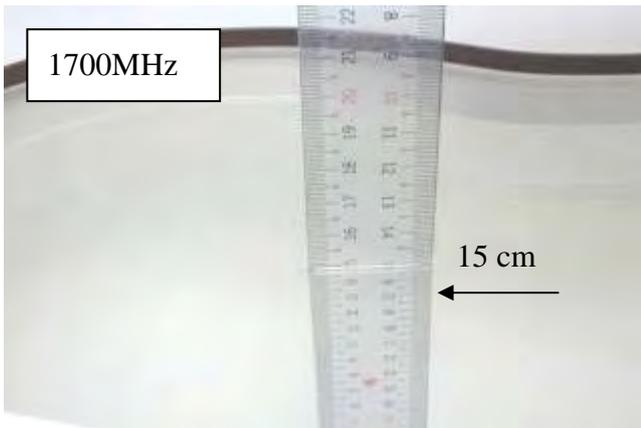


Fig.2.3 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Right-head Side



Fig.2.4 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Flat (Body)

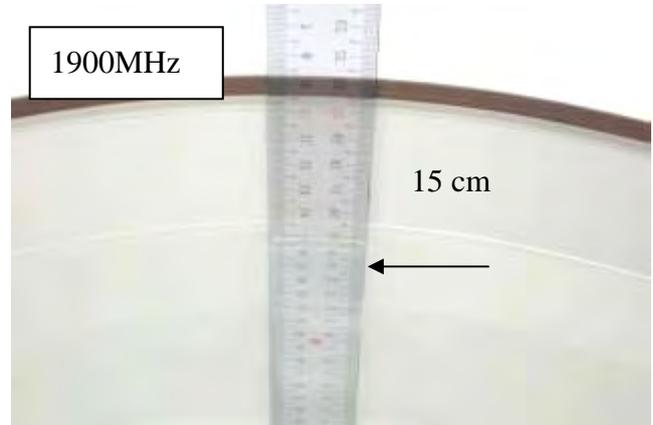


Fig.2.5 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Flat (Body)

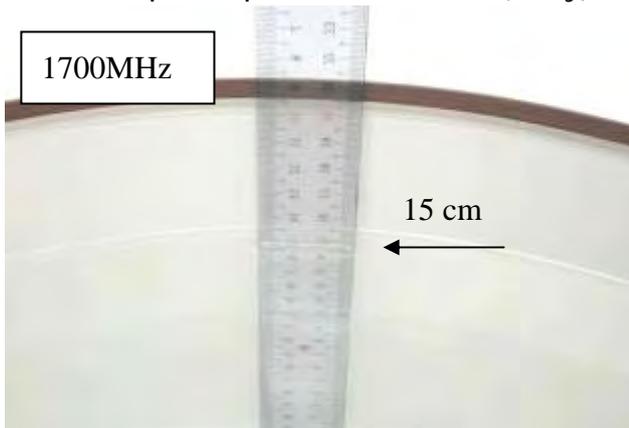


Fig.2.6 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Flat (Body)

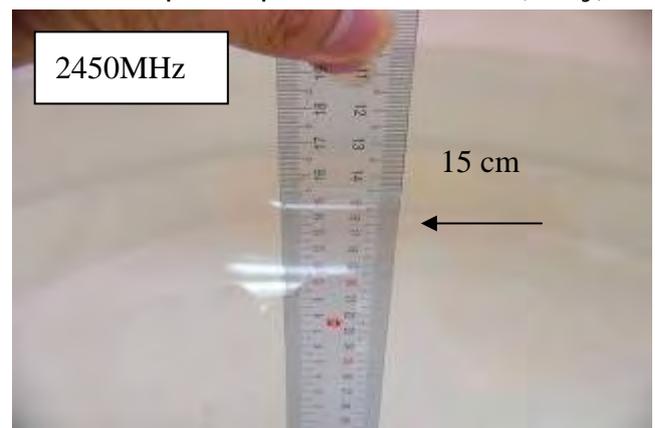


Fig.2.7 Photograph of the Tissue Simulant Fluid liquid depth 15cm for Flat (Body)

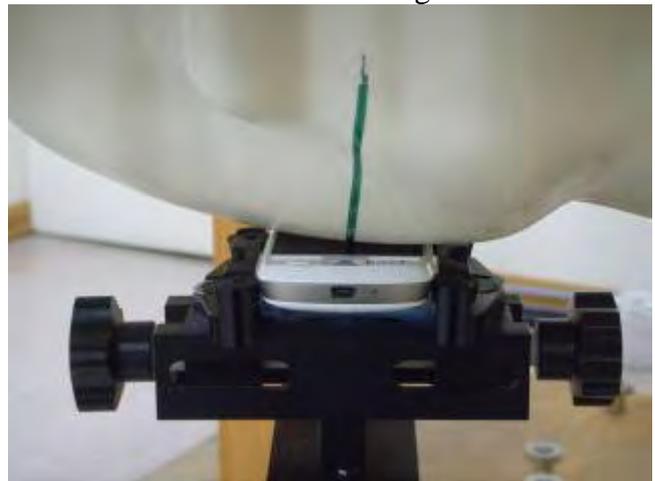
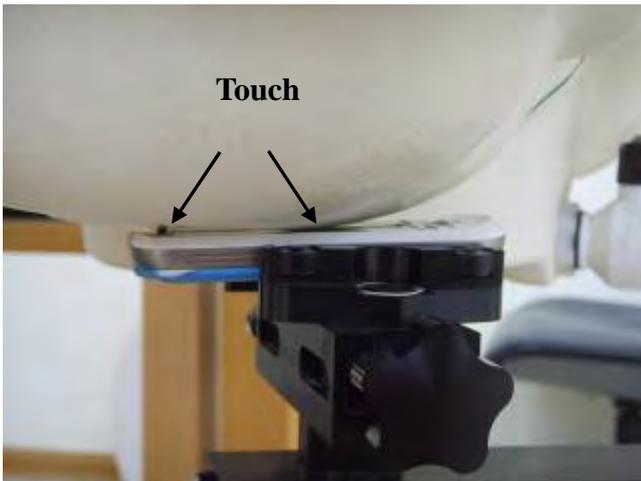


Fig.3 Right Head Section / Cheek-Touch Position

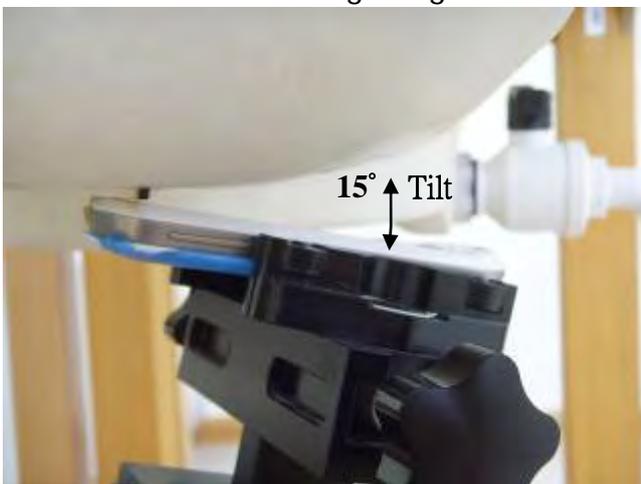


Fig.4 Right Head Section / Ear-Tilt Position(15°)

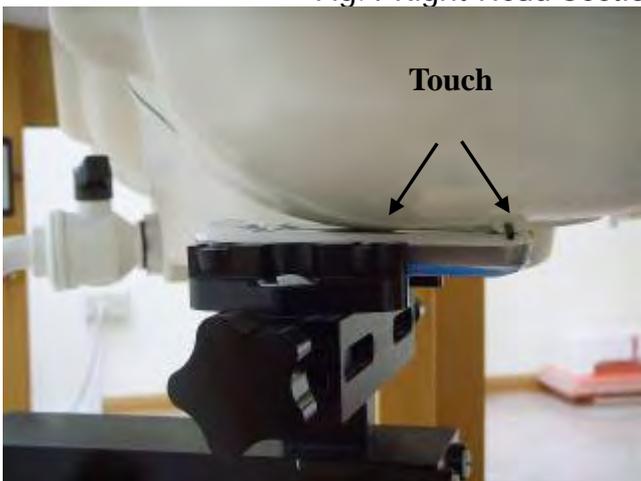


Fig.5 Left Head Section / Cheek-Touch Position



Fig.6 Left Head Section / Ear-Tilt Position(15°)

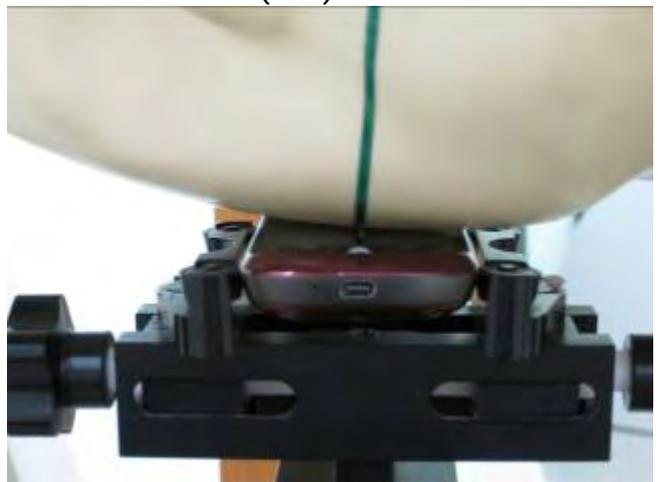
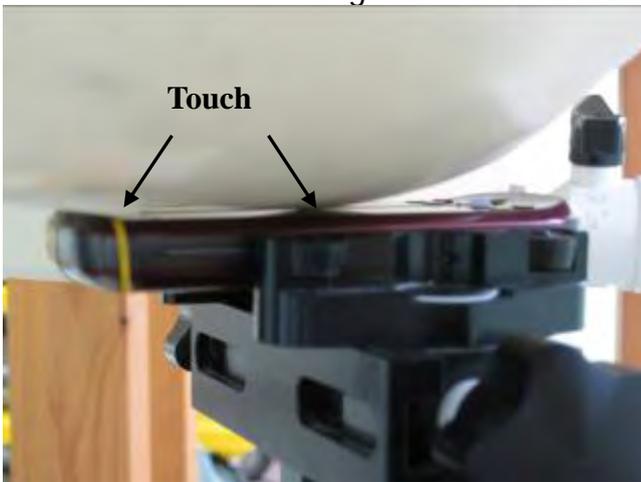


Fig.7 Right Head Section / Cheek-Touch Position



Fig.8 Right Head Section / Ear-Tilt Position(15°)

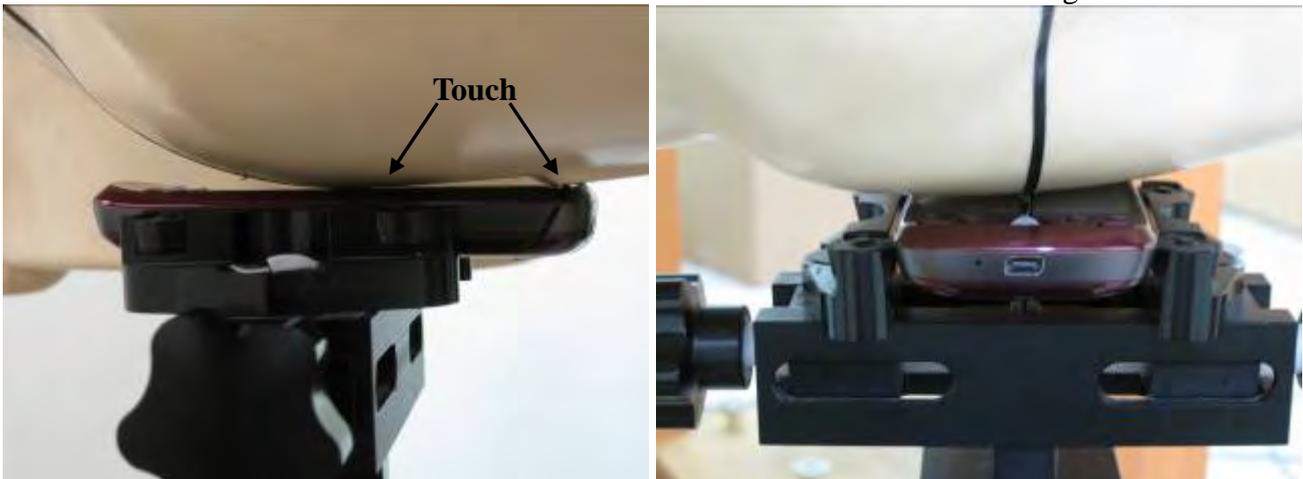


Fig.9 Left Head Section / Cheek-Touch Position



Fig.10 Left Head Section / Ear-Tilt Position(15°)



Fig.11 Right Head Section / Cheek-Touch Position

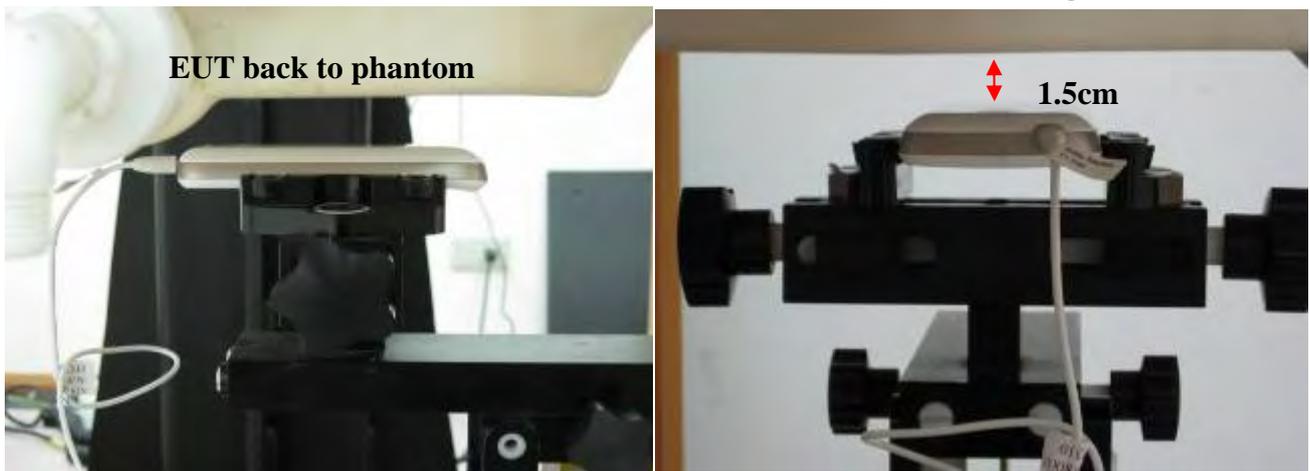


Fig.12 Body worn- EUT back to flat phantom and distance between flat phantom and mobile phone is 1.5 cm

## 10.2 Photographs of the EUT



Fig.13 Front view of device



Fig.14 Back view of device

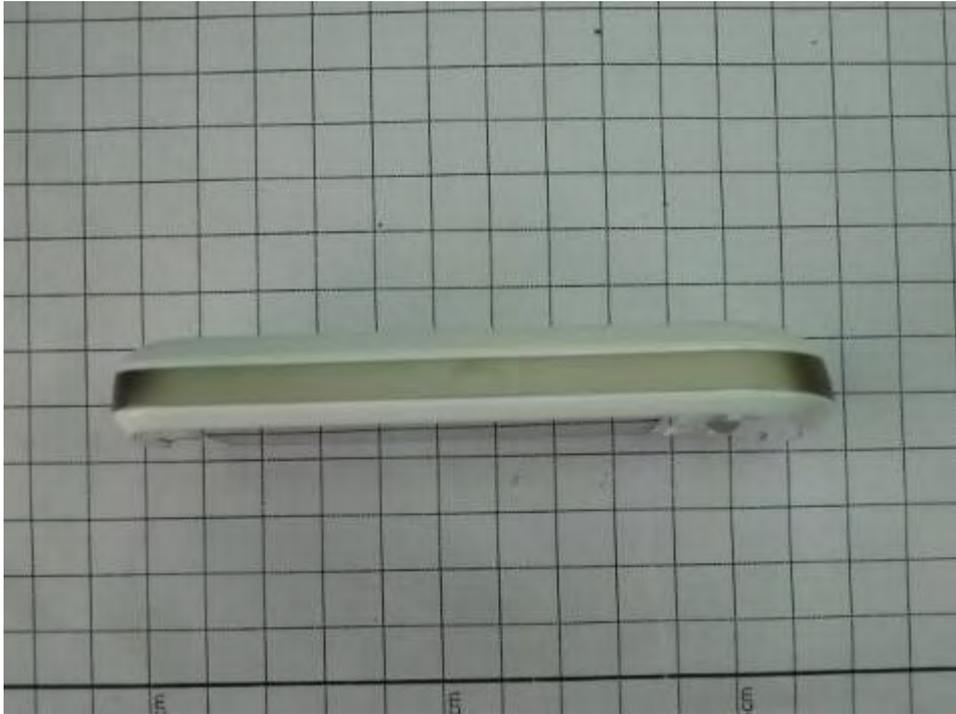


Fig.15 Right side view of device



Fig.16 Left side view of device



Fig.17 Front view of Battery (TWS)



Fig.18 Back view of Battery (TWS)



Fig.19 Front view of Battery (WELLDONE)



Fig.20 Back view of Battery (WELLDONE)



Fig.21 headset



Fig.22 AC Charger



Fig.23 Second sample



Fig.24 Third sample



Fig.25 Fourth sample



Fig.26 Front view of device (IMEI: 356221030019030)



Fig.27 Back view of device(IMEI: 356221030019030)



Fig.28 Front view of device (IMEI: 356221030018990)



Fig.29 Back view of device(IMEI: 356221030018990)



Fig.30 Front view of device (IMEI: 356221030018404)



Fig.31 Back view of device(IMEI: 356221030018404)



Fig.32 Front view of device (IMEI: 356221030022968)



Fig.33 Back view of device(IMEI: 356221030022968)



Fig.34 Front view of device (IMEI: 356221030022943)



Fig.35 Back view of device(IMEI: 356221030022943)

End of Report