


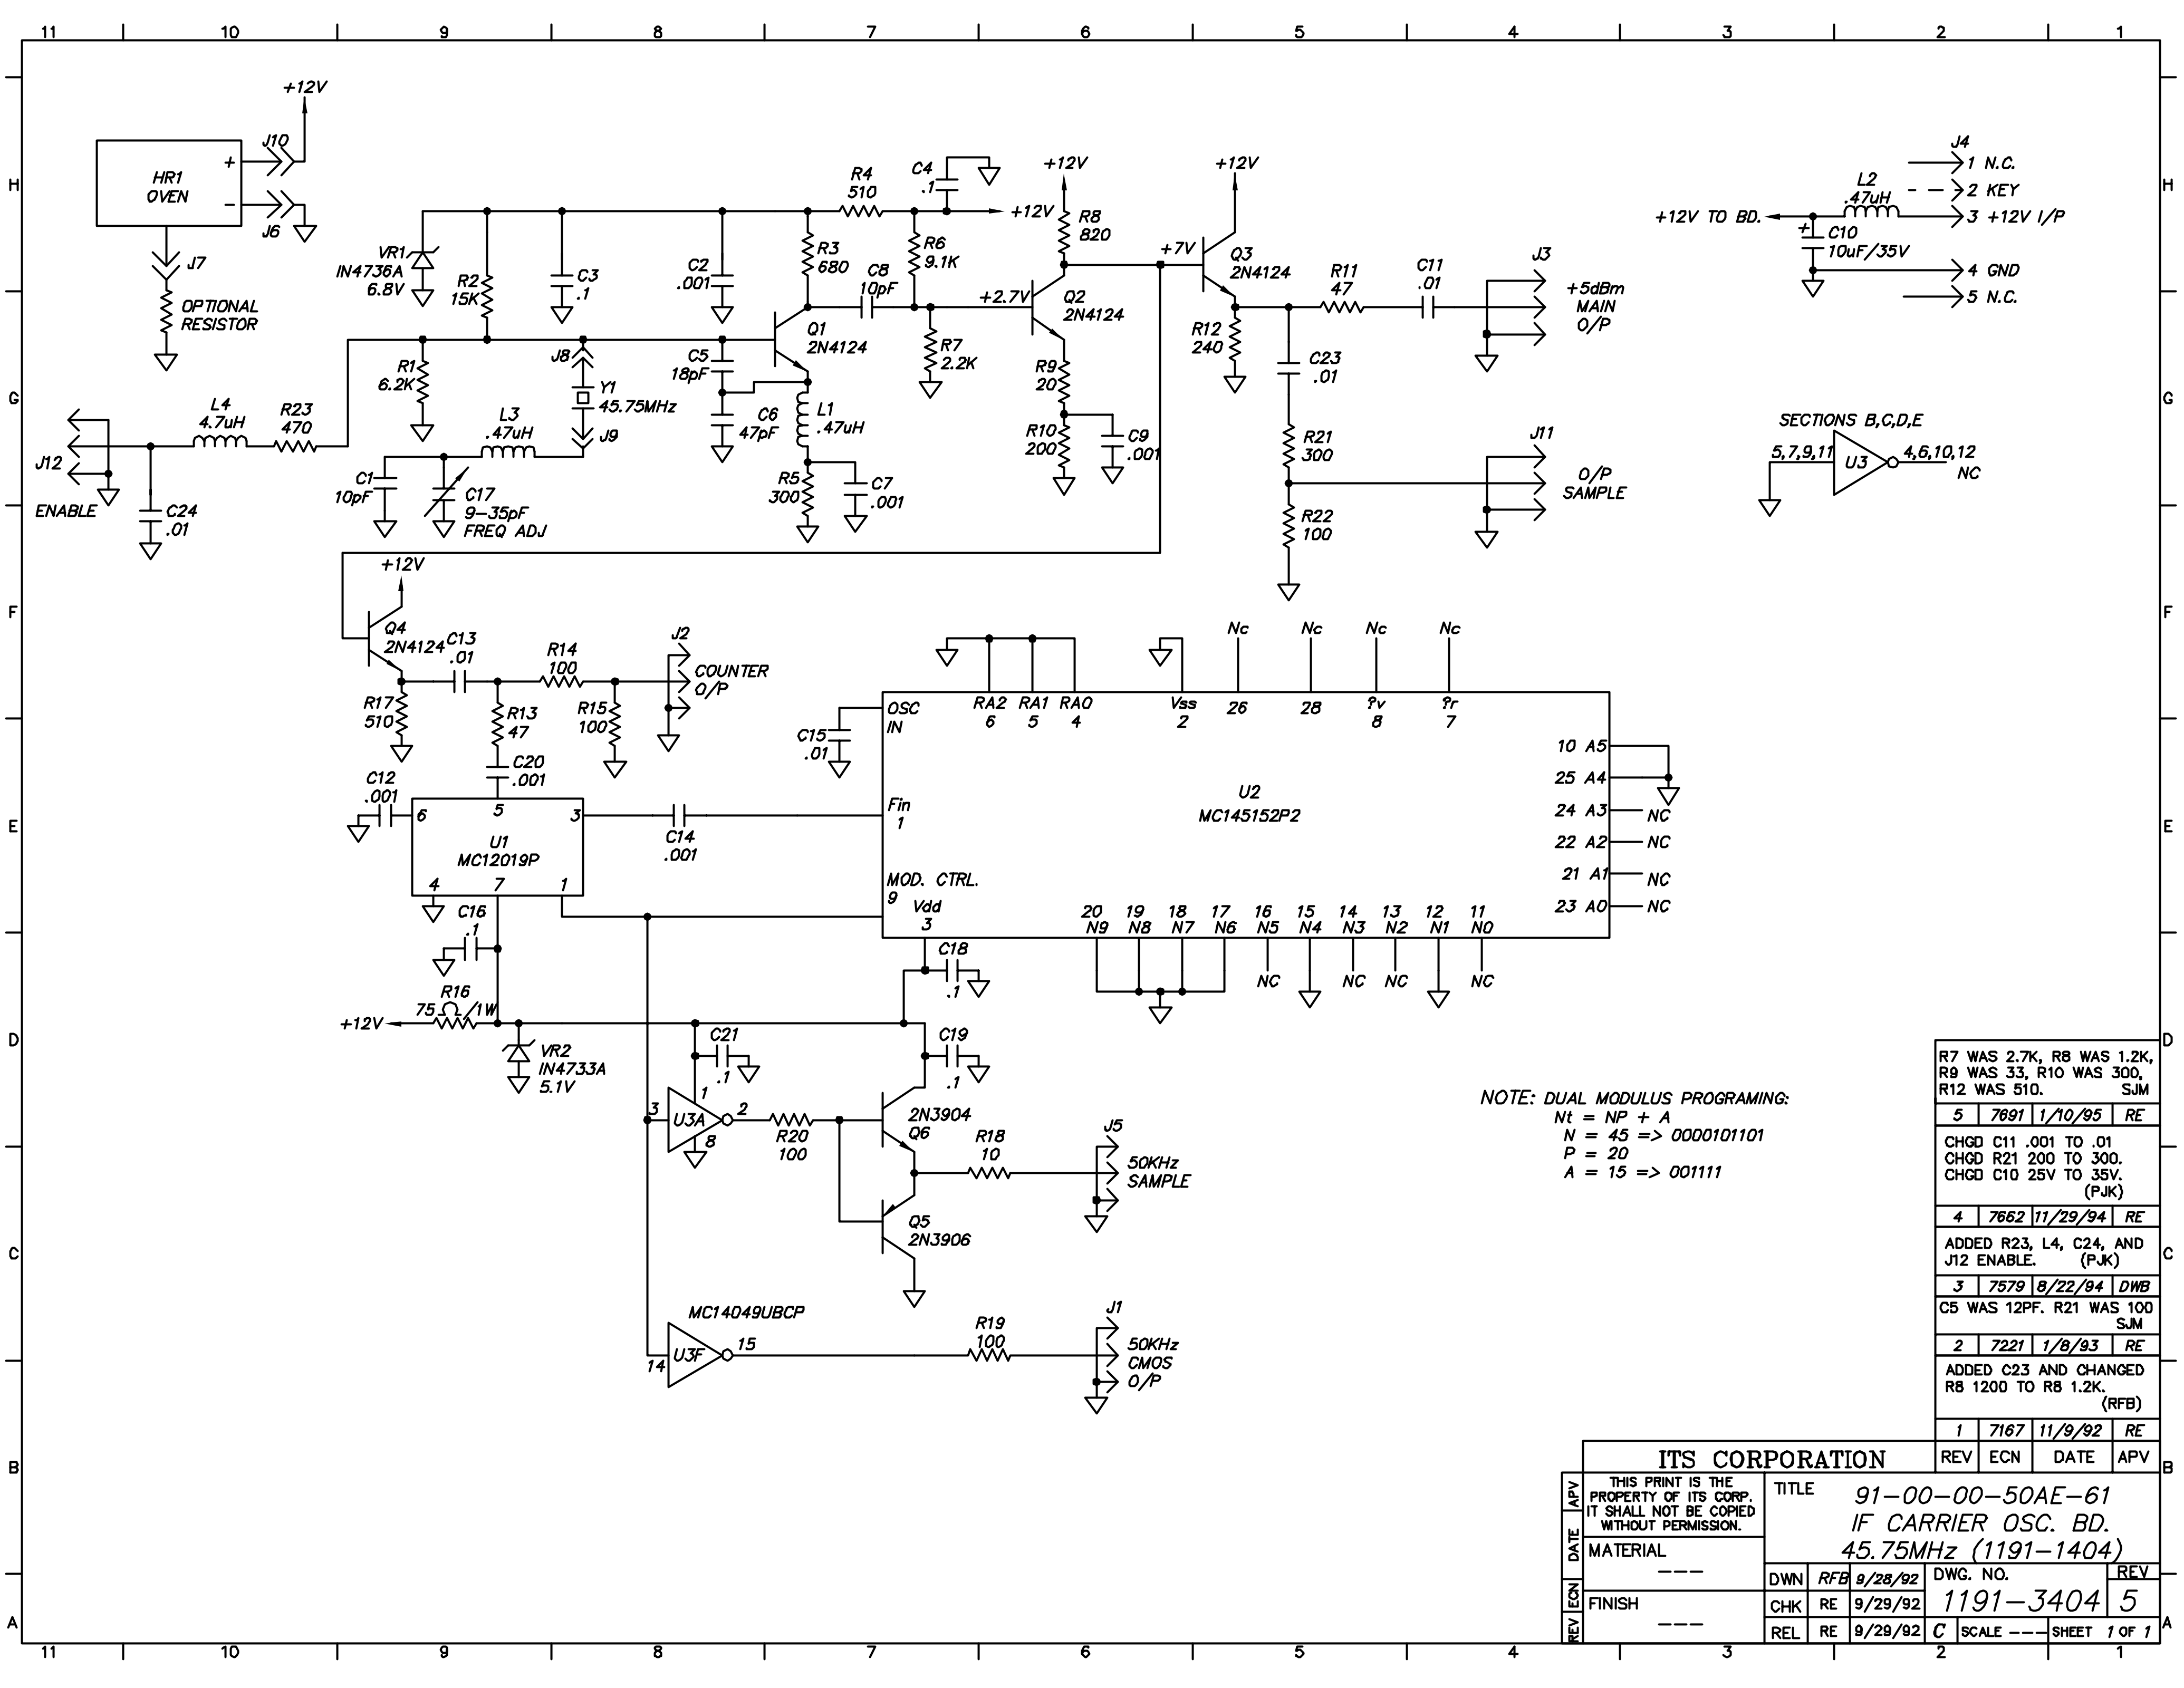

NOTE: DUAL MODULUS PROGRAMMING:
Nt = NP + A
N = 45 => 0000101101
P = 20
A = 15 => 001111

R7 WAS 2.7K, R8 WAS 1.2K, R9 WAS 33, R10 WAS 300, R12 WAS 510. SJM			
5	7691	1/10/95	RE
CHGD C11 .001 TO .01 CHGD R21 200 TO 300. CHGD C10 25V TO 35V. (PJK)			
4	7662	11/29/94	RE
ADDED R23, L4, C24, AND J12 ENABLE. (PJK)			
3	7579	8/22/94	DWB
C5 WAS 12PF. R21 WAS 100 SJM			
2	7221	1/8/93	RE
ADDED C23 AND CHANGED R8 1200 TO R8 1.2K. (RFB)			
1	7167	11/9/92	RE

ITS CORPORATION				REV	ECN	DATE	APV
THIS PRINT IS THE PROPERTY OF ITS CORP. IT SHALL NOT BE COPIED WITHOUT PERMISSION.				TITLE 91-00-00-50AE-61 IF CARRIER OSC. BD. 45.75MHz (1191-1404)			
MATERIAL ---				DWN	RFB	9/28/92	DWG. NO.
FINISH ---				CHK	RE	9/29/92	1191-3404
REL				RE	9/29/92	C	SCALE ---
				SHEET 1 OF 1			