
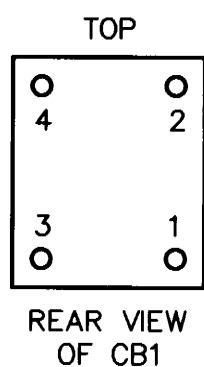


NOTES:

1. ALL WIRE IS 6 AWG UNLESS NOTED OTHERWISE.
2. VR2 REQUIRES A MOV INSULATOR KIT.
3. LINE 2 IS THE NEUTRAL FOR INTERNATIONAL SYSTEMS USING 220 VAC HOT AND NEUTRAL.

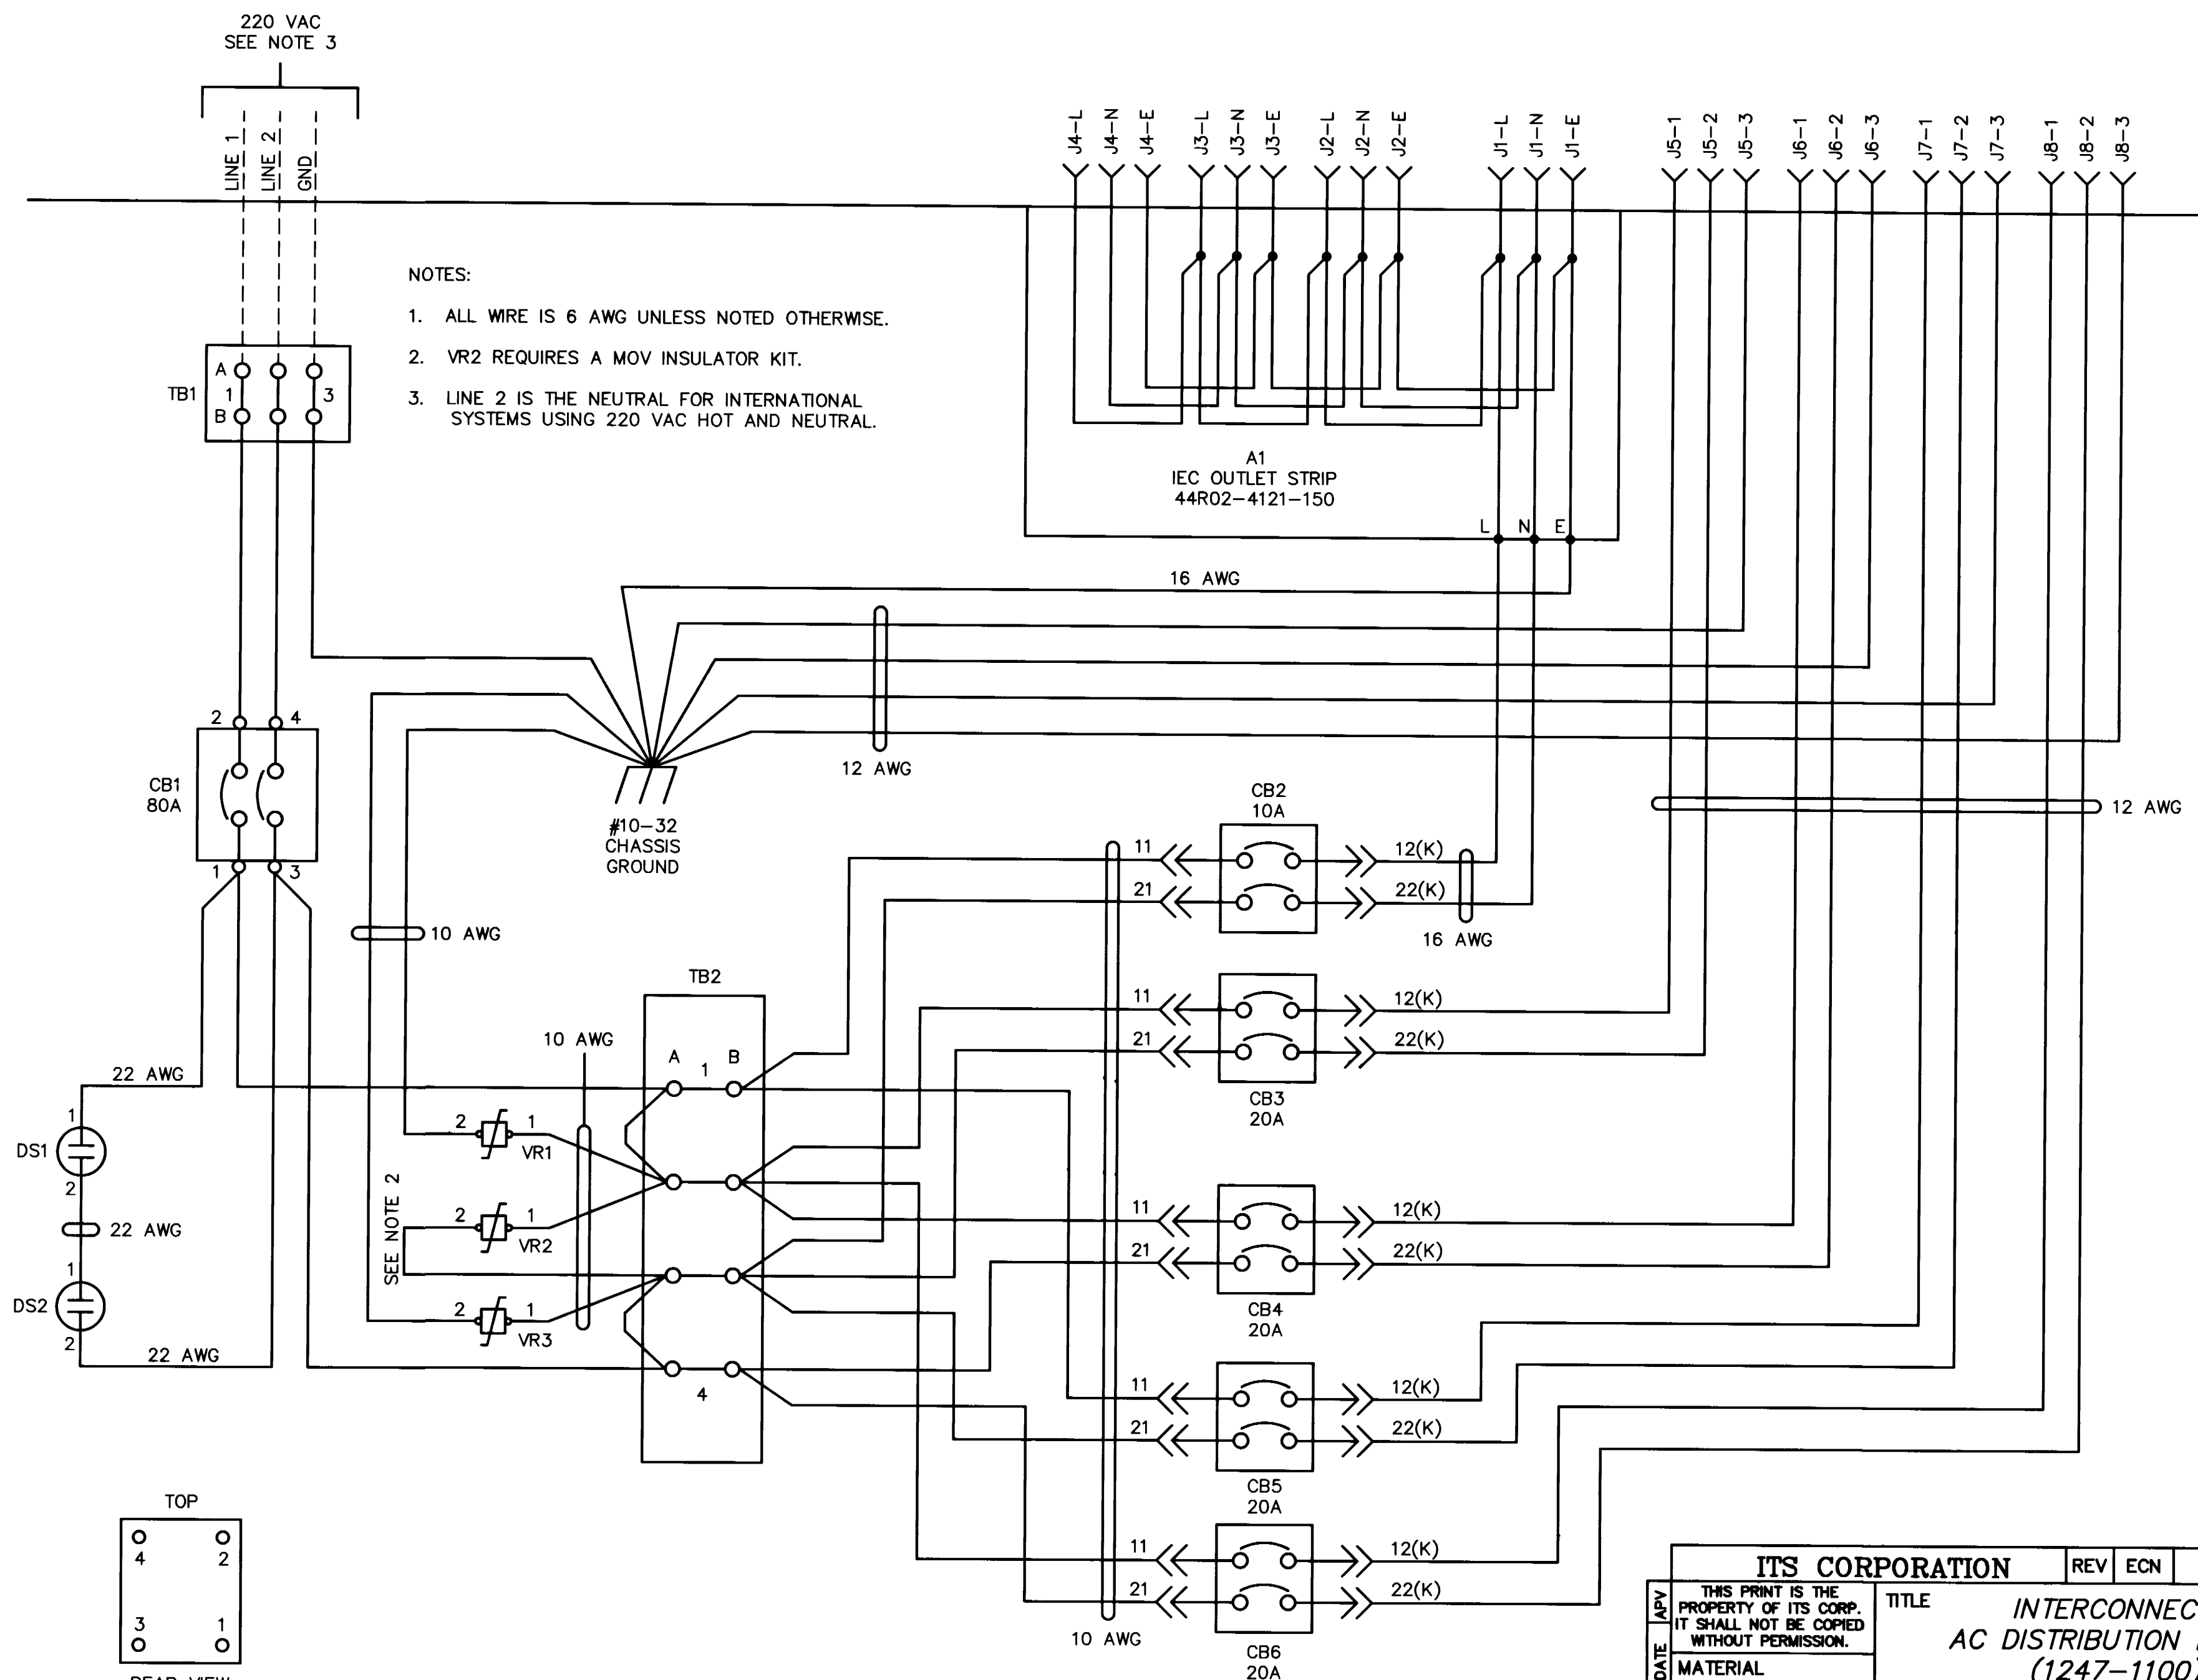

ITS CORPORATION				REV	ECN	DATE	APV
THIS PRINT IS THE PROPERTY OF ITS CORP. IT SHALL NOT BE COPIED WITHOUT PERMISSION.				TITLE			
				INTERCONNECT, AC DISTRIBUTION PANEL (1247-1100)			
MATERIAL				DWN	RFB	10/12/94	DWG. NO.
FINISH				CHK	RE	10/17/94	1247-8100 0
				REL	RE	10/17/94	C
				SCALE --- SHEET 1 OF 1			