


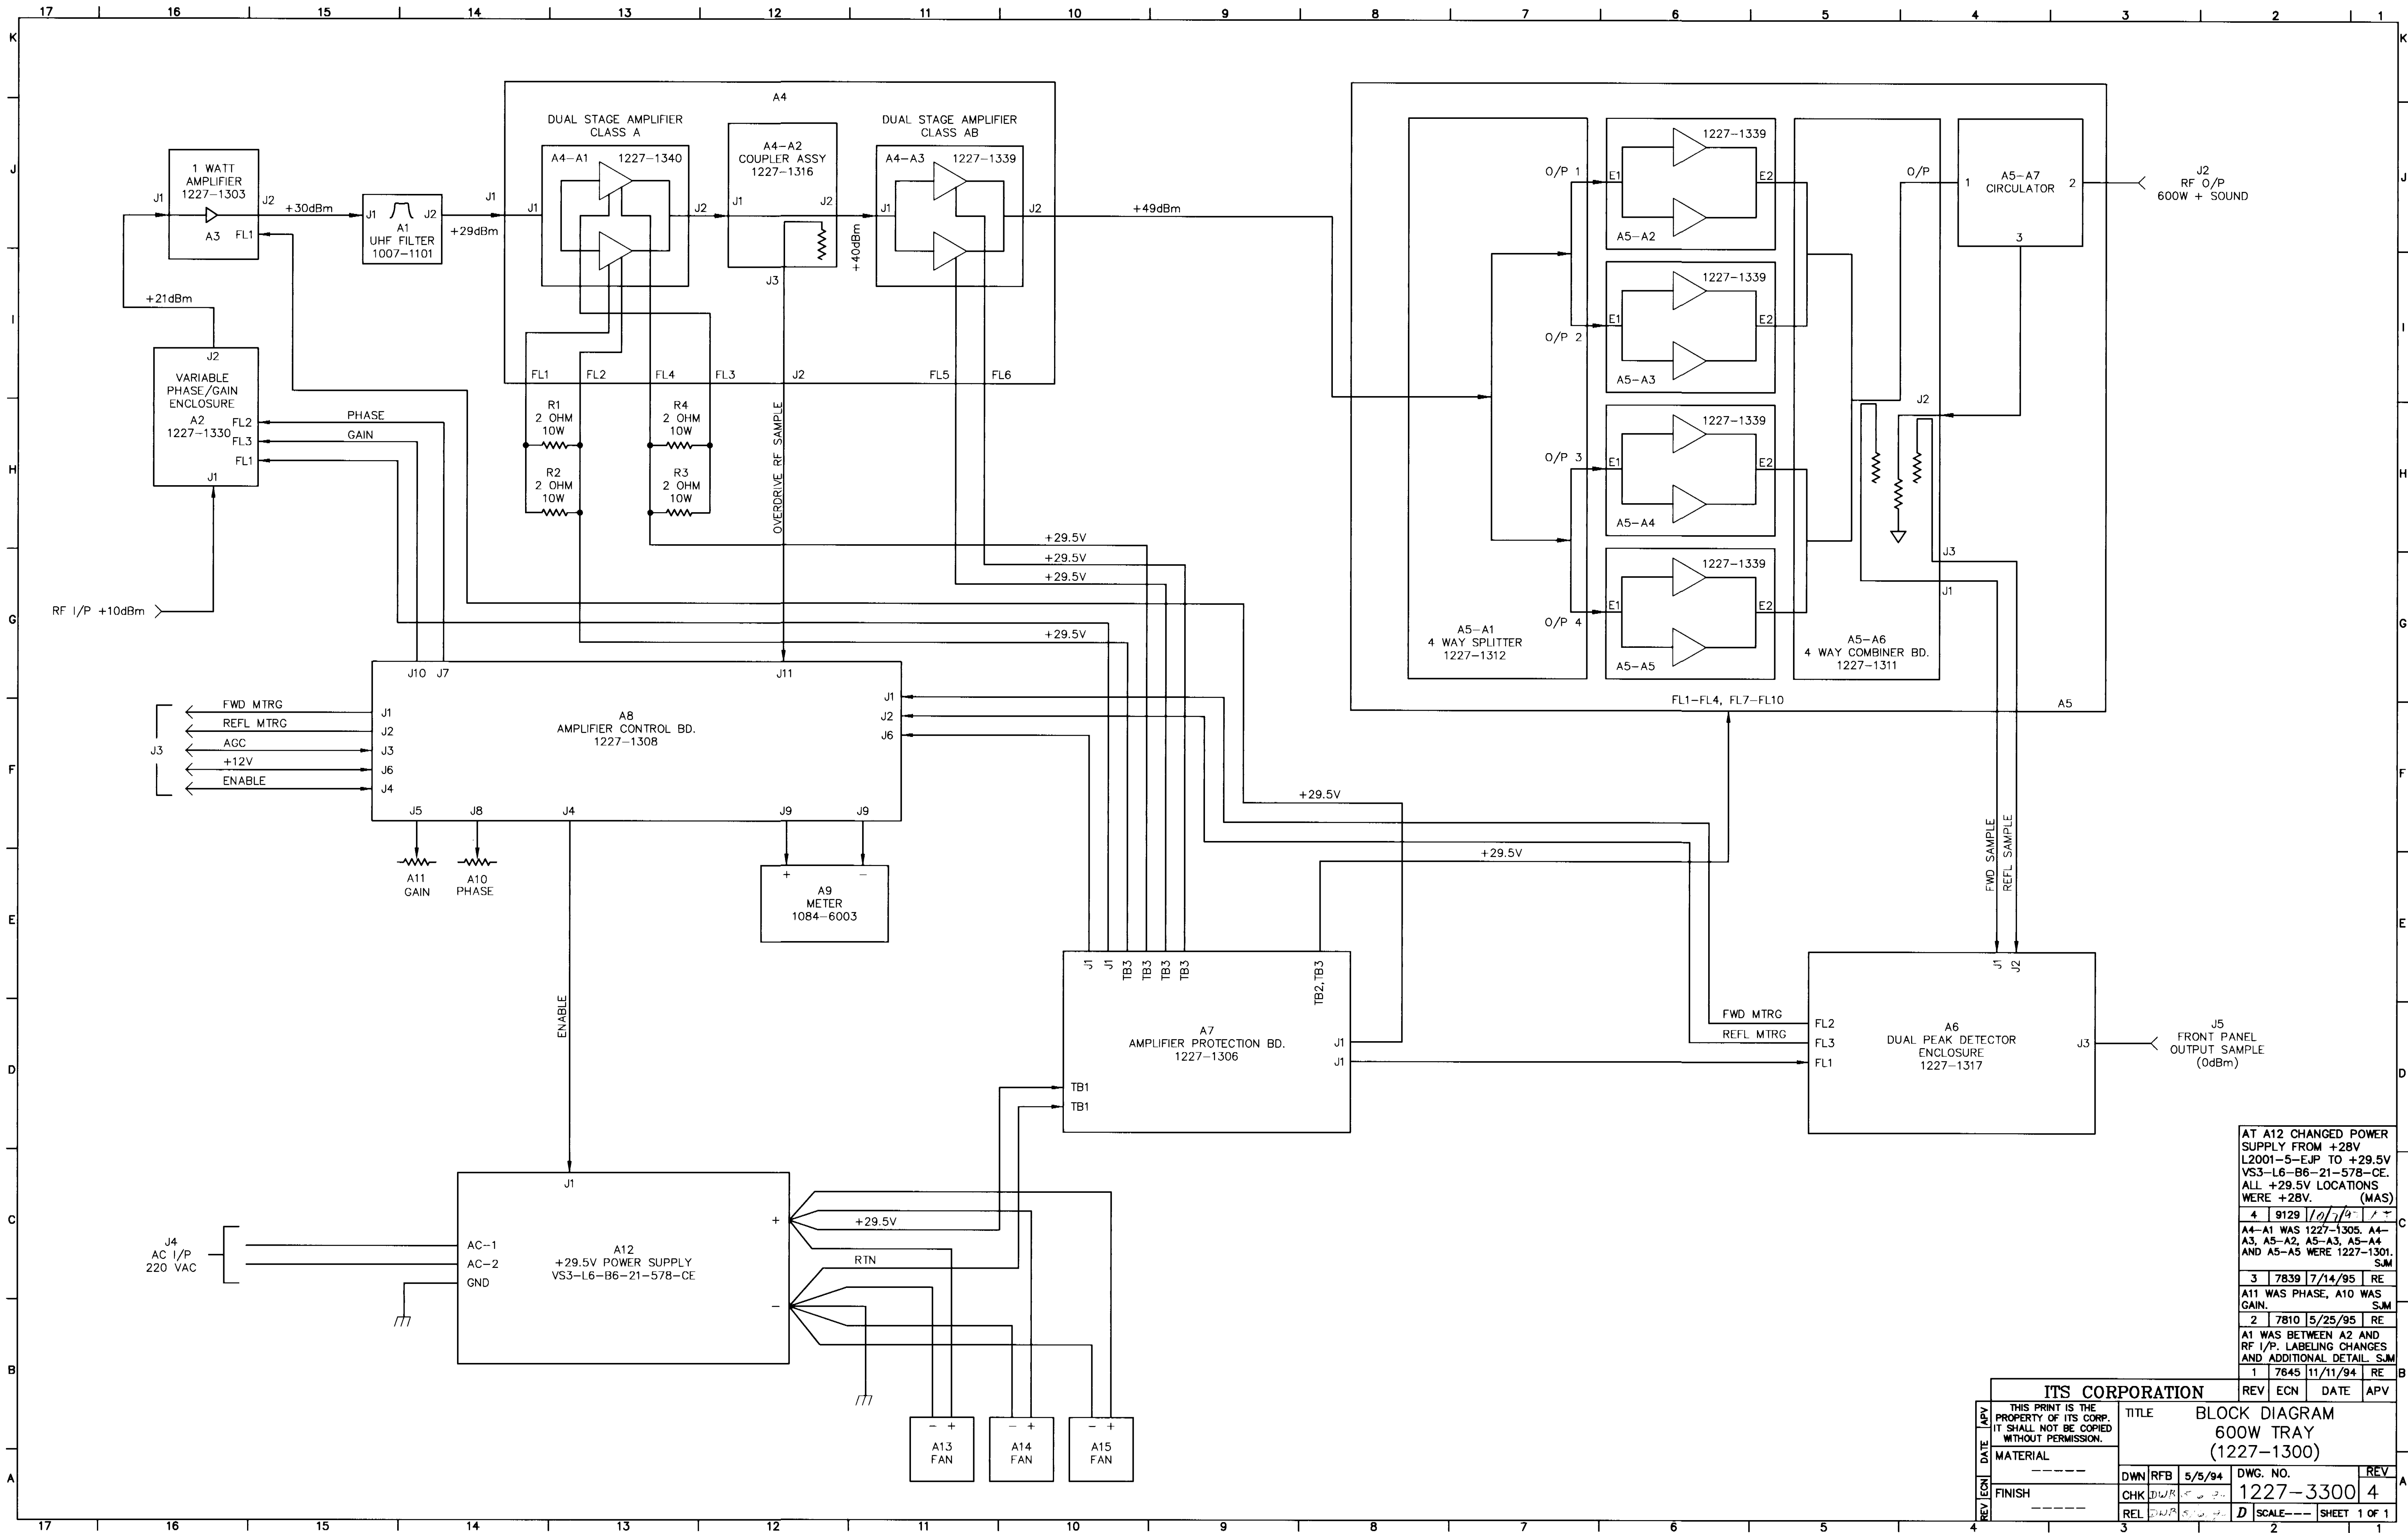

AT A12 CHANGED POWER SUPPLY FROM +28V L2001-5-EJP TO +29.5V VS3-L6-B6-21-578-CE. ALL +29.5V LOCATIONS WERE +28V. (MAS)

4	9129	1/2/79	1	+
3	7839	7/14/95	RE	
A11 WAS PHASE, A10 WAS GAIN.				
2	7810	5/25/95	RE	
A1 WAS BETWEEN A2 AND RF I/P. LABELING CHANGES AND ADDITIONAL DETAIL. S.M.				
1	7645	11/11/94	RE	

ITS CORPORATION					REV	ECN	DATE	APV
THIS PRINT IS THE PROPERTY OF ITS CORP. IT SHALL NOT BE COPIED WITHOUT PERMISSION.					TITLE			
MATERIAL					BLOCK DIAGRAM 600W TRAY (1227-1300)			
FINISH					DWN	RFB	5/5/94	DWG. NO.
					CHK	DWR	5/5/94	1227-3300
					REL	DWR	5/5/94	4
					SCALE--- SHEET 1 OF 1			