


FOCAL JM LAB®

Digital PCB (Secondary) (Top)




FOCAL

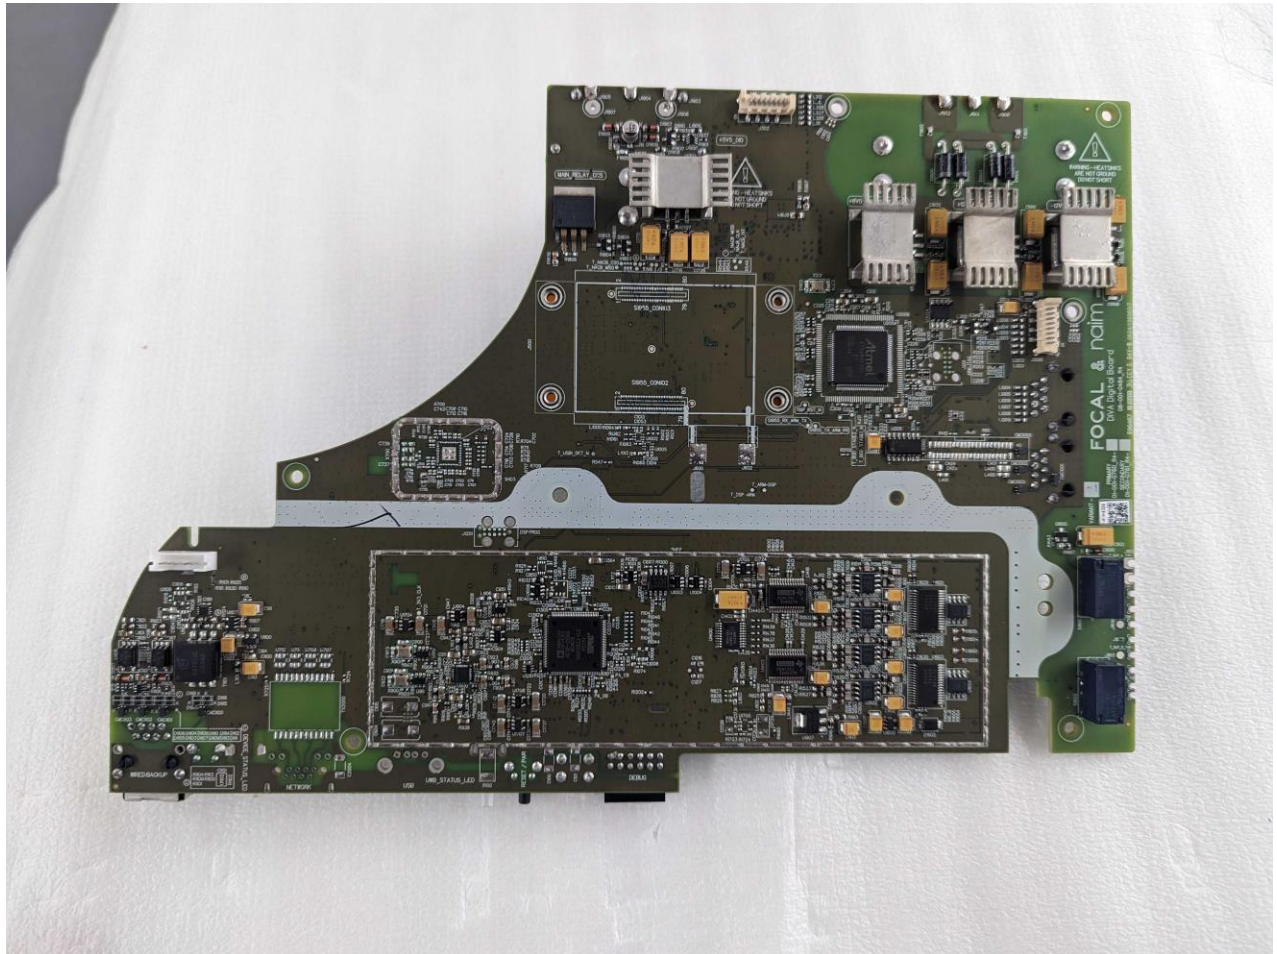

BP 374 ■ 108, rue de l'Avenir ■ 42353 La Talaudière cedex ■ France ■ T. +33 (0) 477 435 700 ■ F. +33 (0) 477 435 701
SAS au capital de 1 062 080 € ■ RCS Saint-Etienne ■ 344 394 309 ■ VAT number : FR 49 344 394 309

FOCAL JM LAB®

Digital PCB (Secondary) (Bottom)

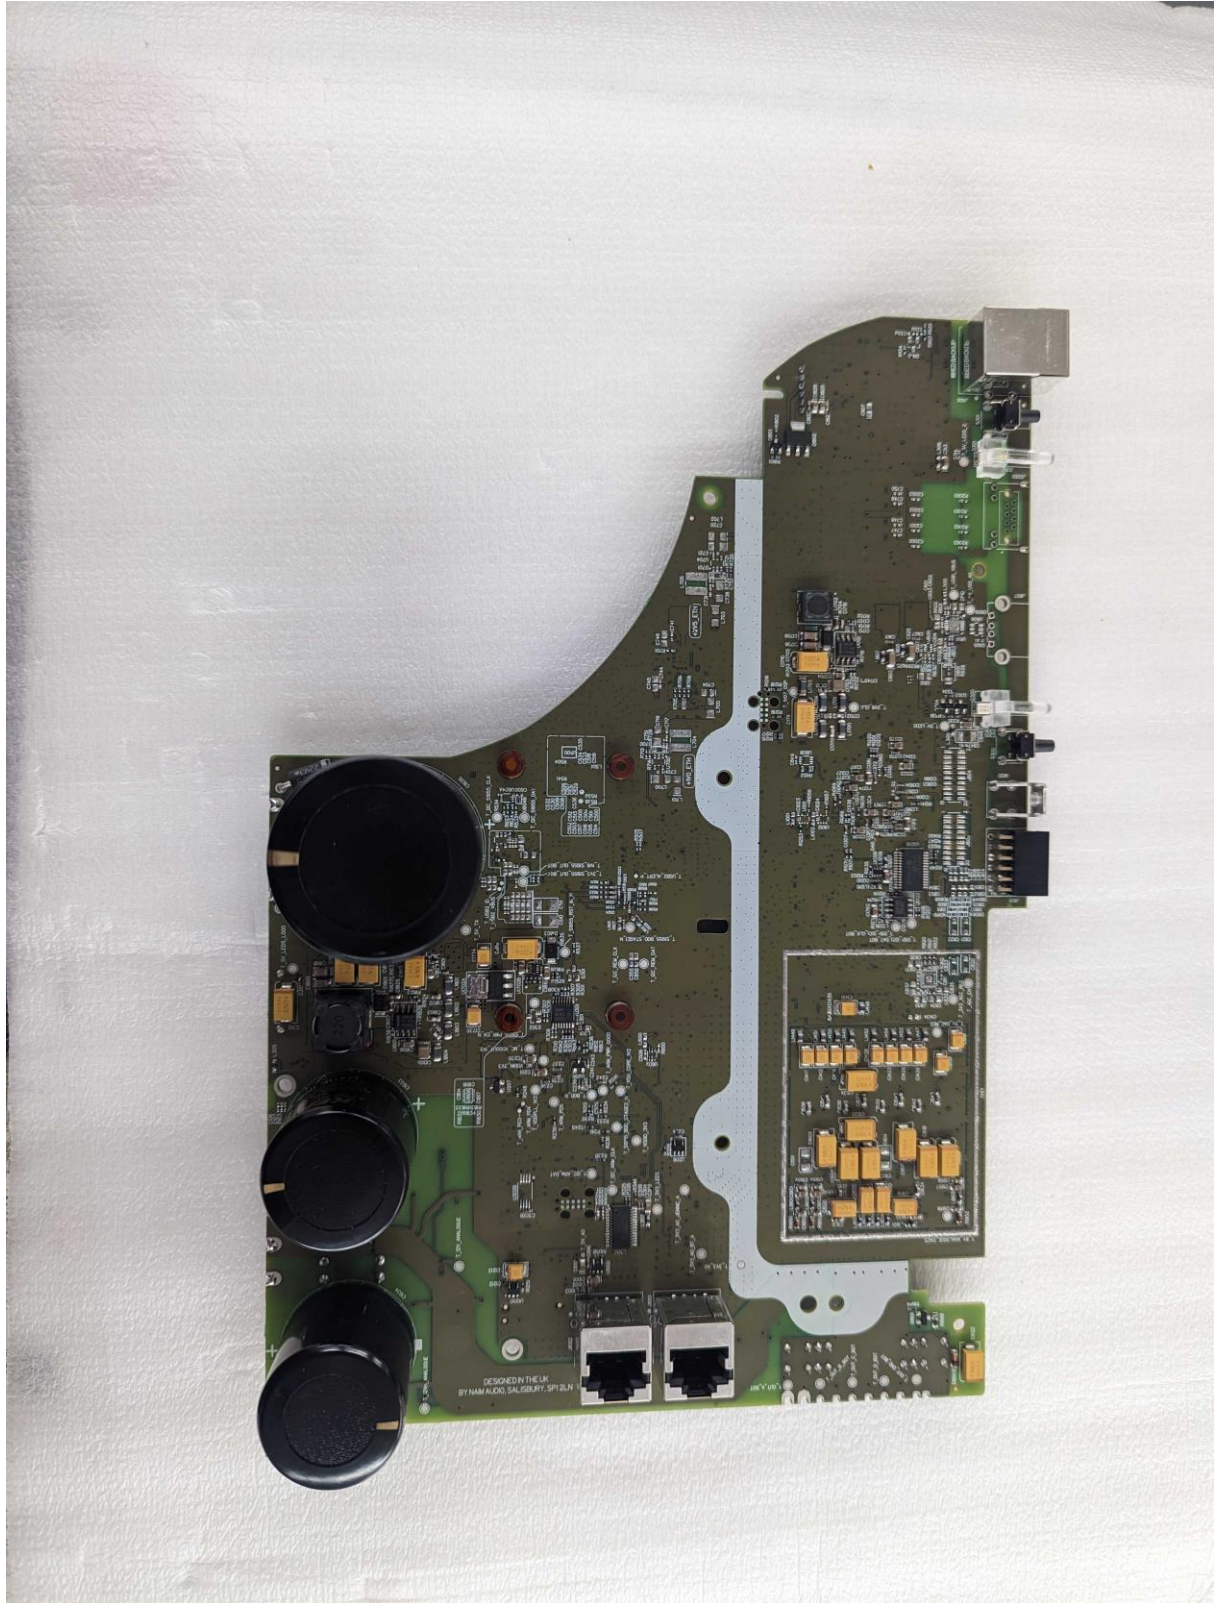


FOCAL



BP 374 ■ 108, rue de l'Avenir ■ 42353 La Talaudière cedex ■ France ■ T. +33 (0) 477 435 700 ■ F. +33 (0) 477 435 701
SAS au capital de 1 062 080 € ■ RCS Saint-Etienne ■ 344 394 309 ■ VAT number : FR 49 344 394 309

FOCAL JM LAB®

PA PCB (Top)

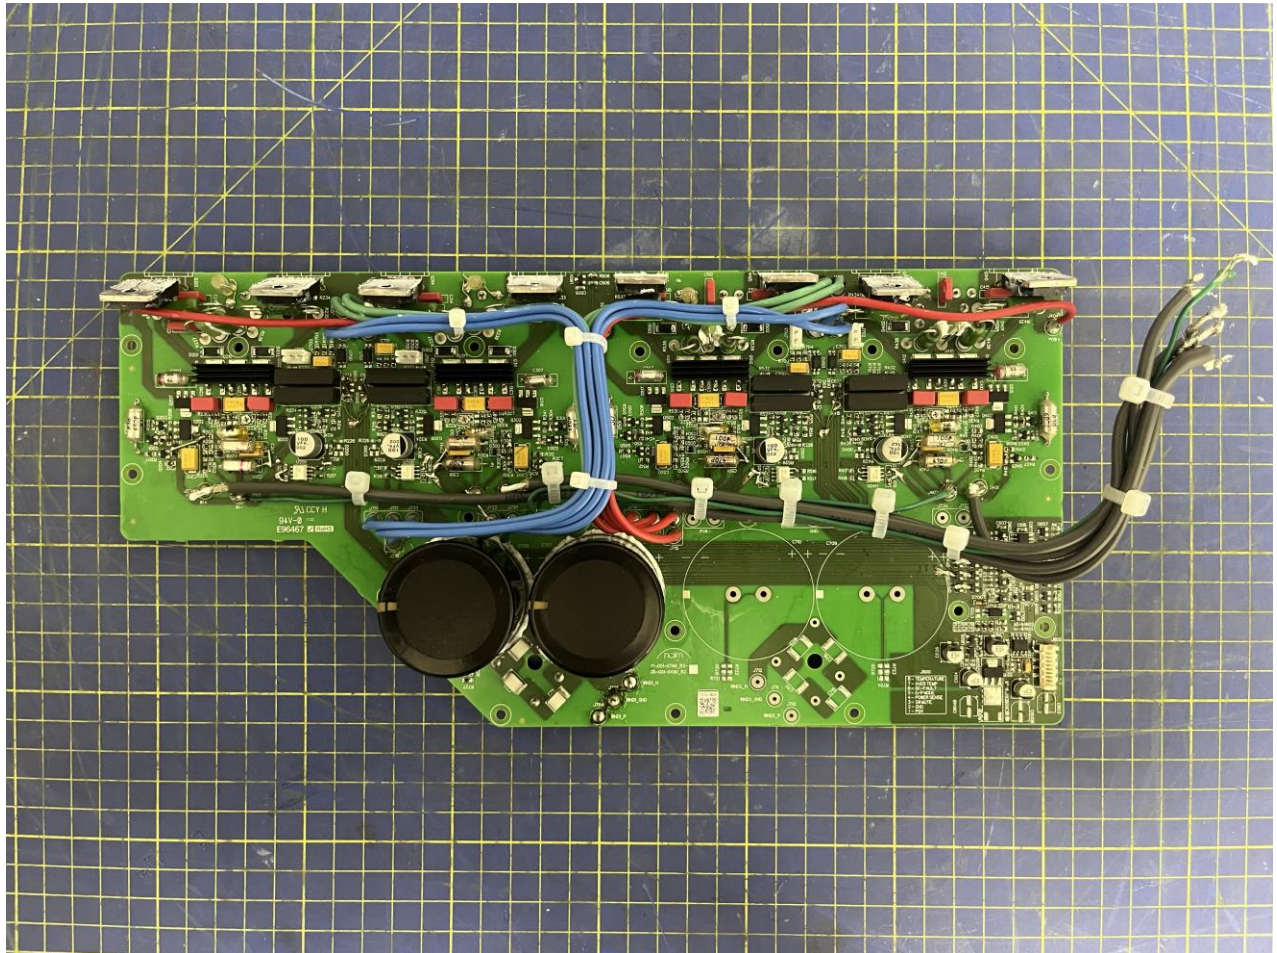


FOCAL



FOCAL JM LAB®

PA PCB (Bottom)

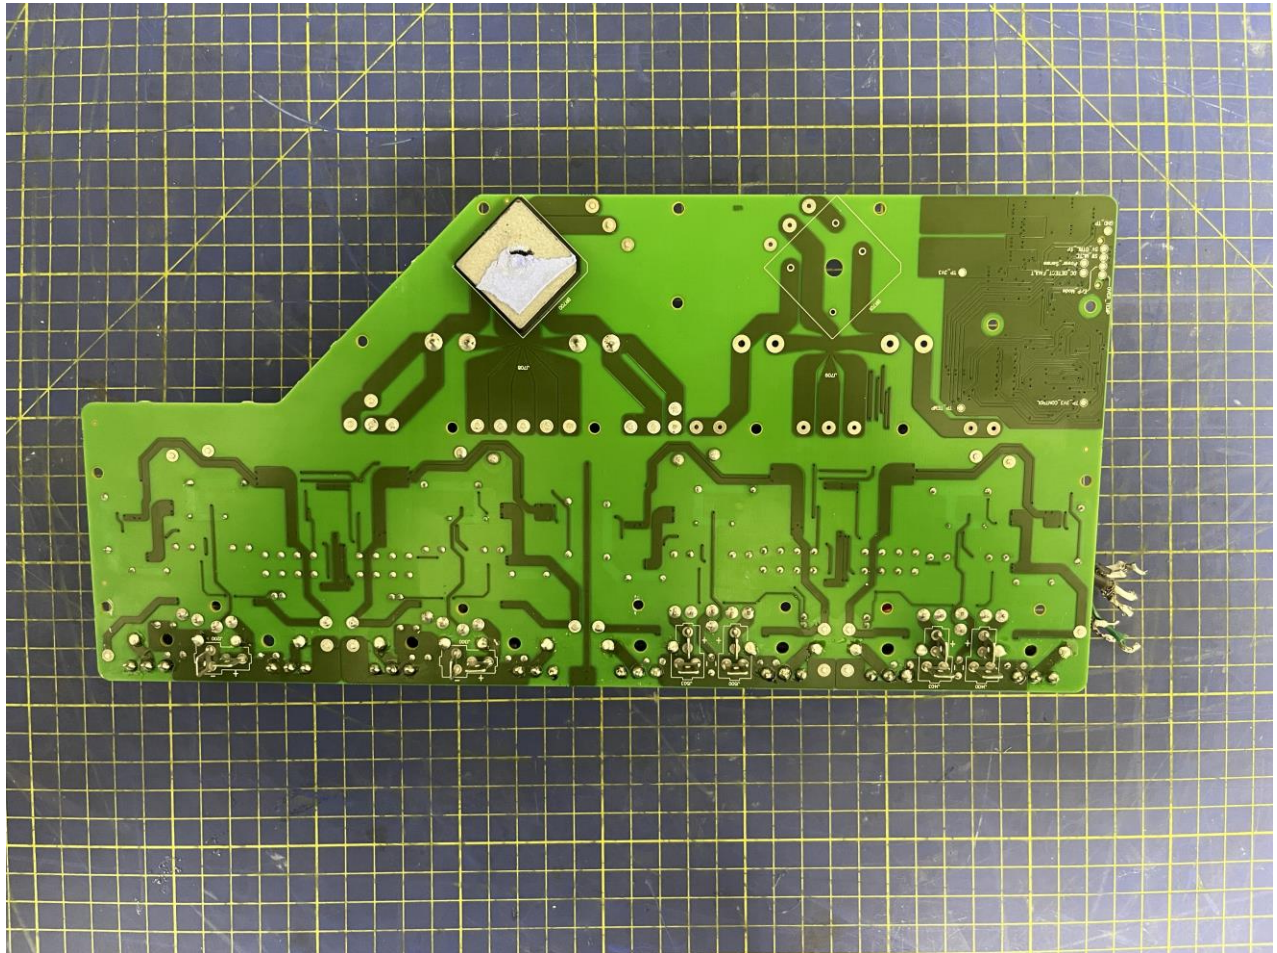


FOCAL



FOCAL JM LAB®

HDMI PCB (Top)

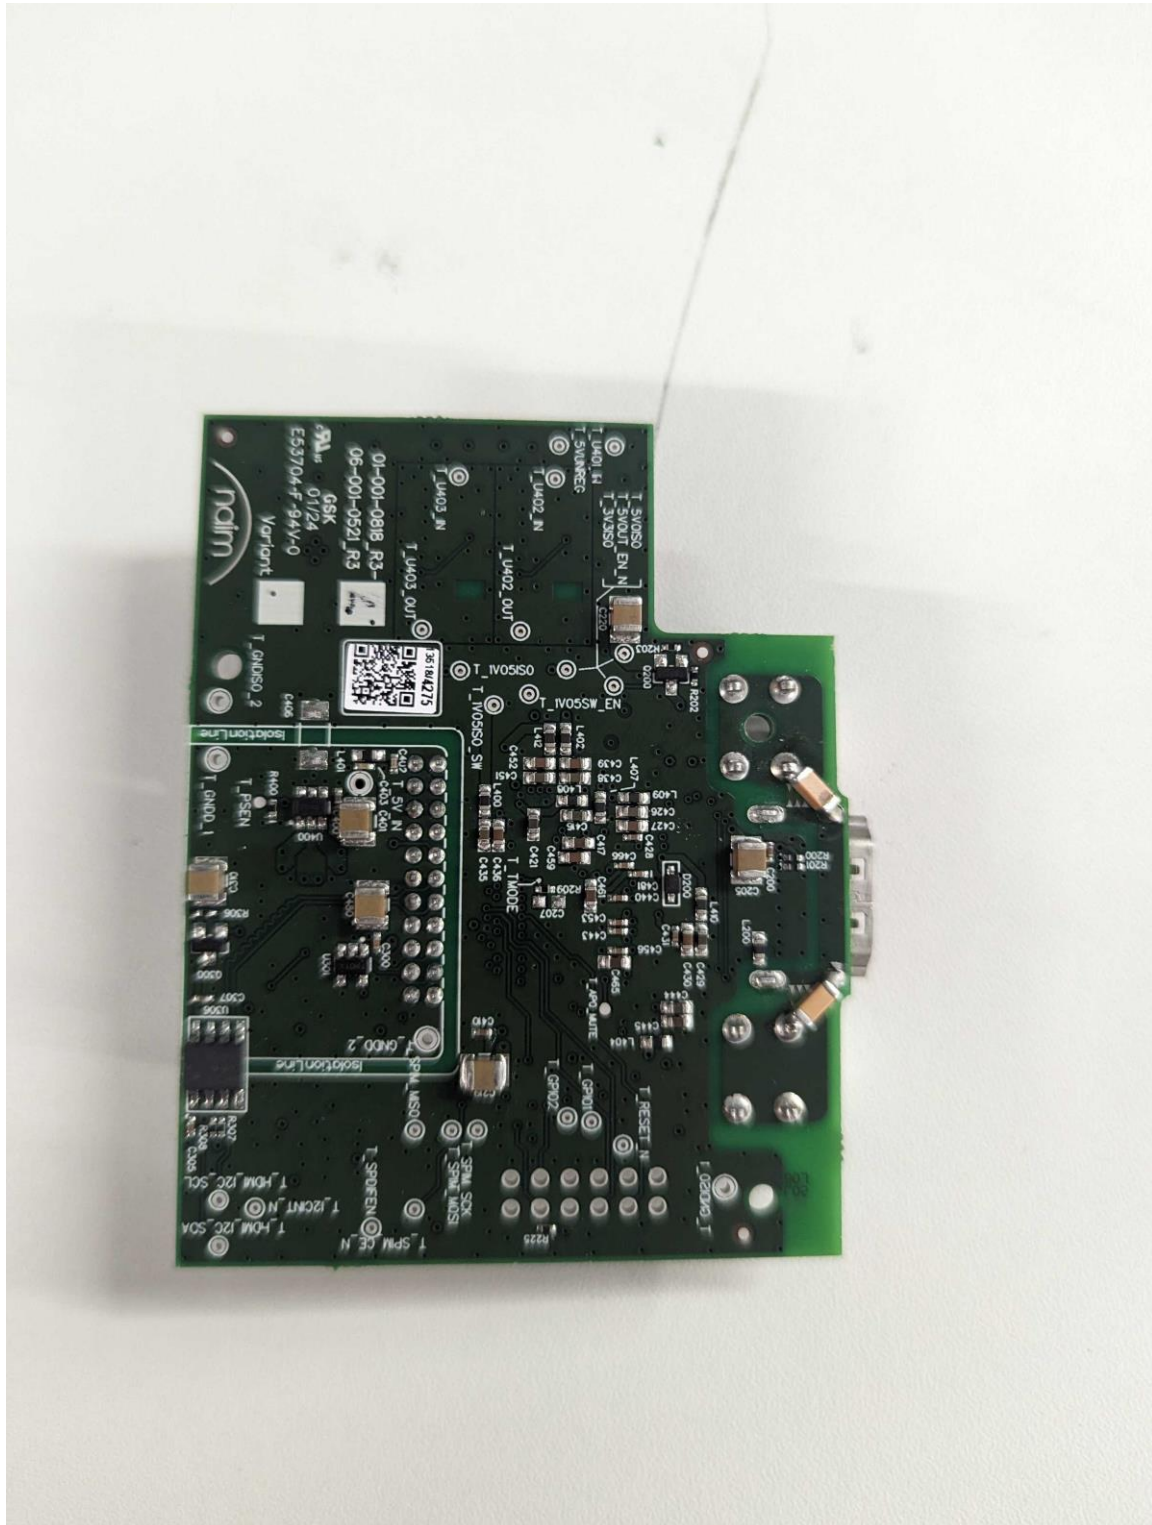


FOCAL



FOCAL JM LAB®

HDMI PCB (Bottom)

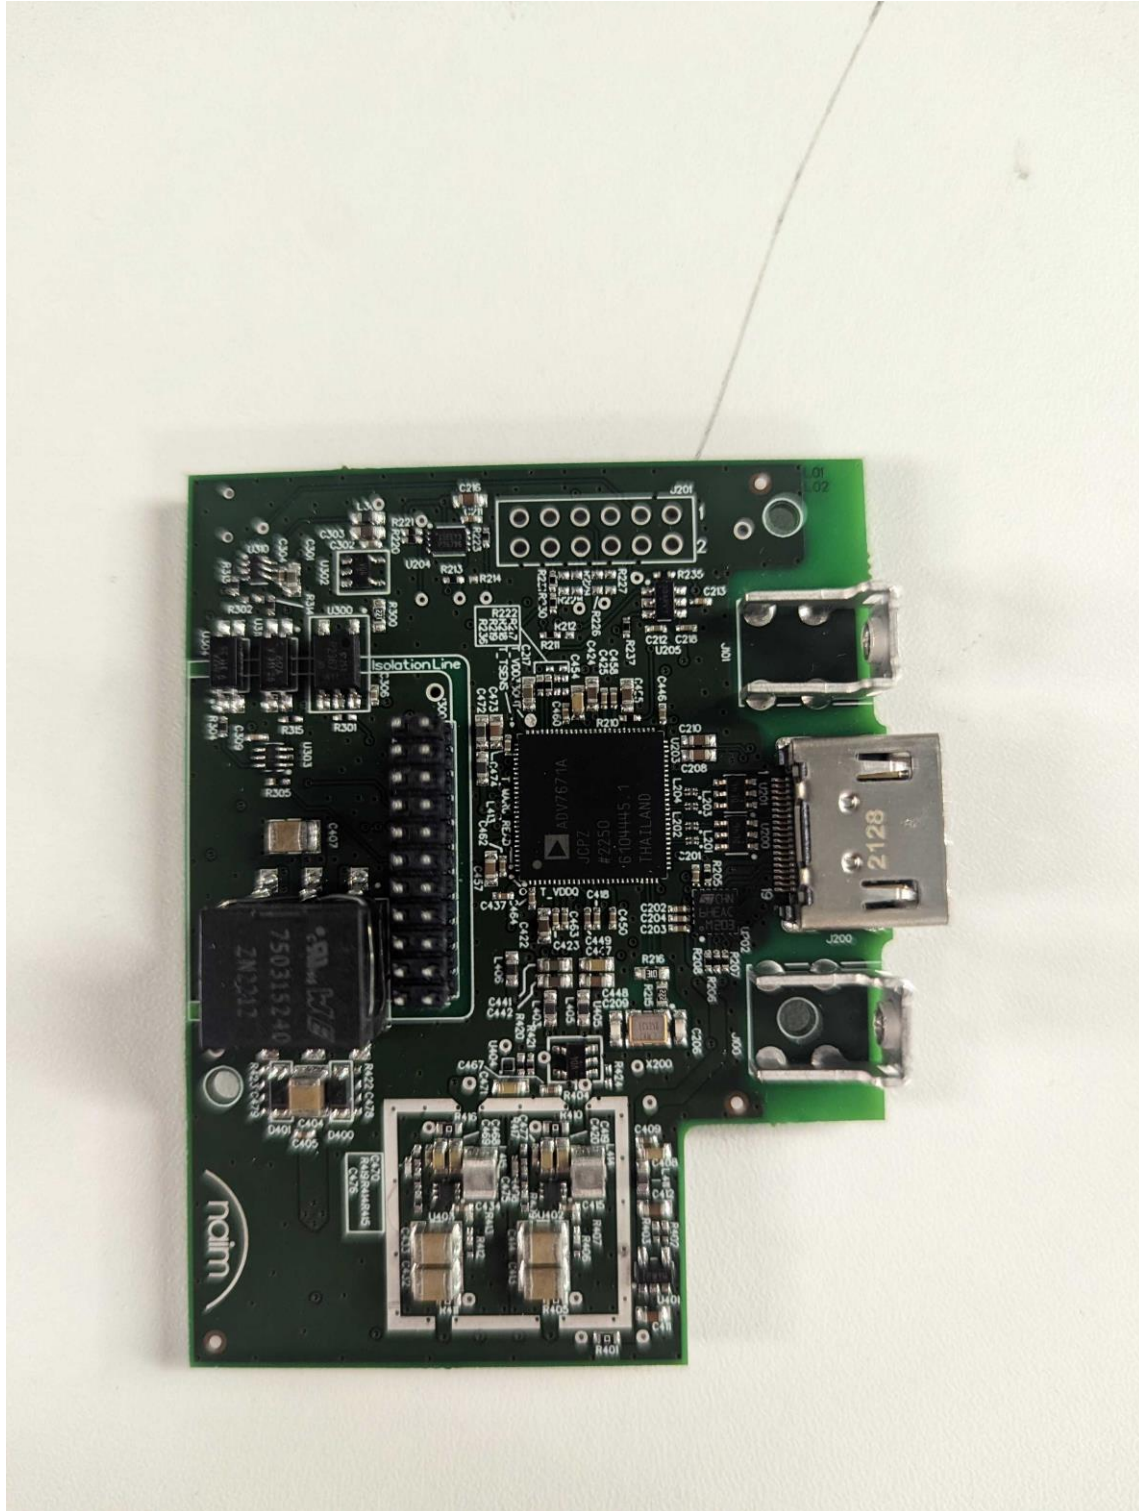


FOCAL



BP 374 ■ 108, rue de l'Avenir ■ 42353 La Talaudière cedex ■ France ■ T. +33 (0) 477 435 700 ■ F. +33 (0) 477 435 701
SAS au capital de 1 062 080 € ■ RCS Saint-Etienne ■ 344 394 309 ■ VAT number : FR 49 344 394 309

FOCAL JM LAB®

EuP Module in situ (Top)

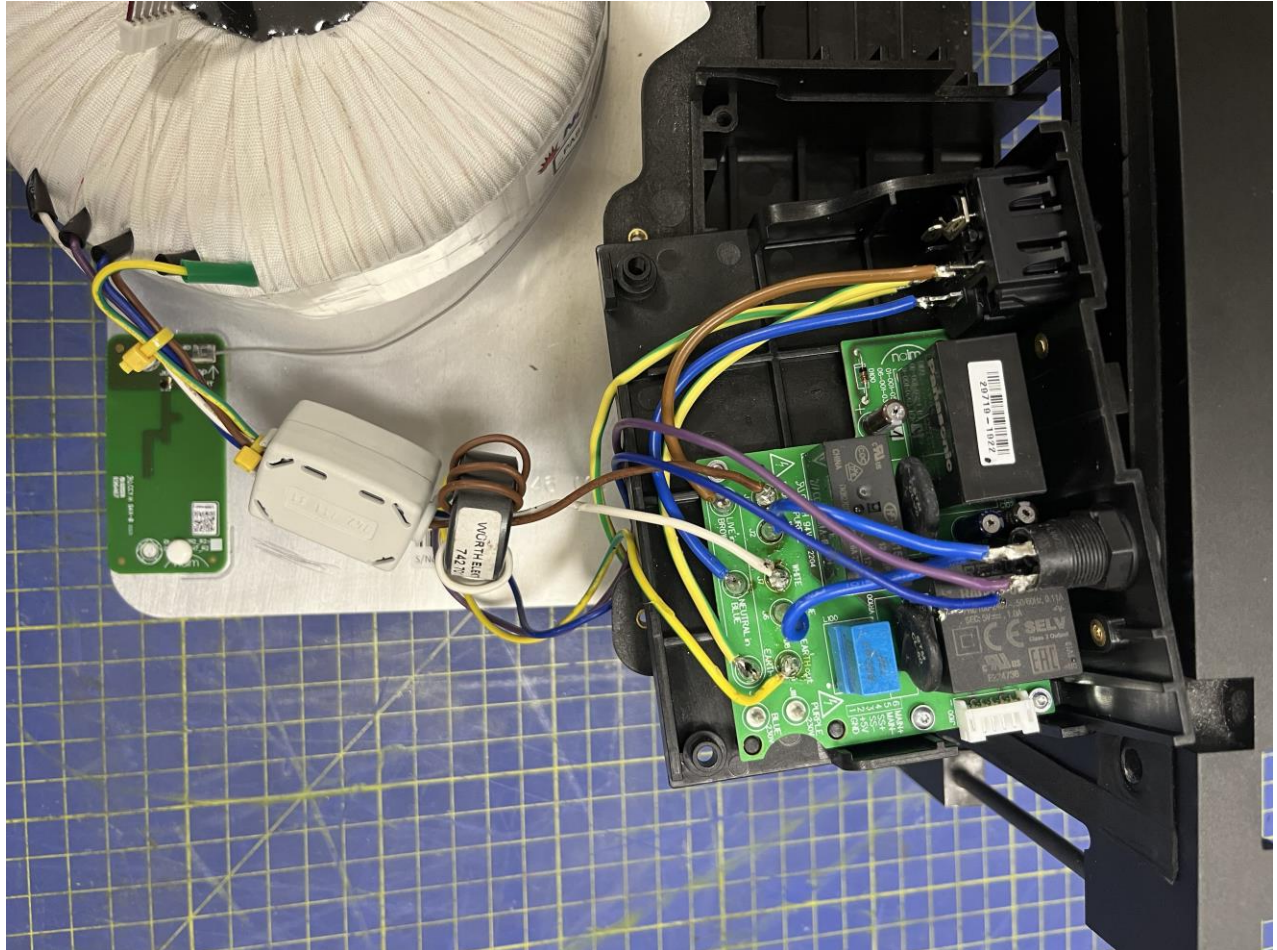


FOCAL



FOCAL JM LAB®


Logo PCB (Top)

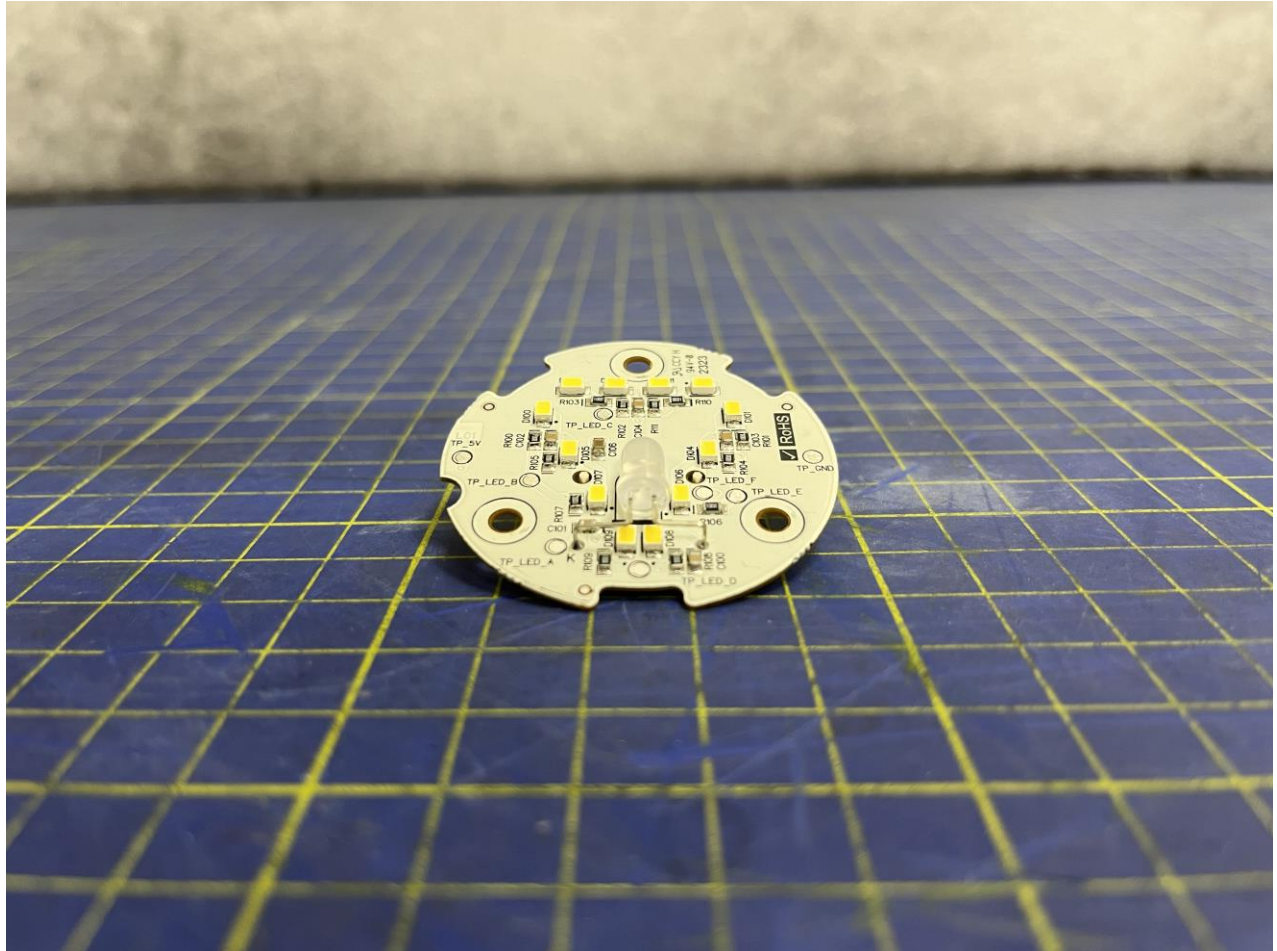

BP 374 ■ 108, rue de l'Avenir ■ 42353 La Talaudière cedex ■ France ■ T. +33 (0) 477 435 700 ■ F. +33 (0) 477 435 701
SAS au capital de 1 062 080 € ■ RCS Saint-Etienne ■ 344 394 309 ■ VAT number : FR 49 344 394 309

FOCAL JM LAB®

Logo PCB (Bottom)

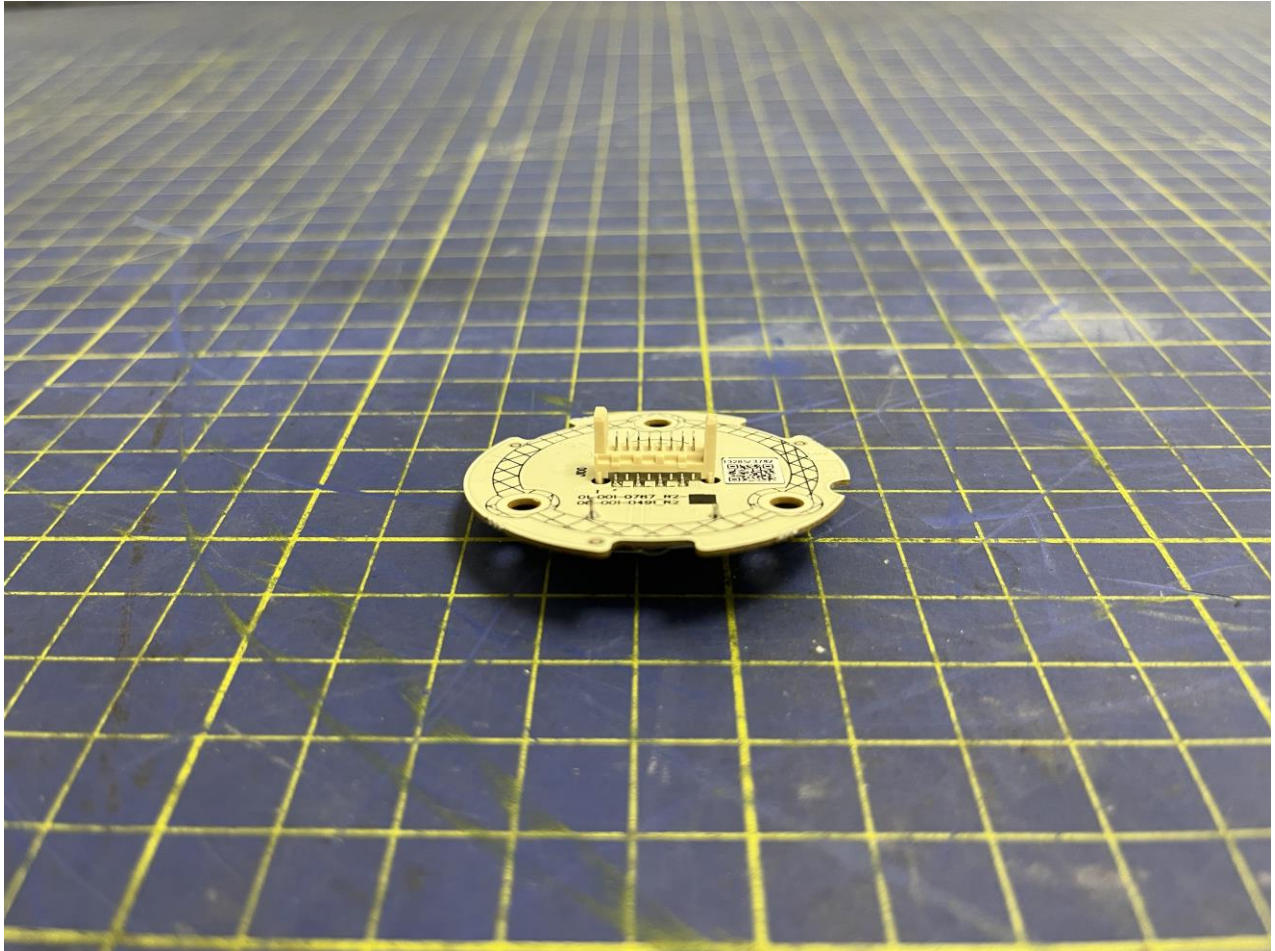


FOCAL



FOCAL JM LAB®

Inputs PCB (Top)

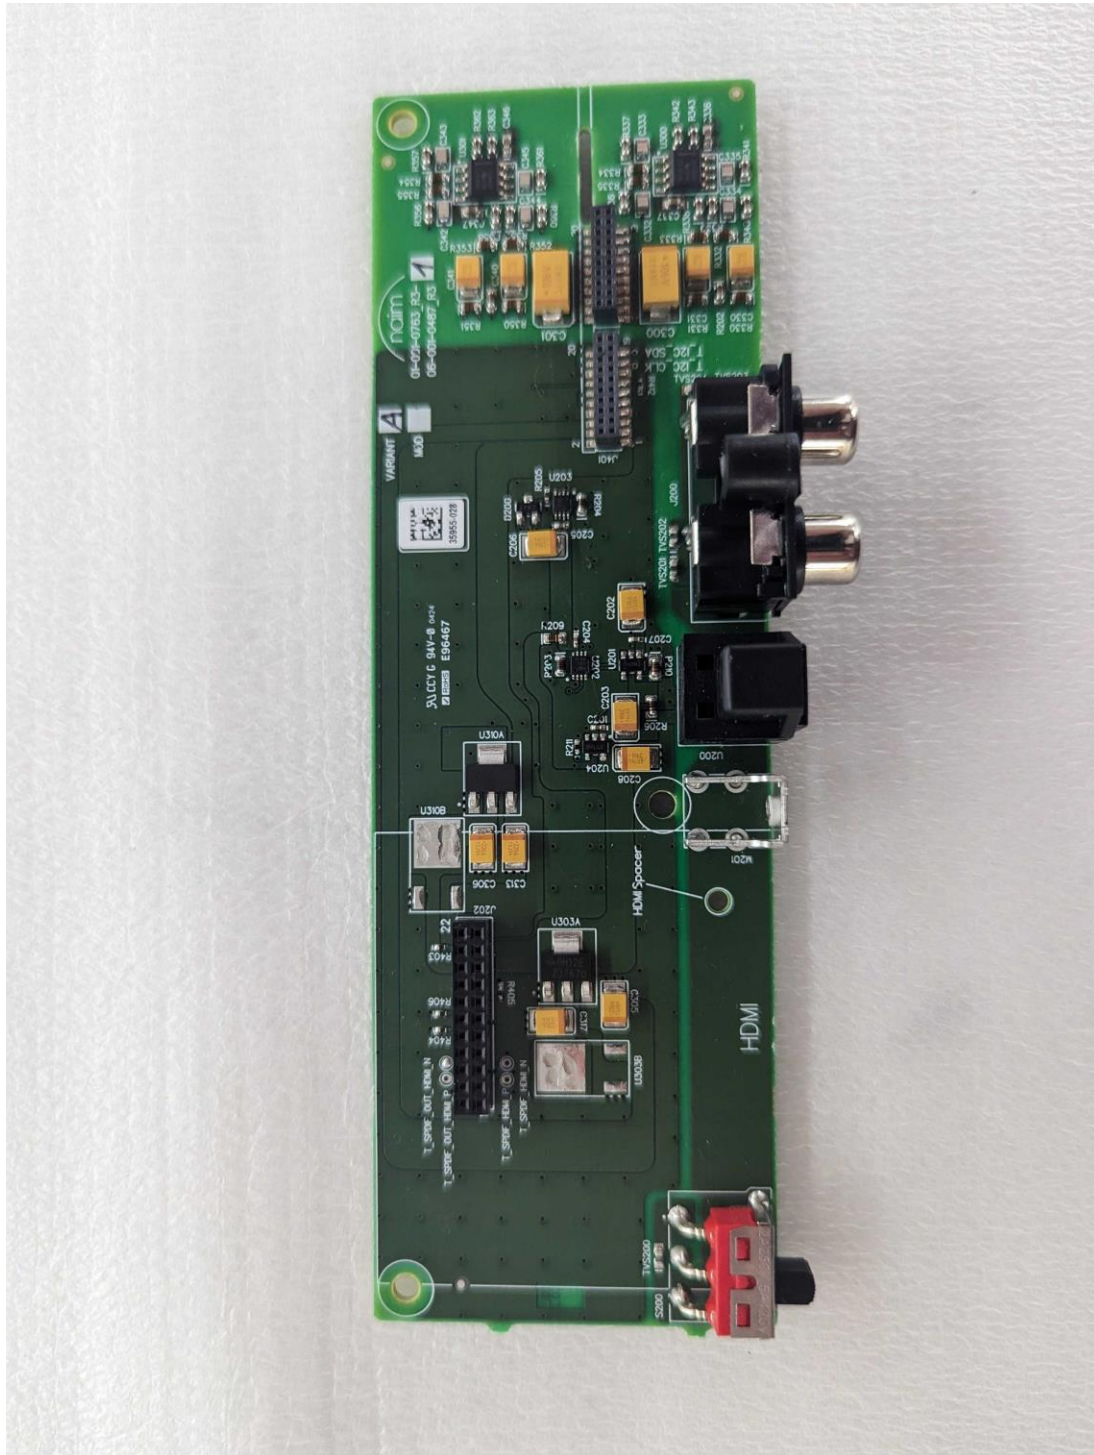


FOCAL



BP 374 ■ 108, rue de l'Avenir ■ 42353 La Talaudière cedex ■ France ■ T. +33 (0) 477 435 700 ■ F. +33 (0) 477 435 701
SAS au capital de 1 062 080 € ■ RCS Saint-Etienne ■ 344 394 309 ■ VAT number : FR 49 344 394 309

FOCAL JM LAB®

Inputs PCB (Bottom)

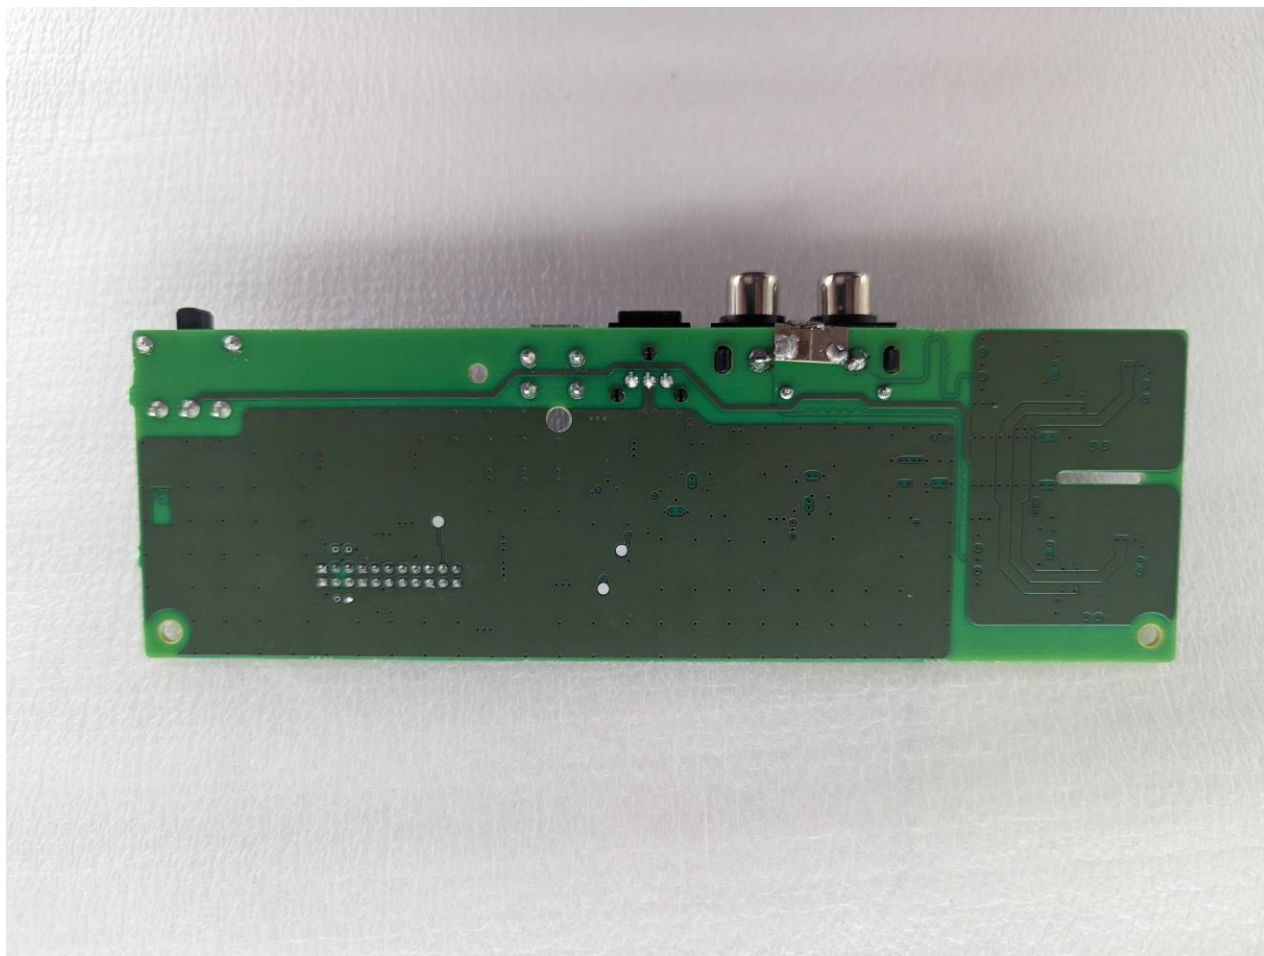


FOCAL




FOCAL JM LAB®

Inputs Connecting PCB (Top)

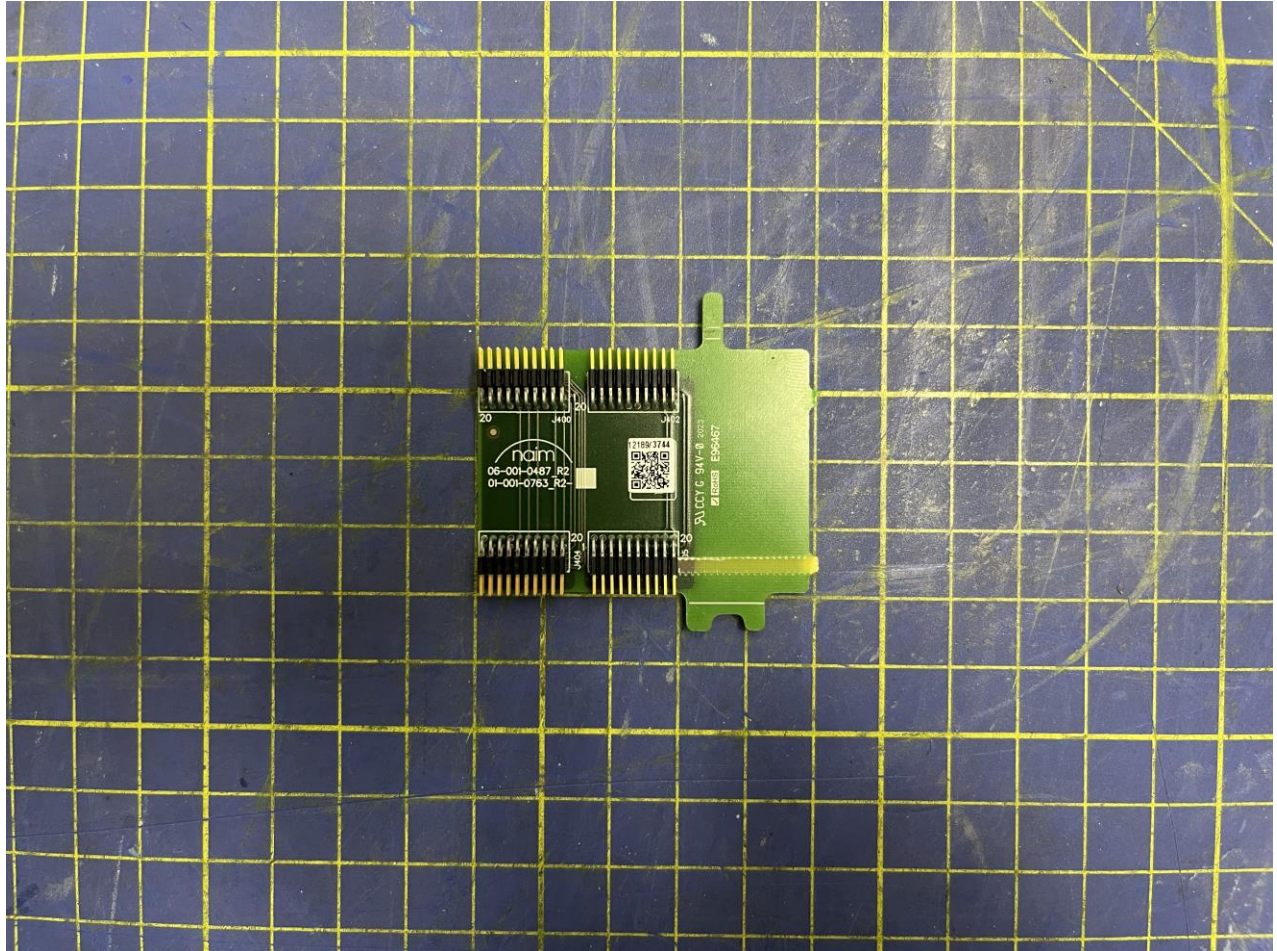


FOCAL JM LAB®

Inputs Connecting PCB (Bottom)

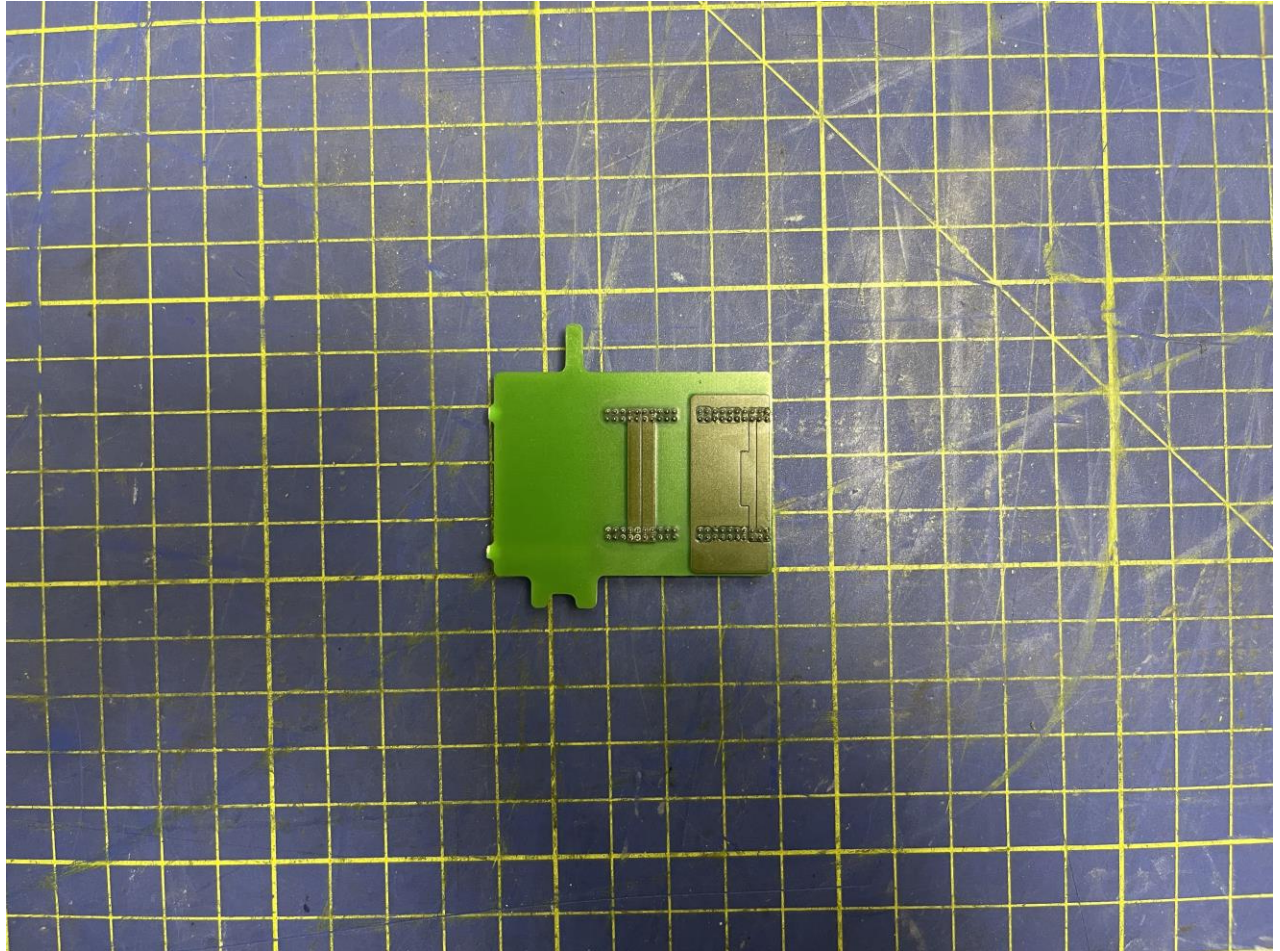

FOCAL JM LAB®

UWB SR1020 module (Top):

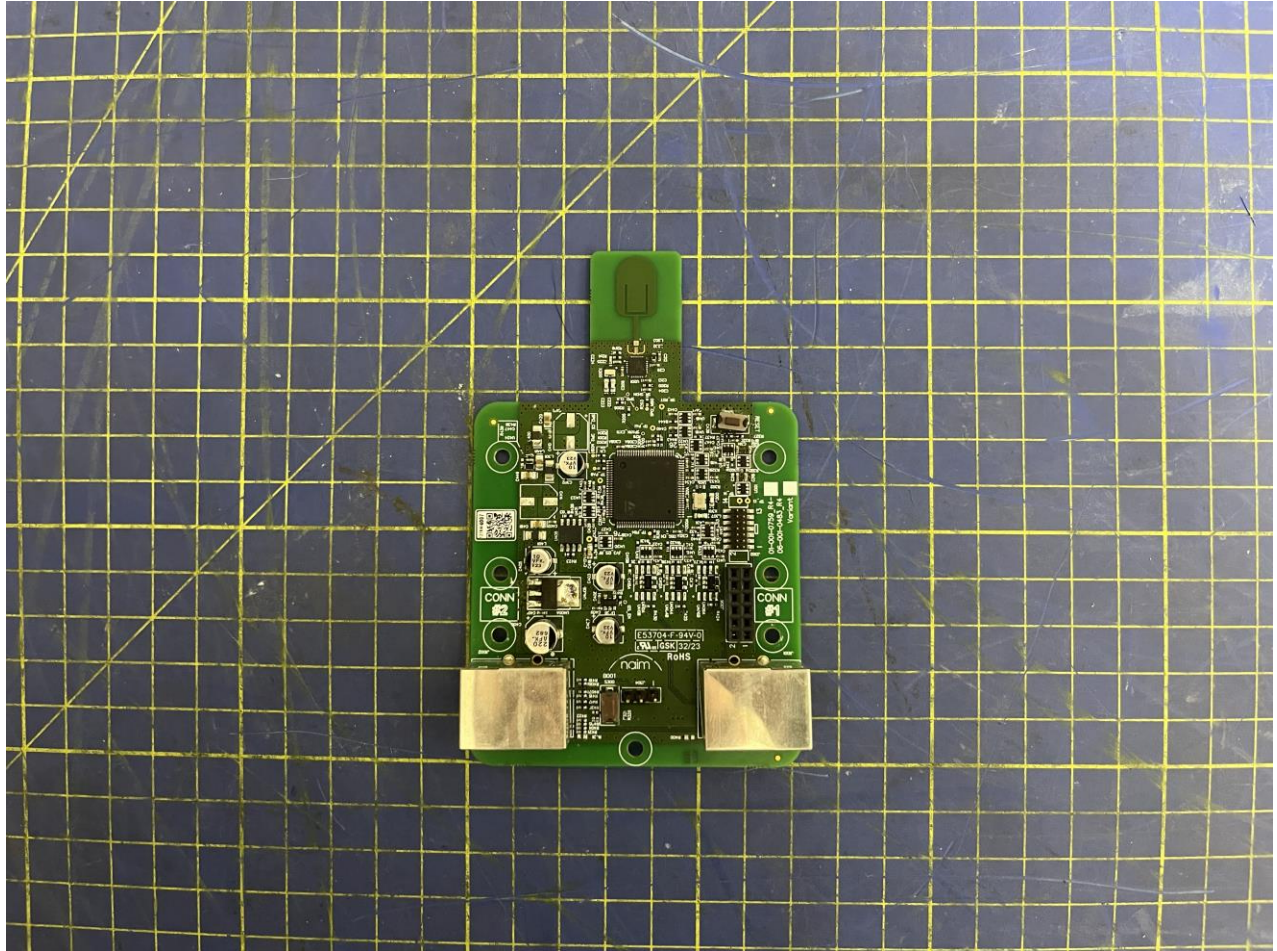


FOCAL



FOCAL JM LAB®

UWB SR1020 module (Bottom):

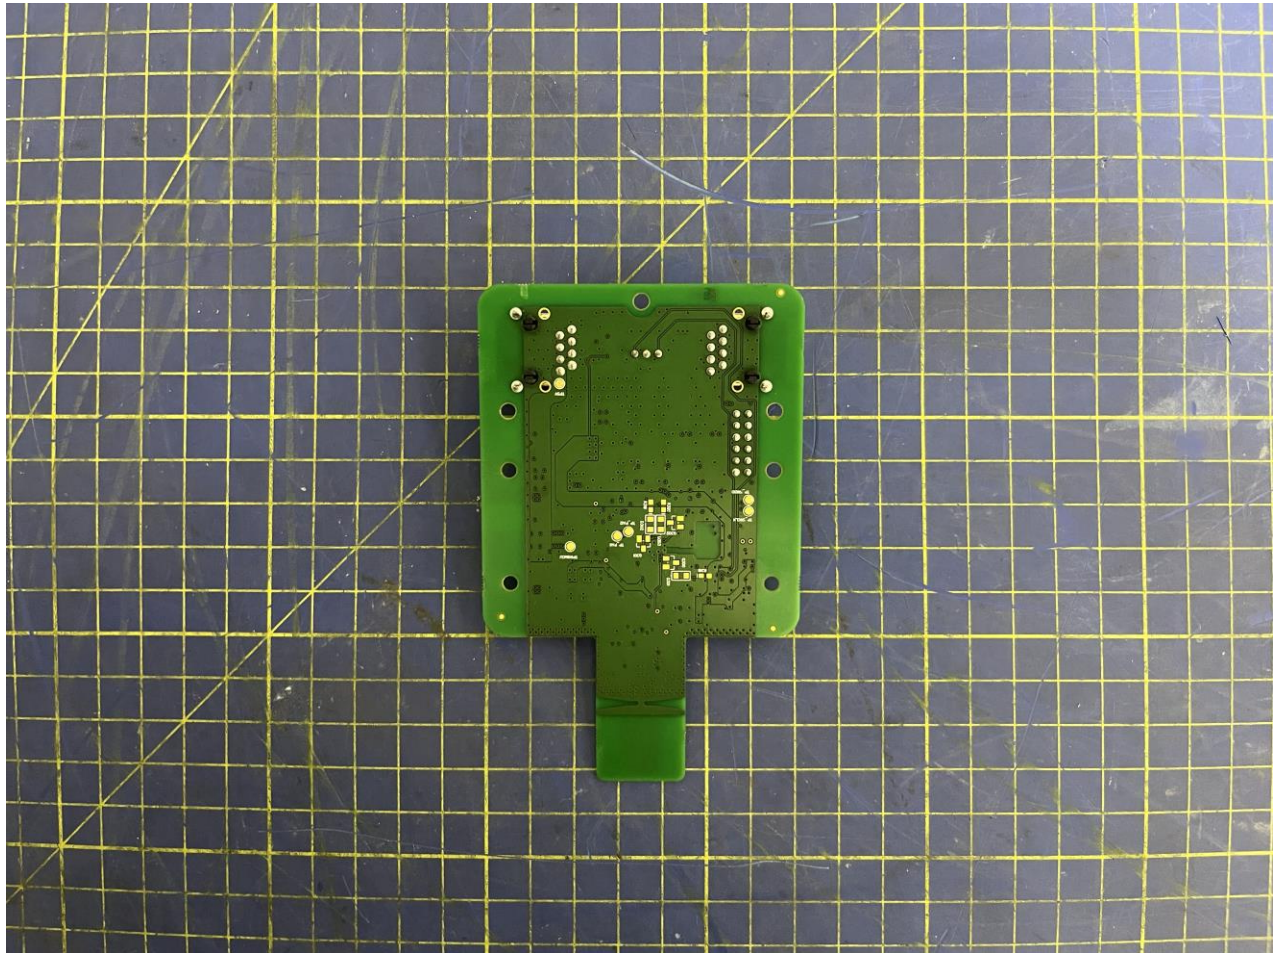

FOCAL

