


OSCILLOSCOPE PRESENTATION
MICROAIR, T2000 Transponder
2001-OCT-08, 12:01, MON

POWER: HIGH
MODULATION: INTERNAL
REMARK: DETECTED PULSE

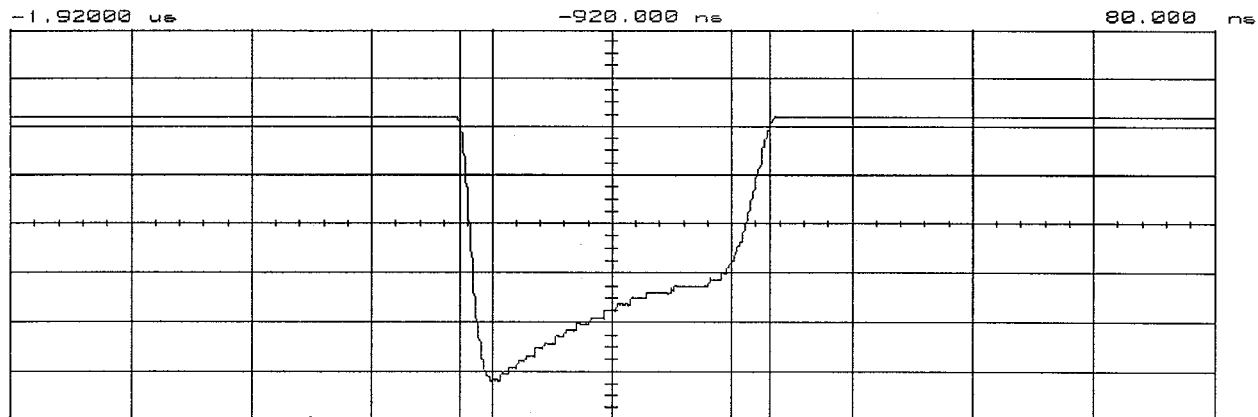

Main	Timebase	Delay/Pos	Reference	Markers	
	200 ns/div	-920.000 ns	Center	delta t	= 850.000 ns
Channel 1	Sensitivity	Offset	Probe		
	200 mV/div	-450.000 mV	1.000 :1		

Trigger mode : Edge
On Positive Edge Of Chan1
Trigger Level
Chan1 = -450.000 mV (noise reject OFF)
Holdoff = 40.000 ns