


OSCILLOSCOPE PRESENTATION
 MICROAIR, T2000 Transponder
 2001-OCT-08, 12:01, MON

POWER: HIGH
 MODULATION: INTERNAL
 REMARK: DETECTED PULSE

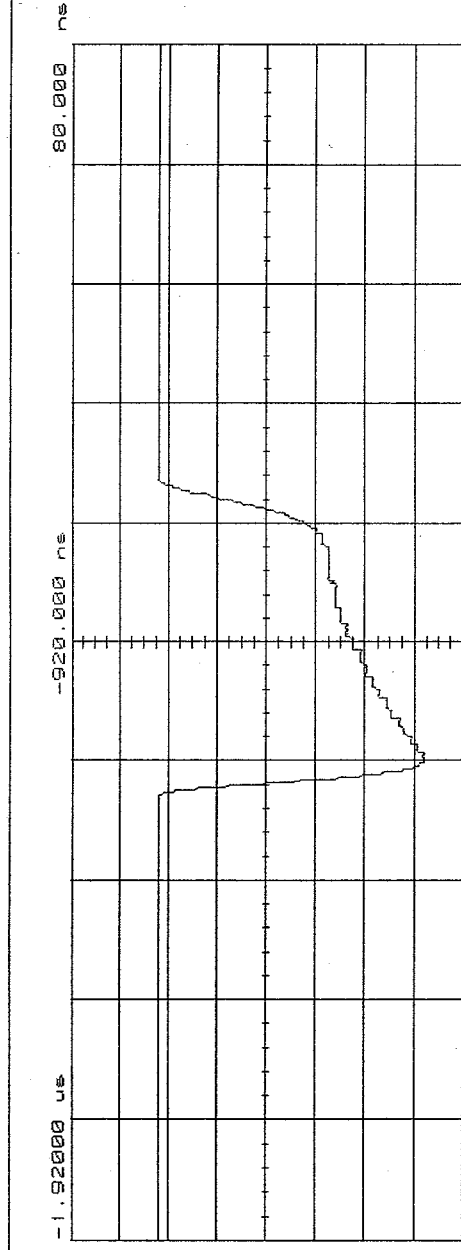

Main	Timebase 200 ns/div	Delay/Pos -920.000 ns	Reference Center	Markers delta t	= 533.000 ns
Channel 1	Sensitivity 200 mV/div	Offset -450.000 mV	Probe 1.000 :1		

Trigger mode : Edge
 On Positive Edge Of Chan1
 Trigger Level
 Chan1 = -450.000 mV (noise reject OFF)
 Holdoff = 40.000 ns