

TEST SITE PHOTOS

UNDERGROUND

8748 Country Lane, Manassas, VA



T-3314

F6 8
A

WARNING
Keep away from
energized parts
and equipment
WARNING
Do not touch
energized parts
and equipment

100

NO PCBs
1000 Parts 1111



TEST SITE PHOTOS

UNDERGROUND

8754 Country Lane, Manassas, VA

57-11-8-2

T 3362

F67

100-KVA

WARNING

HIGH VOLTAGE

INSIDE THIS ENCLOSURE

UNDERGROUND POWER CABLES
ARE LOCATED IN THIS AREA.
NEEDS CORRODING STAINLESS
STEEL. PLEASE CALL TOLL FREE
"WISS UTILITY" (800) 527-5772



DO NOT ERECT ANY STRUCTURE
WITHIN 5 FEET OF THIS
ENCLOSURE. DO NOT PLACE
PLANTS WITHIN 5 FEET OF
ACCESS DOORS.

FOR FURTHER INFORMATION
PLEASE SEE MEMBER HANDBOOK OR CALL NEAREST DISTRICT OFFICE
NORTHERN VIRGINIA ELECTRIC COOPERATIVE

NO PCBs
(LESS THAN 2 P.P.M.)

THIS UNIT HAS BEEN CLASSIFIED BY:

NAME: PLY DATA

DATE: (month/year)

SCREEN TESTING:

OTHER VERIFICATION:



DANGER
HIGH VOLTAGE

H1A

H1B

X3

X1

X2

TEST SITE PHOTOS

UNDERGROUND

8757 Country Lane, Manassas, VA

57-11-8-1

T3361
F77

100-KVA


WARNING
WARNING
HIGH VOLTAGE
INSIDE
--KEEP OUT
For Your Safety
UNDERGROUND CABLES
In This Area
CALL (800) 257-7777
24 Hours



NO PCBs
(LESS THAN 2 P.P.M.)

THIS UNIT HAS BEEN CLASSIFIED BY:	
DATE PLACED IN SERVICE	DATE REMOVED FROM SERVICE
TESTING METHOD	TESTING METHOD
TESTING METHOD	TESTING METHOD



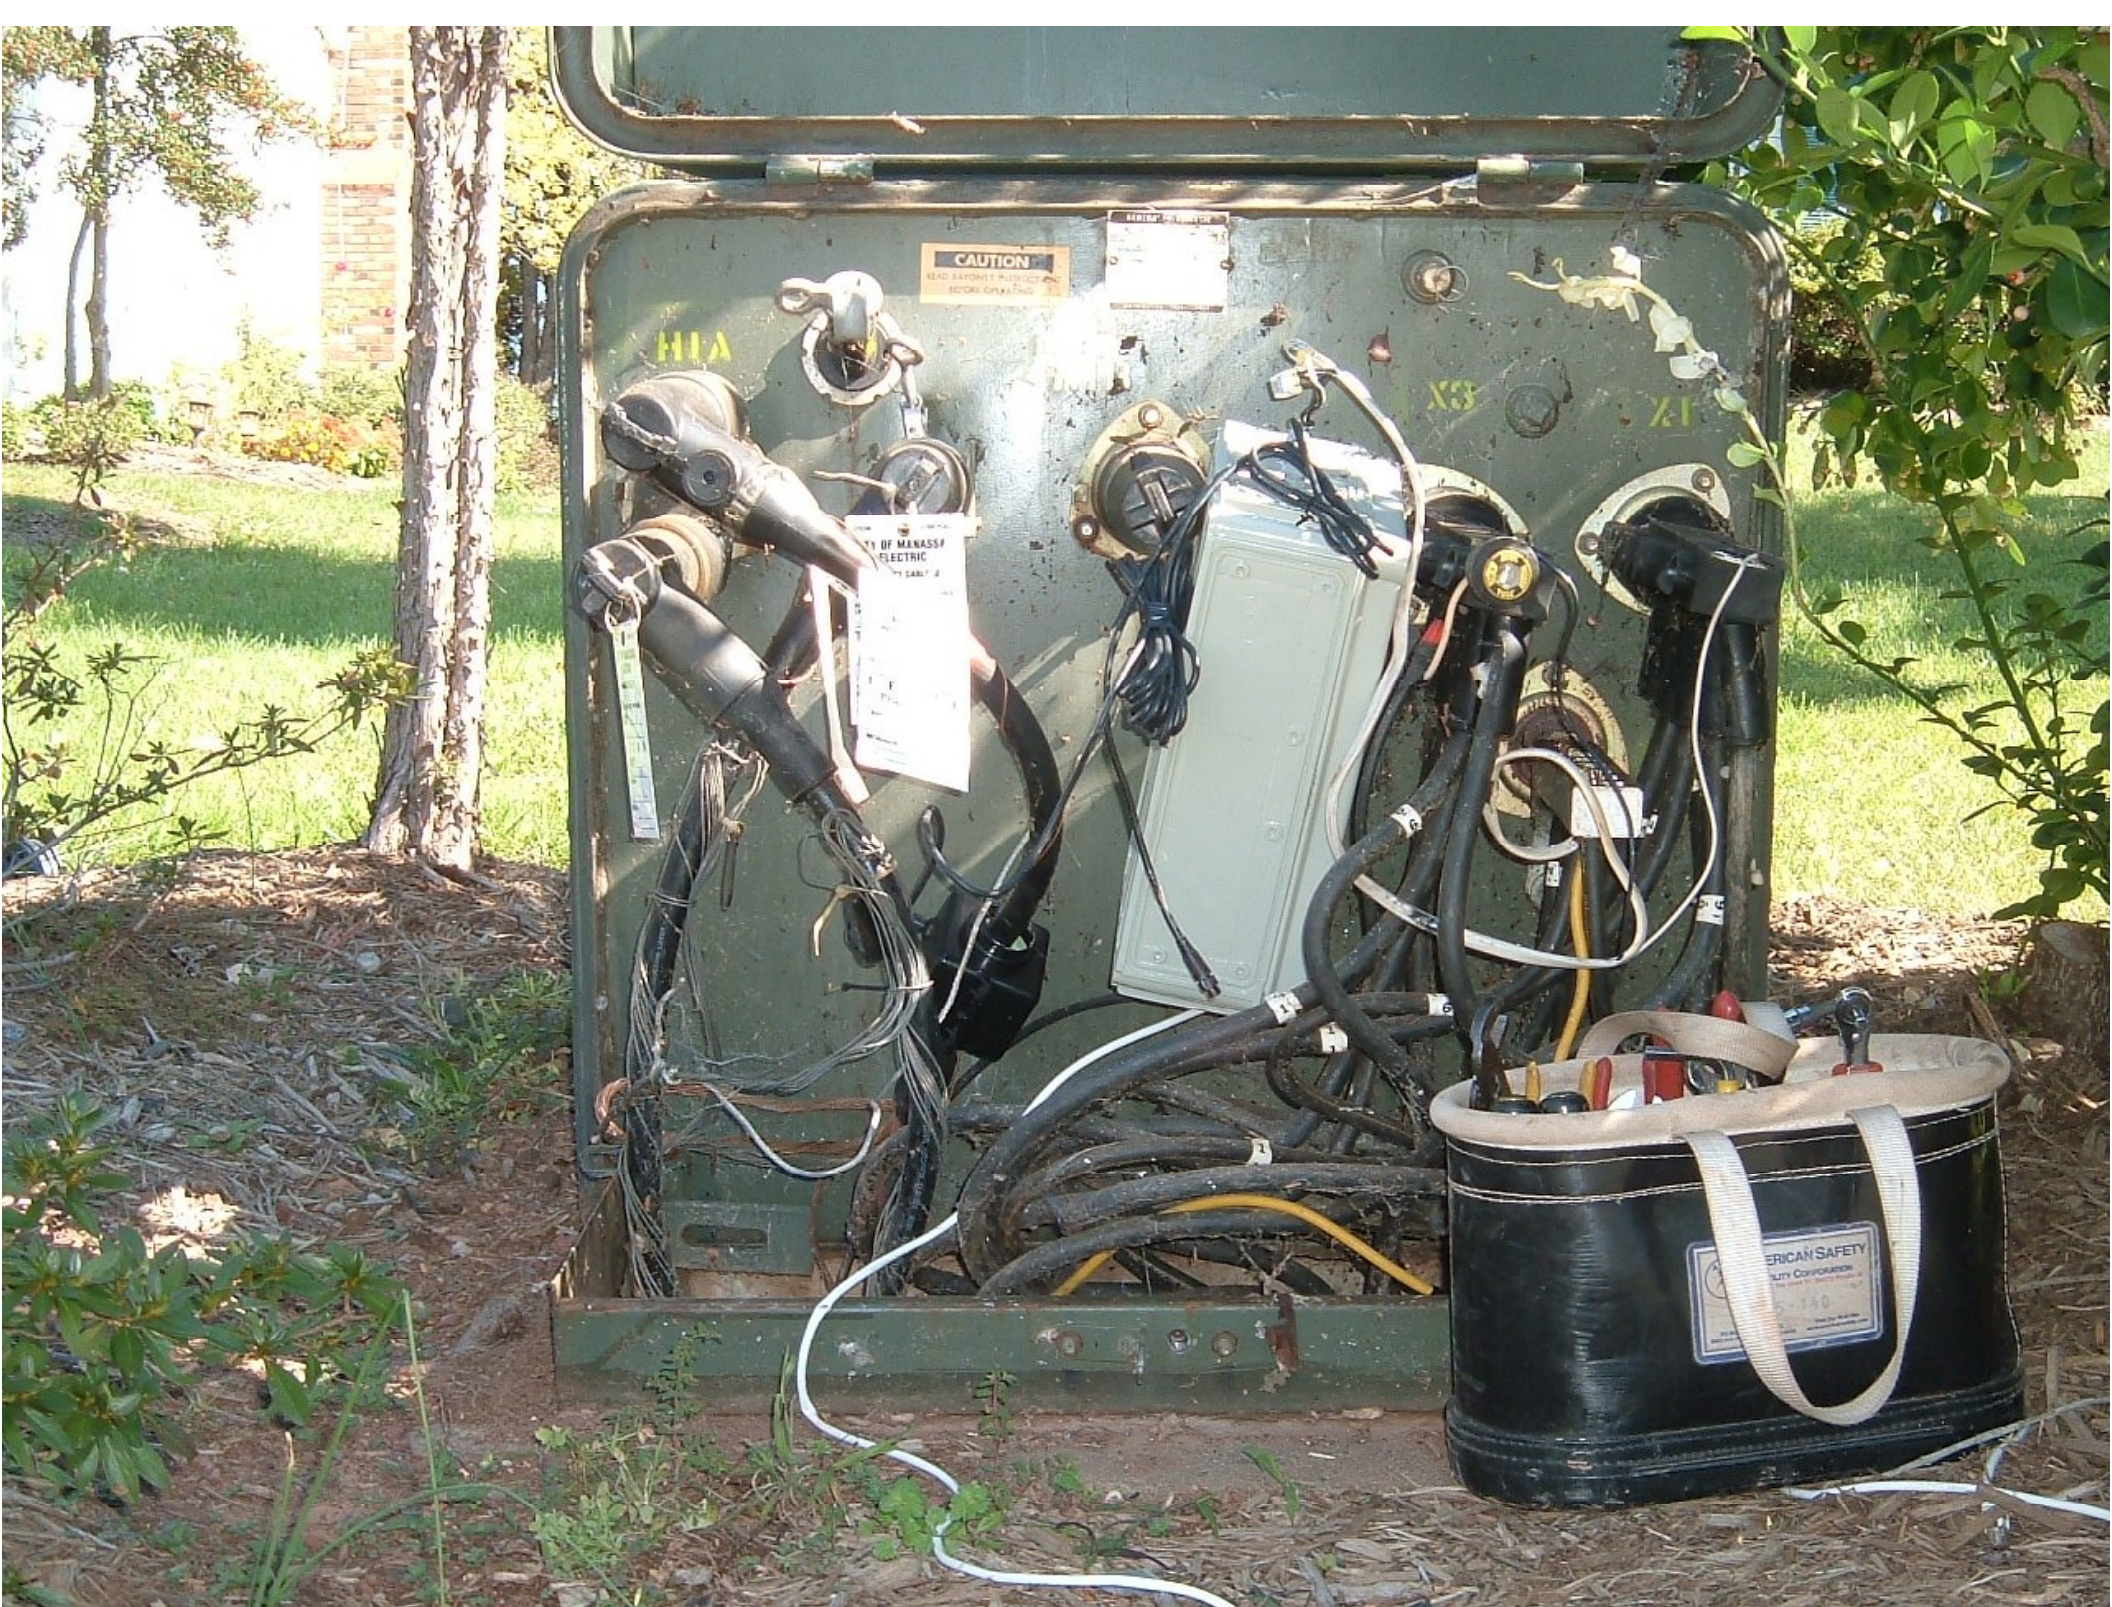

CAUTION
READ BEFORE OPERATING

H1A

X3

X1

CITY OF MANASSA
ELECTRIC
UTILITY

AMERICAN SAFETY
CORPORATION
SAFETY EQUIPMENT