



REV NO	DATE	SIGN
B 7670	981124	SEC


10867/99system/052221/94104


 <b>ALLGON SYSTEM AB</b> Box 541, S-183 25 TÄBY SWEDEN P/N Rev: ARXXXX/XXX RYZ Serial no: Year/Week:      Sign:		Status/Modification  Manufacturer Serial number  AS00000000
--	--	--

75

XXXX/XXX is to be changed to  
article number

YZ is to be changed to  
revision no and letter.

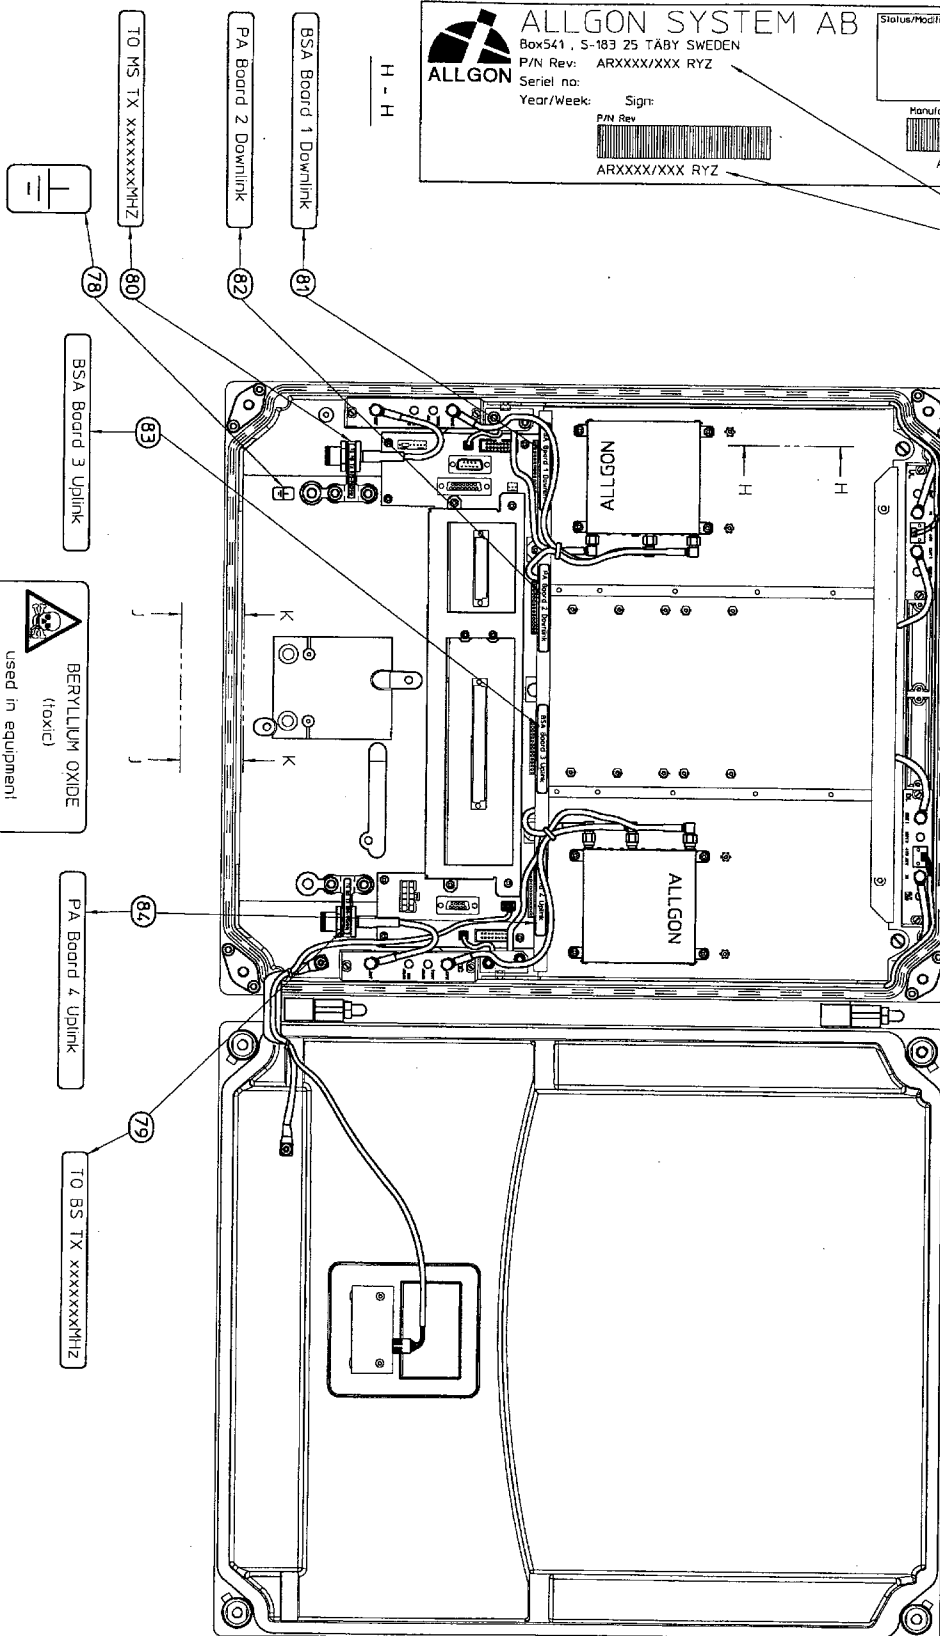

 **BERYLLIUM OXIDE**  
(toxic)  
used in equipment!  
see instruction book

K - K

<b>ALLGON</b> Model: Cerebro: The device complies with part 21 of the FCC rules and is approved for operation in the U.S. The device is designed to operate in the 218-221 MHz band and is not to be used for any other purpose. The device is not to be used in the presence of any other radio equipment, including interference from other users of the same band. See also:		Art Nr: YYYYY/YYY Ser Nr: XXXXX
---	--	------------------------------------

76

(YYYY/YYY is to be changed to article number)  
(XXXXX is to be changed to serial no)

J - J

POS. N°	NAME	MATERIAL / DRAW	DM	NOTE
11	A2 980302SNH	Technical drawing		
12	A2 980302SNH	Technical drawing		
13	A2 980302SNH	Technical drawing		
<b>ALLGON SYSTEM AB</b> <b>SWEDEN</b> <b>REPEATER</b> <b>BS 800</b> Drawing number: AR4200/052-221 Revision: B				