

RAD-900-IFS

900 MHz wireless transceiver (transmitter and receiver) with RS-232 and RS-485 interface, can be extended with I/O extension modules



INTERFACE

Data sheet
3225_en_A

© PHOENIX CONTACT 2013-03-25

1 Description

Wireless communication is based on Trusted Wireless 2.0 technology. The high demand for a interference-free data transmission using the license-free 900 MHz band, in particular via the use of the FHSS method (FHSS) and 128-bit data encryption (AES), is fulfilled.

In addition to an RS-232 and RS-485 2-wire interface, the **RAD-900-IFS** wireless module supports the option of directly connecting up to 32 I/O extension modules in the station structure via the TBUS DIN rail connector.

Addressing of the wireless module and I/O mapping of the I/O extension modules is carried out quickly and easily by means of the thumbwheel on the front. Programming knowledge is not required.

The PSI-CONF configuration and diagnostics software for special functionality and diagnostic options in the wireless module is available free of charge.

Features

- Flexible network applications: I/O data, serial data, PLC/Modbus RTU mode
- Adjustable data rates for the wireless interface
- Easy point-to-point or network structures (star, repeater)
- Quick and easy startup thanks to simple wireless module addressing using the thumbwheel on the front
- Integrated RS-232 and RS-485 interface
- Can be extended with up to 32 I/O modules per station via T-BUS (hot-swappable)
- 128-bit data encryption (AES)
- Unique network addressing via plug-in configuration memory (RAD-CONF) for secure, parallel operation of multiple networks (different RF bands)
- Data rates and ranges can be adjusted



This product is only for export outside of the European Economic area.



Make sure you always use the latest documentation.
It can be downloaded from the product at phoenixcontact.net/products.



This data sheet is valid for all products listed on the following page:

2 Table of contents

1	Description	1
2	Table of contents	2
3	Ordering data	3
4	Technical data	4
5	Safety regulations and installation notes.....	7
5.1	Installation notes	7
5.2	Installation and operation.....	7
5.3	Safety regulations for installation in potentially explosive areas	7
5.4	Conformance.....	8
6	Installation	9
6.1	Structure	9
6.2	Basic circuit diagram	9
6.3	Display and diagnostic elements	10
6.4	Assembly/removal	12
6.5	Connecting the cables	13
6.6	Serial pin assignment	13
7	Startup and configuration	15
7.1	Resetting to the default settings.....	15
7.2	Setting the station address (RAD-ID)	16
7.3	I/O data transmission	16
7.4	Serial data transmission	16
7.5	PLC/Modbus RTU mode	17
7.6	Behavior of the input and output modules in the event of an interrupted wireless connection	17
7.7	Saving the wireless network	17
7.8	Copying device settings to new network devices	18
7.9	PSI-CONF configuration and diagnostics software	18
8	Application example	19


3 Ordering data

Description	Type	Order No.	Pcs. / Pkt.
Bidirectional, Radioline 900 MHz transceiver for wireless transmission of serial and I/O data	RAD-900-IFS	2901540	1
Accessories	Type	Order No.	Pcs. / Pkt.
Analog/digital I/O extension module with 2 digital inputs/outputs (0...250 V AC/DC) and 1 analog input (0/4...20 mA) and output (0/4 ... 20 mA, 0...10 V), with screw connection, incl. DIN rail connector	RAD-DAIO6-IFS	2901533	1
Digital I/O extension module with 4 digital inputs (0...250 V AC/DC), with screw connection, incl. DIN rail connector	RAD-DI4-IFS	2901535	1
Digital I/O extension module with 4 digital relay outputs (6 A, 250 V AC/ 24 V DC), with screw connection, incl. DIN rail connector	RAD-DOR4-IFS	2901536	1
Analog extension module with 4 analog current inputs (0/4 mA ... 20 mA), with screw connection, incl. DIN rail connector	RAD-AI4-IFS	2901537	1
Analog I/O extension module with 4 analog current/voltage outputs (0/4 mA ... 20 mA, 0...10 V), with screw connection, incl. DIN rail connector	RAD-AO4-IFS	2901538	1
DIN rail connector for DIN rail power supply unit, gold-plated contacts, for DIN rail mounting, 5-pos.	ME 17,5 TBUS 1,5/ 5-ST-3,81 GN	2709561	10
Memory stick for saving individual configuration data for the Radioline wireless module	RAD-MEMORY	2902828	1
USB data cable (USB-A on IFS plug) for communicating between PCs and PHOENIX CONTACT devices with an IFS data port, e.g., RAD-2400-IFS. Power supply for diagnostics and configuration via the USB port of the PC. Cable length: 2 m.	RAD-CABLE-USB	2903447	1
Antenna cable, 0.5 m in length; N (male) -> RSMA (male), impedance 50 ohms	RAD-PIG-RSMA/N-0.5	2903263	1
Antenna cable, 1 m in length; N (male) -> RSMA (male), impedance 50 ohms	RAD-PIG-RSMA/N-1	2903264	1
Antenna cable, 2 m in length; N (male) -> RSMA (male), impedance 50 ohms	RAD-PIG-RSMA/N-2	2903265	1
Antenna cable, 3 m in length; N (male) -> RSMA (male), impedance 50 ohms	RAD-PIG-RSMA/N-3	2903266	1
Adapter, N (female) -> N (female); insertion attenuation < 0.3 dB at 2.4 GHz	RAD-ADP-N/F-N/F	2867843	1
Vulcanizing sealing tape for external protection of adapters, cable connections, etc. against the effects of weather, roll length: 3 m	RAD-TAPE-SV-19-3	2903182	1
DIN rail power supply unit, primary-switched mode, slim design, output: 24 V DC / 1.5 A	MINI-SYS-PS-100-240AC/24DC/1.5	2866983	1
Attachment plug with surge protection for coaxial signal interfaces. Connection: N connector, female/female	CN-UB-70DC-6-BB	2803166	1
Attachment plug with Lambda/4 technology as surge protection for coaxial signal interfaces. Connection: N connectors female connector/female connector	CN-LAMBDA/4-2.2-BB	2800024	1
Antenna cable, 3 ft. in length, type N (male) to type N (male), 50 Ω impedance	RAD-CAB-LMR240-3	5606169	1
Antenna cable, 10 ft. in length, type N (male) to type N (male), 50 Ω impedance	RAD-CAB-LMR240-10	5606124	1
Antenna cable, 20 ft. in length, type N (male) to type N (male), 50 Ω impedance	RAD-CAB-LMR400-20	5606125	1
Antenna cable, 25 ft. in length, type N (male) to type N (male), 50 Ω impedance	RAD-CAB-LMR500-25	5606126	1
Antenna extension cable, length: 40 ft	RAD-CAB-RG213-40	2867377	1
Antenna extension cable, length: 50 ft	RAD-CAB-RG213-50	2867225	1
Antenna extension cable, length: 60 ft	RAD-CAB-LMR400-60	2867380	1

Accessories	Type	Order No.	Pcs. / Pkt.
Antenna extension cable, length: 80 ft	RAD-CAB-LMR400-80	2867393	1
Antenna extension cable, length: 100 ft	RAD-CAB-LMR400-100	2867238	1
Antenna extension cable, length: 150 ft	RAD-CAB-LMR600-150	2885184	1
Antenna extension cable, length: 200 ft	RAD-CAB-LMR900-200	2885197	1
Omnidirectional antenna, IP65 protection, gain 5 dBi, connection N (female)	RAD-ISM-900-ANT-OMNI-FG-3-N	2867791	1
Omnidirectional antenna, IP65 protection, gain 7 dBi, connection N (female)	RAD-ISM-900-ANT-OMNI-5	2867199	1
Panel antenna, IP65 protection, gain 5 dBi, cable length 1.5 m, connection N (female)	RAD-ISM-900-ANT-YAGI-3-N	2867801	1
Omnidirectional antenna, IP65 protection, gain 8 dBi, connection N (female)	RAD-ISM-900-ANT-OMNI-FG-6-N	2885579	1
Panel antenna, IP65 protection, gain 8.5 dBi, cable length 1.5 m, connection N (female)	RAD-ISM-900-ANT-YAGI-6.5-N	2867814	1
Yagi directional antenna, 12.15 dBi gain, 2 ft. RG-213 cable with type N (female) connector	RAD-ISM-900-ANT-YAGI-10-N	5606614	1

4 Technical data

Dimensions (nominal sizes in mm)

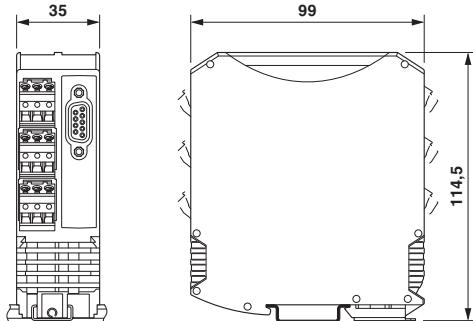

Dimensions W / H / D

35 mm / 99 mm / 114.5 mm

General data

Surge voltage category	II
Degree of protection	IP20
Pollution degree	2
Type of housing	PA 6.6-FR , green
Inflammability class according to UL 94	V0

Supply

Supply voltage range	10.8 V DC ... 30.5 V DC
Transient surge protection	Yes

Wireless interface

Antenna connection method	RSMA (female)
Direction	Bi-directional
Frequency	900 MHz
Frequency range	902 MHz ... 928 MHz

Wireless interface

Data transmission rate (adjustable)

16 kbps
125 kbps
250 kbps
500 kbps

Receiver sensitivity

-112.00 dBm (16 kbps)
-105.00 dBm (125 kbps)
-102.00 dBm (250 kbps)
-95.00 dBm (500 kbps)

Transmission power

max. 1 W (adjustable)

Security

128-bit data encryption

RS-232 Interface , 3-conductor

Connection method

COMBICON plug-in screw terminal block

Data rate

0.3 ... 115.2 kbps

RS-485 Interface , 2-wire

Connection method

COMBICON plug-in screw terminal block

Data rate

0.3...115.2 kbps

Termination resistor (switchable via DIP switches)

390 Ω
150 Ω
390 Ω

RSSI output

Number of outputs

1

Voltage output signal

0 V ... 3 V

RF link relay output

Number of outputs

1

Contact type

PDT

Contact material

PdRu, gold-plated

Maximum switching voltage

30 V AC
60 V DC

Max. switching current

500 mA

Electrical service life

5 x 10⁵ cycles with 0.5 A @ 30 V DC

Test voltage**Connection data**

Connection method

Screw connection

Conductor cross section, solid

0.2 mm² ... 2.5 mm²

Conductor cross section, stranded

0.2 mm² ... 2.5 mm²

Conductor cross section AWG/kcmil

24 ... 14

Stripping length

7 mm

Tightening torque

0.6 Nm

Status indication

Status display

Green LED (supply voltage, PWR)
Green LED (bus communication, DAT)
Red LED (periphery error, ERR)
3 x green, 1 x yellow LED (LED bar graph receive quality, RSSI)
Green LED (RS-232/485 receive data, RX)
Green LED (RS-232/485 transmit data, TX)

Ambient conditions

Ambient temperature (operation)	-40 °C ... 70 °C -40 °F ... 158 °F
Ambient temperature (storage/transport)	-40 °C ... 85 °C -40 °F ... 185 °F
Permissible humidity (operation)	20 % ... 85 %
Permissible humidity (storage/transport)	20 % ... 85 %
Altitude	2000 m
Vibration (operation)	In accordance with IEC 60068-2-6: 5 g, 10 Hz - 150 Hz
Shock	16 g, 11 ms

Certification

Conformance	FCC Directive, Part 15.247 ISC Directive RSS 210
-------------	---

5 Safety regulations and installation notes

5.1 Installation notes



Please note that, in combination with antennas, the maximum permissible transmission power may be exceeded. Please set the transmission power via the software.

The use of antennas with a gain greater than 6 dBi may require that the transmit power be reduced from the default setting of 30 dBm. Regulations limit the equivalent isotropically-radiated power (EIRP) to 36 dBm. The EIRP may be calculated as the transmit power (Pt) minus any cable loss (Lc) plus the antenna gain (Ga).

$$\text{EIRP} = \text{Pt} - \text{Lc} + \text{Ga}$$

For example, in the case of a 12 dBi antenna used with a cable run with a 4 dB loss, the transmit power must be reduced to 28 dBm or less such that the EIRP does not exceed 36 dBm.



The PSI-CONF configuration and diagnostic software can be used to configure the transmit power.



Operation of the wireless system is only permitted if accessories available from Phoenix Contact are used. The use of other accessory components may invalidate the device approval status.

5.2 Installation and operation

Follow the installation instructions.



NOTE: Installation, operation, and maintenance may only be carried out by qualified specialist personnel.

Error-free operation of this device can only be ensured if transport, storage, and assembly are carried out correctly and operation and maintenance are carried out with care.

When installing and operating the device, the applicable safety directives (including national safety directives), accident prevention regulations, as well as general technical regulations, must be observed.



WARNING: Risk of electric shock

During operation, certain parts of this device may carry hazardous voltages. Disregarding this warning may result in damage to equipment and/or serious personal injury.



NOTE: Access to circuits within the device is not permitted.

Provide a switch/circuit breaker close to the device, which is labeled as the disconnect device for this device.

Provide overcurrent protection ($I \leq 6 \text{ A}$) in the installation.



During maintenance work, disconnect the device from all effective power sources.



NOTE: The IP20 degree of protection (IEC 60529/EN 60529) of the device is intended for a clean and dry environment. Do not subject the device to mechanical and/or thermal loads that exceed the specified limits.

5.3 Safety regulations for installation in potentially explosive areas

Installation in areas with a danger of dust explosions



WARNING: Explosion hazard

The device has not been designed for use in potentially dust-explosive atmospheres.

5.4 Conformance

FCC



NOTE:

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference, in which case, the user will be required to correct the interference at his own expense.

Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

This equipment complies with the FCC RF radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with a minimum distance of 20 cm between the radiator and your body.

- FCC certificate: SGV-SHR-900

Industry Canada (IC)

Operation is subject to the following two conditions: (1) this device may not cause interference, and (2) this device must accept any interference, including interference that may cause undesired operation of the device.

To reduce potential radio interference to other users, the antenna type and its gain should be so chosen that the equivalent isotropically radiated power (EIRP) is not more than that permitted for successful communication.

This device has been designed to operate with the antennas listed in this document and having a maximum gain of 12 dB. Antennas not included in this list or having a gain greater than 12 dB are strictly prohibited for use with this device. The required antenna impedance is 50 Ω.

Under Industry Canada regulations, this radio transmitter may only operate using an antenna of a type and maximum (or lesser) gain approved for the transmitter by Industry Canada. To reduce potential radio interference to other users, the antenna type and its gain should be so chosen that the equivalent isotropically radiated power (EIRP) is not more than that necessary for successful communication.

- IC certificate: IC4270C-SHR900

6 Installation



NOTE: electrostatic discharge!

The device contains components that can be damaged or destroyed by electrostatic discharge. When handling the device, observe the necessary safety precautions against electrostatic discharge (ESD) according to EN 61340-5-1 and EN 61340-5-1.

6.1 Structure

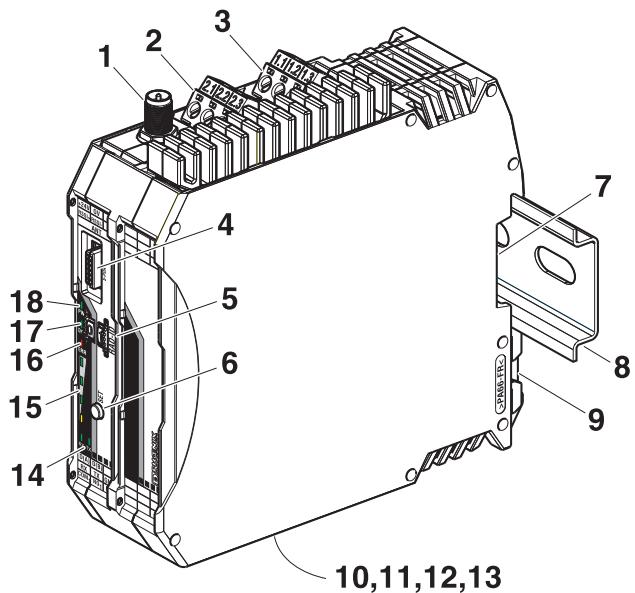


Figure 1 RAD-900-IFS

Pos.	Designation
1	RSMA antenna connection (socket)
2	Test output RSSI (0...3 V DC) for evaluation of the wireless signal strength
3	Device supply (+24 V DC, GND)
4	12-pos. programming interface (S-PORT)
5	RAD ID address setting via thumbwheel
6	SET button
7	Connection option for TBUS DIN rail connector
8	DIN rail
9	DIN rail release latch
10	Connection terminal block RS-485 interface
11	Connection terminal block RS-232 interface
12	Relay output with PDT contact (floating)
13	9-pos. D-SUB connector (RS-232 interface)
14	RS-232/485 serial interface status LED (RX/TX)
15	LED bar graph for displaying the wireless signal strength
16	ERR status LED, red (communication error)
17	DAT status LED, green (BUS communication)
18	PWR status LED, green (supply voltage)

6.2 Basic circuit diagram

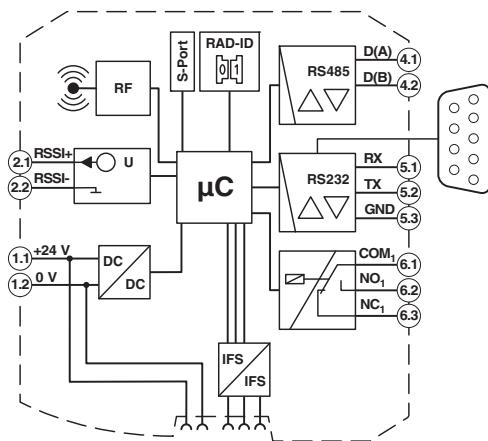


Figure 2 Circuit diagram

6.3 Display and diagnostic elements

Nine LEDs on the RAD-900-IFS indicate the operating status.

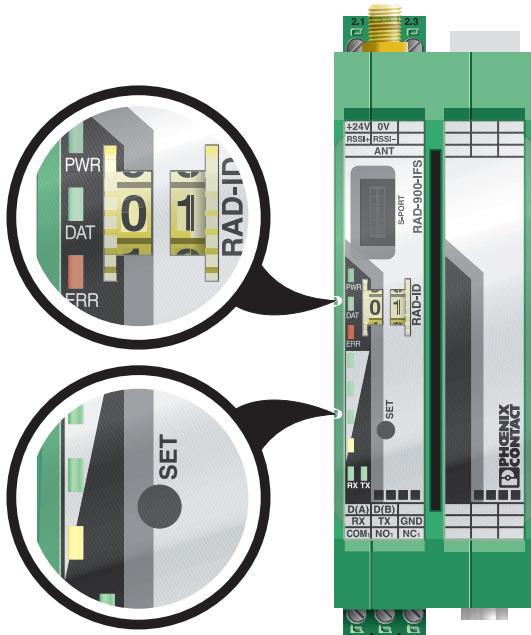


Figure 3 Display and diagnostic elements

PWR LED

The green PWR LED indicates the supply voltage status.

- Off: No supply voltage
- On: Supply voltage OK

DAT LED

The green DAT LED indicates the bus communication status.

- Off: No communication
- Flashing: Configuration mode
- On: Cyclic data communication

ERR LED

The red ERR LED indicates the error status, e.g., no corresponding output module found (e.g., incorrect addressing).

- Off: No error
- Flashing: Slow (1.4 Hz)
 - Wireless module in I/O data mode (wire in/wire out):** double assignment of the I/O MAP address, missing input module, missing output module, modified RAD ID
 - Wireless module in PLC/Modbus RTU mode:** double assignment of the I/O MAP address, modified RAD ID, no Modbus communication
 - Example: watchdog active
 - Wireless connection interrupted
- On: Local bus error
 - Example: input or output module not read

LED bar graph

The LED bar graph indicates the receive signal strength.

Bar graph	LEDs	Receive signal	RSSI (in V)
█ █ █ █	All 4 LEDs light up	Maximum signal strength	2.5 ... 3 V
		16k -75 dBm	
		125k -70 dBm	
		250k -65 dBm	
		500k -60 dBm	
█ █ █ █	Yellow and 2 green LEDs light up	Very good signal	2 ... 2.5 V
		16k -85 dBm	
		125k -80 dBm	
		250k -75 dBm	
		500k -70 dBm	
█ █ █ █	Yellow and 1 green LEDs light up	Good signal	1.5 ... 2 V
		16k -95 dBm	
		125k -90 dBm	
		250k -85 dBm	
		500k -80 dBm	
█ █ █ █	Yellow LED lights up	Low signal	1 ... 1.5 V
		16k LINK	
		125k LINK	
		250k LINK	
		500k LINK	
█ █ █ █	OFF	Not connected	0 V

LED bar graph - light sequence

The light sequence from bottom to top signalizes a firmware update or that the wireless module is in write mode for the memory stick (see Section 7.6).



Observe the maximum permissible emitted transmission power of 30 dBm. This is determined based on: Device transmission power + Antenna gain - Cable attenuation. Reduce the device transmission power, if necessary.



The antenna is mounted outside the control cabinet/building. Observe the installation instructions for the antenna used. See also "Safety regulations and installation notes".

As the full transmission power and the reception amplifier are activated by default, signals may be superimposed. Increase the distance between devices.

TX LED

The green TX LED indicates communication (transmit data) with the RS-232/RS-485 interface.

RX LED

The green RX LED indicates communication (receive data) with the RS-232/RS-485 interface.

SET button

The SET button is used to confirm a station change, without performing a power up.

After making any change, press the SET button for one second to apply the settings. The DAT LED starts flashing. When the DAT LED is permanently on this means that read in has been completed.

Station changes include:

- Changing the RAD ID address of the wireless module
- Changing the I/O MAP address of the extension modules
- Adding an I/O extension module
- Removing an I/O extension module
- Using the CONF/memory stick
- Changing the RAD ID address of the wireless module.
- Changing the I/O MAP address of the extension modules.
- Adding an I/O extension module.
- Removing an I/O extension module.
- Using the CONF/memory stick.

RSSI LED bar graph

In a point-to-point connection, the LED bar graph is active on the master and on the repeater/slave. The same signal strength is displayed on both modules.

In a wireless network with more than one repeater/slave, only the yellow LED on the master is permanently on. The signal strength is displayed on the repeaters/slaves. The signal strength is always related to the wireless module which is directly connected.

RF link relay

The RF link relay in the transceiver diagnoses the state of the wireless connection. It picks up when the wireless connection is established. If no data packets are received correctly over a period of 10 s seconds, the relay drops out again.

It picks up again automatically when the wireless connection is re-established.

The RF link relay has been designed as a PDT contact.



The RF link relay can be used as a fault message contact to indicate the failure of the wireless connection to the controller.

RSSI test socket

A voltage measuring device can be connected to the RSSI test socket to measure a voltage, which provides information about the received wireless signal. Using the table shown below the LED bar graph, the received signal strength can be determined using the voltage value. This can be useful when positioning and aligning the antenna, for example.

6.4 Assembly/removal

Connection station with I/O extension modules

Up to 32 different I/O extension modules can be connected to each RAD-900-IFS wireless module via the TBUS DIN rail connector (see accessories). Data is transmitted and power is supplied to the I/O extension modules via the bus foot.



Figure 4 Radioline connection station with up to 32 I/O extension modules



When the wireless module power supply is 19.2 - 30.5 V DC, up to 32 different I/O extension modules can be connected. When the power supply is 10.8 - 17.0 V DC, up to four I/O extension modules can be connected.

The I/O extension modules must only be mounted to the right of the wireless module.



When using the RAD-900-IFS in a connection station, use the supplied 17.5 mm wide DIN rail connectors.

DIN rail mounting



Make sure that the DIN rail connector and device are aligned correctly.

- DIN rail connector (plug) left
- Device (snap-on foot) below

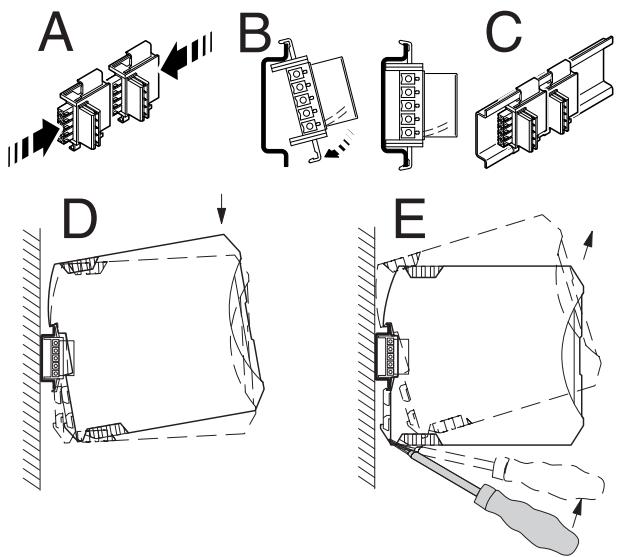


Figure 5 Mounting and removal

1. Place the device onto the DIN rail from above so that the upper housing keyway hooks onto the top edge of the DIN rail.
2. Rotate the device toward the DIN rail so the device bus connector is securely mated with the TBUS connector.
3. Once the foot snaps onto the DIN rail, check that it is fixed securely.

DIN rail removal

1. Use a suitable screwdriver to release the locking mechanism on the snap-on foot of the device.
2. Rotate the bottom of the device off the DIN rail.
3. Carefully lift the device off the DIN rail connector and the DIN rail.

6.5 Connecting the cables

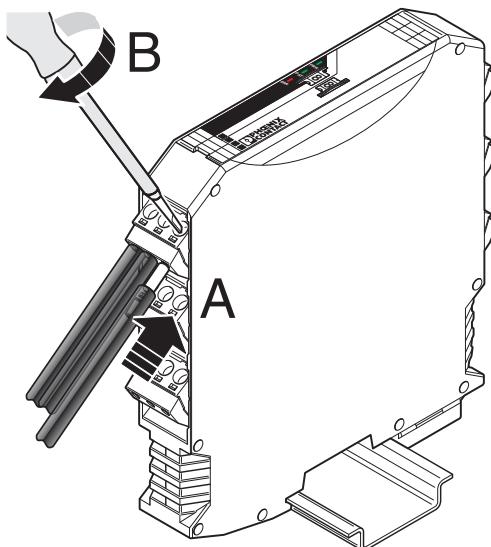


Figure 6 Connecting the cables

- Crimp ferrules to the wires.
Permissible cable cross section: 0.2...2.5 mm².
- Insert the wire with ferrule into the corresponding connection terminal block.
- Use a screwdriver to tighten the screw in the opening above the connection terminal block.
Tightening torque: 0.6 Nm

6.6 Serial pin assignment

Connect the I/O device to the RAD-900-IFS wireless module via the necessary serial interface.



Parallel operation of the interfaces is not possible.

Shielding

Connect the shield of the RS-485 bus cable correctly via an external shield connection clamp.

Choose the type of shield connection according to the type of interference expected:

- Connect the shield on one side to suppress electrical fields.
- To suppress disturbances caused by alternating magnetic fields, connect the shield on both sides. When doing so, the ground loops must be taken into account: galvanic disturbances along the reference potential can interfere with the useful signal, and the shielding effect is reduced.
- If several devices are connected to a single bus, the shield must be connected to each device (e.g., by means of clamps).
- Connect the bus shield to a central PE point using short, low-impedance connections with a large surface area (e.g., by means of shield connection clamps).



NOTE:

Observe the polarity of the RS-485 2-wire cable and ensure that the shield connection is connected correctly.

A faulty connection of the shield in combination with permanent external interferences can cause damage to the RS-485 interface.

Activating/deactivating the termination network

The RAD-900-IFS wireless module is operated on a 2-wire bus cable. For correct operation of the bus system, termination networks are required for the RS-485 bus connection.

The RS-485 cable must be terminated at both ends of the bus with a 390/150/390 Ω termination network. Depending on the position of the device on the RS-485 cable, this can be implemented as shown in the table below.

Operating mode of the wireless module

The operating mode of the device is set using a termination network depending on the location on the RS-485 bus cable. Select the required operating mode and set it using the DIP switch.

Operating mode	Termination network	DIP switch	
		1	2
RS-485 termination device	activated	ON	ON
RS-485 device	deactivated	OFF	OFF

RS-485 pin assignment

In RS-485 mode, an RS-485 network with several I/O devices can be created. Use a twisted pair bus cable to connect the I/O devices. Fit this bus cable with a termination network at the two furthest points of the RS-485 network.

Connect the individual conductors of the data cable to the COMBICON plug-in screw terminal block.

In RS-232 mode, point-to-point connections can be established.

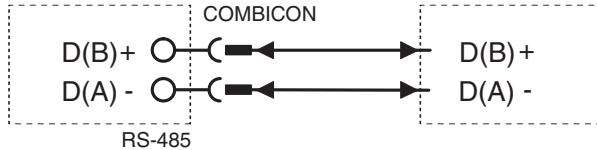


Figure 7 RS-485 interface pin assignment

RS-232 pin assignment



The RS-232 interface is a DCE (data communication equipment) type.

Connect the individual conductors of the data cable to the COMBICON plug-in screw terminal block.

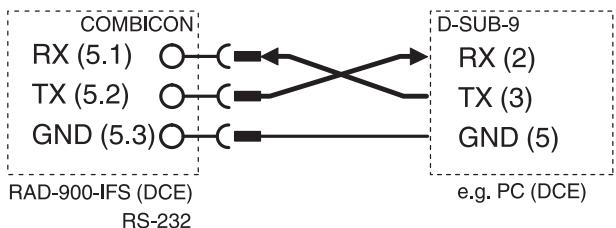


Figure 8 RS-232 interface pin assignment (DCE - DTE)

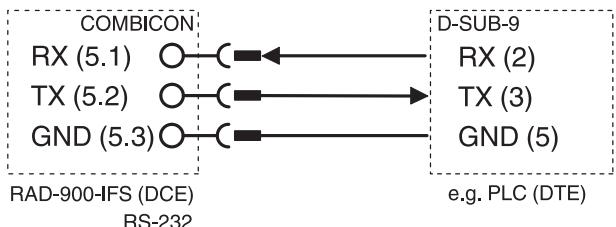


Figure 9 RS-232 interface pin assignment (DTE - DCE)

9-pos. DSUB pin assignment

The RAD-900-IFS provides a D-SUB 9-pos. female connector for attaching RS-232 serial devices.

A **B**

DCE		DTE	
1	-	CD	1
2	TX	RX	2
3	RX	TX	3
4	-	-	4
5	GND	GND	5
6	-	-	6
7	RTS	RTS	7
8	CTS	CTS	8
9	-	RI	9

DCE		DTE	
1	-	CD	1
2	TX	RX	2
3	RX	TX	3
4	-	DTR	4
5	GND	GND	5
6	-	DSR	6
7	RTS	RTS	7
8	CTS	CTS	8
9	-	RI	9

Figure 10 D-SUB 9-pos. straight-through cable pinouts for 3-wire (A) and 5-wire (B)

A **B**

DCE		DTE	
1	-	CD	1
2	TX	RX	2
3	RX	TX	3
4	-	-	4
5	GND	GND	5
6	-	-	6
7	RTS	RTS	7
8	CTS	CTS	8
9	-	RI	9

DCE		DTE	
1	-	CD	1
2	TX	RX	2
3	RX	TX	3
4	-	DTR	4
5	GND	GND	5
6	-	DSR	6
7	RTS	RTS	7
8	CTS	CTS	8
9	-	RI	9

Figure 11 D-SUB 9-pos. null cable pinouts for 3-wire (A) and 5-wire (B)

Antenna connection

The RAD-900-IFS wireless module has an RSMA antenna connection (socket) for connecting an external antenna.

A wide selection of antennas and antenna cables can be found in the "Ordering data" section on page 3.

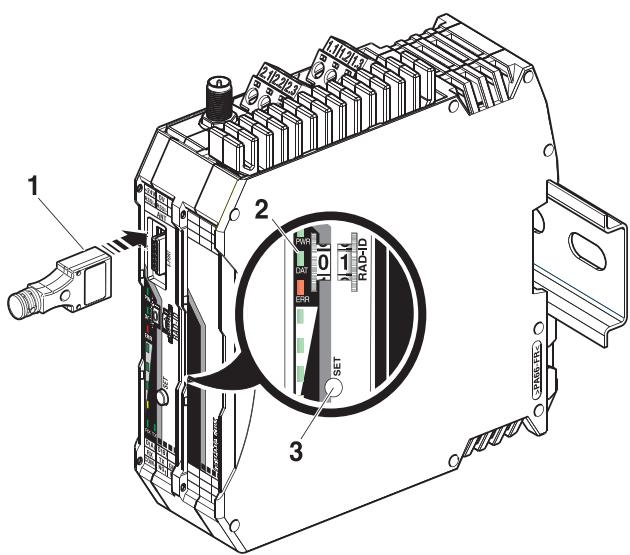


Figure 12 Antenna connection

7 Startup and configuration

All RAD-900-IFS wireless modules have the same default configuration.

Default settings

Operating mode: I/O data mode (wire in/wire out)



Data communication is only possible using I/O extension modules.

Wireless interface

Net ID:	127
RF band:	1
Encryption:	OFF
Network structure:	Star
Device type:	Slave
Blacklisting:	
Data rate of the wireless interface:	125 kbps
Transmission power:	1 W (30 dBm)

For simple I/O data applications (wire in/wire out), addressing is carried out easily using a thumbwheel. You can therefore establish a wireless connection to other RAD-900-IFS devices without any programming effort.

For serial data transmission, PLC/Modbus RTU mode or changes to the “default settings”, each wireless module must be configured using the PSI-CONF configuration and diagnostics software. See Section 7.8, “PSI-CONF configuration and diagnostics software”.

7.1 Resetting to the default settings

1. Disconnect the device from the supply voltage.
2. Press the “SET” button on the front of the device.
3. Switch the supply voltage back on.
4. Press and hold the “SET” button until the “DAT” LED flashes.

Alternatively, you can reset the device to the default settings using the PSI-CONF software.

7.2 Setting the station address (RAD-ID)

The devices in a wireless network are addressed using the thumbwheel on the front of the RAD-900-IFS wireless module.

Set the desired station address with the yellow thumbwheel on the wireless module. This results in an initial functional configuration. There must be one master (address "01") and at least one repeater/slave (address "02 to 99") in a network.



Each address in a network must be unique.

Configuring two wireless modules with the same address will result in a network that does not function correctly.

The following settings can be made using the thumbwheel:

Thumbwheel settings	Description
01	Master address for networks with repeaters (mesh networks)
02 - 99	Repeater/slave addresses for networks with repeaters (mesh networks)
*1	Master address for networks without repeaters (star networks)
*2 - *9	Slave address for networks without repeaters (star networks)
00	Not permitted
**	Addressing wireless modules using the PSI-CONF configuration and diagnostics software (address 1 ... 250)



Setting the address via the thumbwheel has priority over setting the address via the PSI-CONF configuration and diagnostics software.



After making any change to the module address, press the "SET" button for one second to apply the setting.

7.3 I/O data transmission

In order to enable the transmission of signals, you must assign a corresponding output module to the input module.

The following conditions must be met:

Wireless module in I/O data mode (default setting)

Use the white thumbwheel on the I/O extension module to set the I/O MAP address (01 ... 99).

The input device must be provided with the same I/O MAP address as the assigned output device at the other wireless station (I/O mapping).

The I/O MAP address may only appear once in the network.

Exception: outputs with the same address can occur multiple times in different stations on the network.



Figure 13 Example: 2 RAD-DAIO6-IFS with the same address

Once the desired number of I/O extension modules have been connected to the wireless module via the DIN rail connector, the active configuration of the station must be read in via the "SET" button (item 6 in Figure 1) on the front of the wireless module.



After making any change to the I/O MAP address (I/O extension module), you must press the "SET" button on the wireless module to apply the configuration.

After making any change to the station (e.g., I/O MAP address, RAD ID address, adding or removing an I/O extension module, etc.), you must press the "SET" button on the wireless module for 1 s to apply the configuration.



Connect a maximum of 32 I/O extension modules if the power supply is 19.2 - 30.5 V DC. Connect a maximum of 4 I/O extension modules if the power supply is 10.8 - 19.2 V DC.

7.4 Serial data transmission

For serial data communication, you have to activate the "serial data" mode in the PSI-CONF software. Set the interface parameters of the RS-232 or RS-485 interface such as data rate, parity, stop bits, and data bits according to the connected application.

For configuration, you need the RAD-CABLE-USB cable (Order No. 2903447).

7.5 PLC/Modbus RTU mode

For configuration, you need the RAD-CABLE-USB cable (Order No. 2903447).

Activate the PLC/Modbus RTU mode in the PSI-CONF software.

In PLC/Modbus RTU mode (I/O to serial), you can wirelessly connect I/O modules directly to a controller. The wireless module provides an RS-232 or RS-485 interface for this purpose.

In PLC/Modbus mode, the wireless master works as a Modbus slave and has its own Modbus address. The Modbus address is a unique address, which is only assigned for the wireless master (RAD-ID = 1). You can select an address 1 ... 247.

You can connect I/O extension modules to each wireless device in the network. A wireless network can have a maximum of 99 I/O extension modules. Each I/O MAP address may only appear once in a network.

Use the white thumbwheel on the I/O extension module to set the I/O MAP address (01 ... 99).

Output modules and input modules must have different I/O MAP addresses with one exception: output modules with the same address can occur multiple times in different stations on the network.

Input and output data is stored in a Modbus Memory Map in the master wireless module.

The process data tables can be found in the I/O extension modules' data sheets.

7.6 Behavior of the input and output modules in the event of an interrupted wireless connection

DIP switches on the I/O extension modules can be used to set how the analog and digital outputs should behave in the event of interrupted wireless connection.

"HOLD" DIP switch

If the wireless connection is interrupted, the outputs of the I/O extension modules retain their last value or state.

"RESET" DIP switch

If the wireless connection is interrupted, the outputs of the I/O extension modules are reset (output value is set to 0).

7.7 Saving the wireless network

Using a CONFSTICK (see accessories in the "Ordering data" section on page 3), you can configure a unique and secure network. This enables the parallel operation of multiple networks (using different RF bands).

The CONFSTICK is inserted in the S-PORT (item 4 in Figure 1) of the RAD-900-IFS wireless module. Once applied, the information is loaded in an internal memory.



WARNING: Explosion hazard

Do not insert or remove the CONFSTICK or memory stick in a potentially explosive atmosphere.



You have to configure each individual network device. To this end, you only need one CONFSTICK for all wireless modules in the network.

After configuration, you can remove the CONFSTICK from the wireless module.

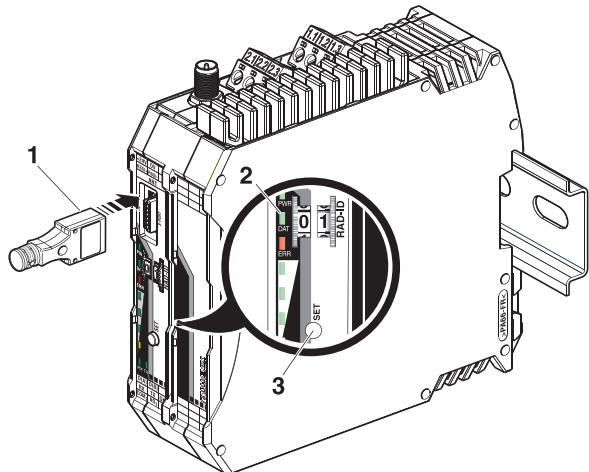


Figure 14 Configuration via CONFSTICK

1 RAD-CONF-RF... CONFSTICK

2 Status LEDs

3 "SET" button

The CONFSTICK contains: RF band (3, 5 or 7) and a unique network ID

The CONFSTICK is used as a network key.

Device configuration transfer using the CONFSTICK

1. Insert the CONFSTICK in the S-PORT of the RAD-900-IFS.
2. Press the "SET" button on the device for 1 second to start the parameter transfer.
3. When the DAT LED flashes once, the transfer process is complete. The new parameters are activated.
4. Remove the CONFSTICK from the RAD-900-IFS.

7.8 Copying device settings to new network devices

Your individual configuration data can be saved to a memory stick (RAD-MEMORY, see accessories in the "Ordering data" section on page 3), e.g., to transfer the same configuration to other devices.

Common network parameters:

- Operating mode
- Network ID
- RF band
- Data rate of the wireless interface
- Encryption
- Network type

Individual device parameters:

- Station name
- RAD ID
- Transmission power
- List of permitted connections
- Serial interface parameters

Writing a full copy of the individual device parameters and common network parameters to the memory stick (RAD-MEMORY):

1. Press and hold the "SET" button on the RAD-900-IFS for at least six seconds. The four RSSI bar graph LEDs start a light sequence from bottom to top.
2. Insert the memory stick in the S-PORT of the device. The copying of the parameters starts automatically.
3. Wait until the RSSI bar graph LEDs reach the static state or the light sequence stops, indicating the write process is complete.
4. Remove the memory stick from the RAD-900-IFS.

Reading in common network parameters via the memory stick:

This function enables common network parameters to be read in from the memory stick. This means that all network devices can have the same network parameters.

1. Insert the memory stick in the S-PORT of the RAD-900-IFS.
2. Press the "SET" button on the device for 1 second to start the parameter transfer.
3. When the DAT LED flashes once, the transfer process is complete. The new parameters are activated.
4. Remove the CONFSTICK from the RAD-900-IFS.

Reading in a full copy of the individual device parameters and common network parameters via the memory stick:

This function enables all individual device parameters and common network parameters to be read in from the memory stick. This means that a full copy of devices can be created. This can be used, for example, to create a backup copy of a device for device replacement.

1. Insert the memory stick in the S-PORT of the device. The copying of the parameters starts automatically.
2. Press and hold the "SET" button on the RAD-900-IFS for at least six seconds. The DAT LED flashes to indicate the transfer is started.
3. When the DAT LED stops flashing the transfer process is complete and the new parameters are activated.
4. Remove the memory stick from the RAD-900-IFS.

7.9 PSI-CONF configuration and diagnostics software

Special settings for the RAD-900-IFS are made using the PSI-CONF configuration and diagnostics software.

This is available to download at www.phoenixcontact.com.

Use the RAD-CABLE-USB USB cable (Order No. 2903447) for configuration and diagnostics.



A PC with a Windows® operating system is required in order to use the configuration and diagnostics software.

8 Application example

Thanks to a wide range of integrated functions, the RAD-900-IFS wireless module can be used in various ways for different applications.

Point-to-point connections

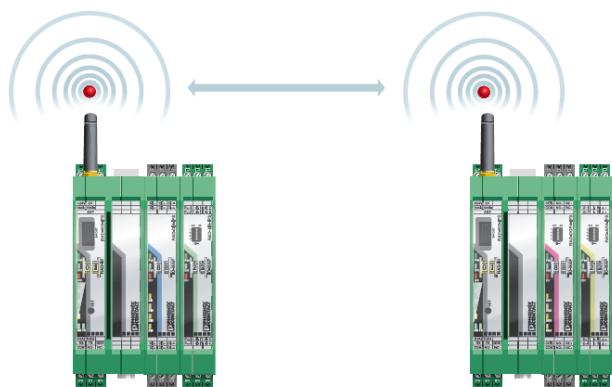


Figure 15 Example of point-to-point connection

Star network

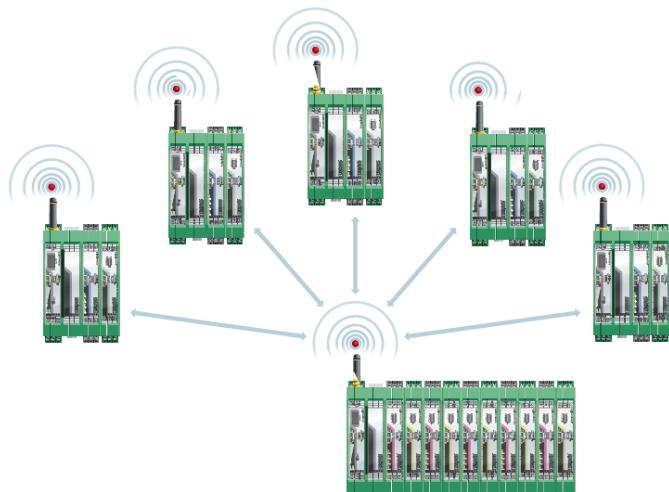


Figure 16 Example of multipoint-to-point connection

Self-healing network

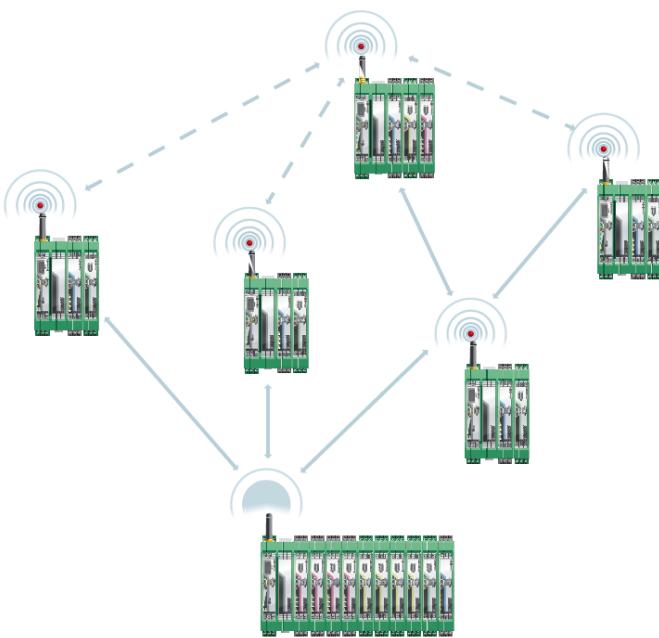


Figure 17 Example of self-healing network