


Exhibit # 4

The SSBXL20-10MED Block diagram.

No parts were changed except in the power metering circuit. Only the amplifier bias was adjusted for the least distortion and best linearity. The EMR low pass filter was the only component added. The MEDEX P617 processor downconverts the 8VSB signal to IF and upconverts it to the desired UHF channel.

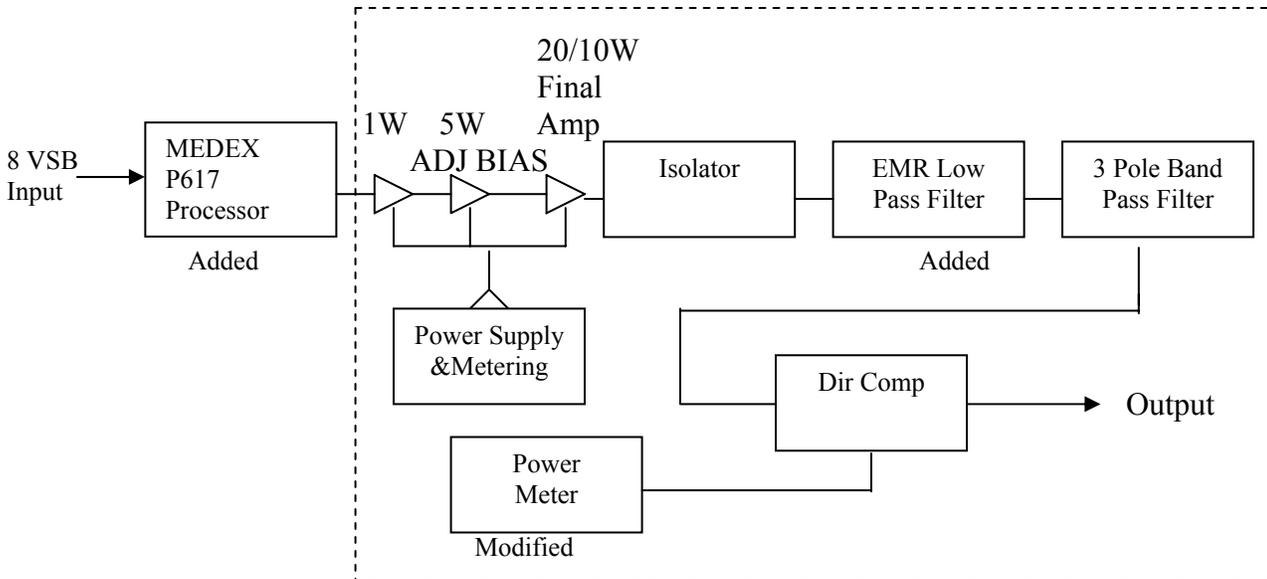

Everything within the dotted line is contained within the cabinet of the existing unit already type certified.