



849 NW State Road 45  
Newberry, FL 32669 USA  
Ph: 888.472.2424 or 352.472.5500  
Fax: 352.472.2030  
Email: [info@timcoengr.com](mailto:info@timcoengr.com)  
Website: [www.timcoengr.com](http://www.timcoengr.com)

---

## FCC PART 15.249 TEST REPORT

### UNLICENSED INTENTIONAL RADIATOR

<b>Applicant</b>	ENERNET CORPORATION	
<b>Address</b>	307 DEWITTSHIRE ROAD	
	SYRACUSE NEW YORK 13214 USA	
<b>FCC ID</b>	TGD14800	
<b>Model Number</b>	14800	
<b>Product Description</b>	WIRELESS THERMOSTAT	
<b>Date Sample Received</b>	1/31/2013	
<b>Date Tested</b>	2/4/2013	
<b>Tested By</b>	Nam Nguyen	
<b>Approved By</b>	Nam Nguyen	
<b>Report Number</b>	202AUT13TestReport.doc	
<b>Test Results</b>	<input checked="" type="checkbox"/> PASS	<input type="checkbox"/> FAIL

THE ATTACHED REPORT SHALL NOT BE REPRODUCED EXCEPT IN FULL  
WITHOUT THE WRITTEN APPROVAL OF TIMCO ENGINEERING, INC.



Testing Certificate #0955-01



## TABLE OF CONTENT

GENERAL REMARKS.....	3
GENERAL INFORMATION .....	4
EMC EQUIPMENT LIST.....	5
TEST PROCEDURES.....	6
RADIATION INTERFERENCE .....	7
OCCUPIED BANDWIDTH .....	8
BAND EDGE COMPLIANCE .....	9
DUTY CYCLE.....	10
POWER LINE CONDUCTED INTERFERENCE .....	12

APPLICANT: ENERNET CORPORATION  
FCC ID: TGD14800  
REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc

## **GENERAL REMARKS**

The attached report shall not be reproduced except in full without the written permission of Timco Engineering Inc.

### **Summary**

The device under test does:

- fulfill the general approval requirements as identified in this test report
- not fulfill the general approval requirements as identified in this test report

### **Attestations**

This equipment has been tested in accordance with the standards identified in this test report. To the best of my knowledge and belief, these tests were performed using the measurement procedures described in this report.

All instrumentation and accessories used to test products for compliance to the indicated standards are calibrated regularly in accordance with ISO 17025 requirements.



Certificate # 0955-01

I attest that the necessary measurements were made, under my supervision, at:

Timco Engineering Inc.  
849 NW State Road 45  
Newberry, FL 32669



### **Authorized Signatory Name:**

Nam Nguyen  
Test Technician

**Date:** February 5, 2013

APPLICANT: ENERNET CORPORATION  
FCC ID: TGD14800  
REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc

## GENERAL INFORMATION

### DUT Specification

The test results relate only to the items tested.		
<b>Applicable Standard</b>	Part 15.249	
<b>DUT Description</b>	WIRELESS THERMOSTAT	
<b>FCC ID</b>	TGD14800	
<b>Model Number</b>	14800	
<b>Operating Frequency</b>	TX: 916.65 MHz	RX: Same
<b>No. of Channels</b>	1	
<b>Modulations</b>	FM	
<b>DUT Power Source</b>	<input type="checkbox"/> 110–120Vac/50– 60Hz	
	<input checked="" type="checkbox"/> DC Power	
	<input type="checkbox"/> Battery Operated Exclusively	
<b>Test Item</b>	<input type="checkbox"/> Prototype	<input checked="" type="checkbox"/> Pre-Production <input type="checkbox"/> Production
<b>Type of Equipment</b>	<input type="checkbox"/> Fixed	<input type="checkbox"/> Mobile <input checked="" type="checkbox"/> Portable
<b>Antenna Connector</b>	FCC Rules require that the antenna connector be unique.	
<b>Test Facility</b>	Timco Engineering Inc. located at 849 NW State Road 45 Newberry, FL 32669 USA.	
<b>Test Conditions</b>	Temperature: 26°C Relative humidity: 50%	
<b>Test Exercise</b>	The DUT was placed in continuous transmit mode of operation.	

### Test Supporting Equipment

Supporting Device	Manufacturer	Model / FCC ID	Serial Number
N/A			

APPLICANT: ENERNET CORPORATION

FCC ID: TGD14800

REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc



## EMC EQUIPMENT LIST

Device	Manufacturer	Model	Serial Number	Cal/Char Date	Due Date
Antenna: Passive Loop	EMC Test Systems	EMCO 6512	9706-1211	06/14/12	06/14/14
Frequency Counter	HP	5352B	2632A00165	06/22/11	06/22/13
Digital Multimeter	Fluke	77	43850817	02/22/12	02/22/13
Antenna: Active Loop	ETS-Lindgren	6502	00062529	09/23/10	09/23/13
Analyzer Open-Frame Tower Preamplifier	HP	8449B	3008A01075	07/22/09	09/15/13
DC Power Supply	HP	6264B		03/21/11	03/21/13
3-Meter Semi-Anechoic Chamber	Panashield	N/A	N/A	12/31/11	12/31/13
Antenna: Log-Periodic	Electro-Metrics	LPA-25	1122	05/04/11	05/04/13
Digital Multimeter	Fluke	77	35053830	09/09/11	09/09/13
Antenna: Biconnical	Eaton	94455-1	1096	05/04/11	05/04/13
Analyzer Tan Tower Preamplifier	HP	8449B-H02	3008A00372	10/28/11	10/28/13
Analyzer Tan Tower Quasi-Peak Adapter	HP	85650A	3303A01690	10/28/11	10/28/13
Analyzer Tan Tower RF Preselector	HP	85685A	3221A01400	10/28/11	10/28/13
Analyzer Tan Tower Spectrum Analyzer	HP	8566B Opt 462	3138A07786 3144A20661	10/28/11	10/28/13
Horn antenna	ETS Lindgren	3117	35923	12/20/11	12/20/13

APPLICANT: ENERNET CORPORATION

FCC ID: TGD14800

REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc

## TEST PROCEDURES

**Radiation Interference:** ANSI C63.4-2003 using a spectrum analyzer, a preselector, a quasi-peak adapter, and an appropriate antenna. The analyzer was calibrated in dB above a microvolt at the output of the antenna. The resolution bandwidth was 100 kHz with an appropriate sweep speed and the video bandwidth was 300 kHz up to 1 GHz and 1 MHz with a video BW of 3 MHz above 1 GHz. When an emission was found, the table was rotated to produce the maximum signal strength. The antenna was placed in both the horizontal and vertical planes and the worse case emissions were reported. The spectrum was searched to at least the tenth (10) harmonic of the fundamental.

**Formula Of Conversion Factors:** The field strength at 3m was established by adding the meter reading of the spectrum analyzer (which is set to read in units of dB $\mu$ V) to the antenna correction factor supplied by the antenna manufacturer. The antenna correction factors are stated in terms of dB. The gain of the preselector was accounted for in the spectrum analyzer meter reading.

Example:

$$\begin{array}{llll}
 \text{Freq (MHz)} & \text{Meter Reading} & + \text{ACF} & + \text{CL} = \text{FS} \\
 33 & 20 \text{ dB}\mu\text{V} & + 10.36 \text{ dB} & + 0.5 = 30.86 \text{ dB}\mu\text{V/m} @ 3\text{m}
 \end{array}$$

**Power Line Conducted Interference:** The procedure used was ANSI C63.4-2003 using a 50uH LISN. Both lines were observed. The bandwidth of the spectrum analyzer was 10kHz with an appropriate sweep speed. The spectrum was scanned from 0.15 to 30 MHz.

**Occupied Bandwidth:** A small sample of the transmitter output was fed into the spectrum analyzer and the attached plot was printed. The vertical scale is set to -10 dBm per division.

**ANSI C63.4-2003 10.1 Measurement Procedures:** The DUT was placed on a table 80 cm high and with dimensions of 1m by 1.5m. The DUT was placed in the center of the table (1.5m side). The table used for radiated measurements is capable of continuous rotation.

When an emission was found, the table was rotated to produce the maximum signal strength. At this point, the antenna was raised and lowered from 1m to 4m. The antenna was placed in both the horizontal and vertical planes. Emissions attenuated more than 20 dB below the permissible value are not reported.



## RADIATION INTERFERENCE

**Rules Part No.:** 15.249, 15.209

### Requirements:

Frequency	Limits
Part 15.209	
9 to 490 kHz	2400/F (kHz) $\mu$ V/m @ 300 meters
490 to 1705 kHz	24000/F (kHz) $\mu$ V/m @ 30 meters
1705 kHz to 30 MHz	29.54 dB $\mu$ V/m @ 30 meters
30 – 88	40.0 dB $\mu$ V/m @ 3 meters
80 – 216	43.5 dB $\mu$ V/m @ 3 meters
216 – 960	46.0 dB $\mu$ V/m @ 3 meters
Above 960	54.0 dB $\mu$ V/m @ 3 meters
Part 15.249	
Fundamental 902 – 928 MHz	94.0 dB $\mu$ V/m @ 3 meters
Fundamental 2.4 – 2.4835 MHz	94.0 dB $\mu$ V/m @ 3 meters
Harmonics	54.0 dB $\mu$ V/m @ 3 meters

Measurements were made from the lowest frequency generated or 9 kHz to at least the 10<sup>th</sup> Harmonic.

### Test Data: 15.249

Tuned Frequency MHz	Emission Frequency MHz	Meter Reading dB $\mu$ V	Ant. Polarity	Coax Loss dB	Correction Factor dB/m	Duty Cycle dB	Field Strength dB $\mu$ V/m	Margin dB
916.6	70.1	9.3	H	0.57	5.23	1.92	13.18	26.82
916.6	70.1	15.7	V	0.57	5.23	1.92	19.58	20.42
916.6	916.6	59.8	V	5.01	23.37	1.92	86.26	7.74
916.6	916.6	67.1	H	5.01	23.37	1.92	93.56	0.44
916.6	1,833.30	17.8	V	2.77	30.63	1.92	49.28	4.72
916.6	1,833.30	18.9	H	2.77	30.63	1.92	50.38	3.62
916.6	2,749.95	11.3	V	3.42	32.8	1.92	45.6	8.4
916.6	2,749.95	11.4	H	3.42	32.8	1.92	45.7	8.3
916.6	3,666.60	9.9	V	4.2	33.27	1.92	45.45	8.55
916.6	3,666.60	10.5	H	4.2	33.27	1.92	46.05	7.95
916.6	4,583.25	8.5	H	4.79	34.25	1.92	45.62	8.38

APPLICANT: ENERNET CORPORATION

FCC ID: TGD14800


REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc

## OCCUPIED BANDWIDTH

Rules Part No.: 15.249 (d)

**Requirements:** The field strength of any emissions appearing outside the bandedges and up to 10 kHz above and below the band edges shall be attenuated at least 50 dB below the level of the carrier or to the general limits of 15.249.

**Test Data: 20dB bandwidth = 60. kHz**

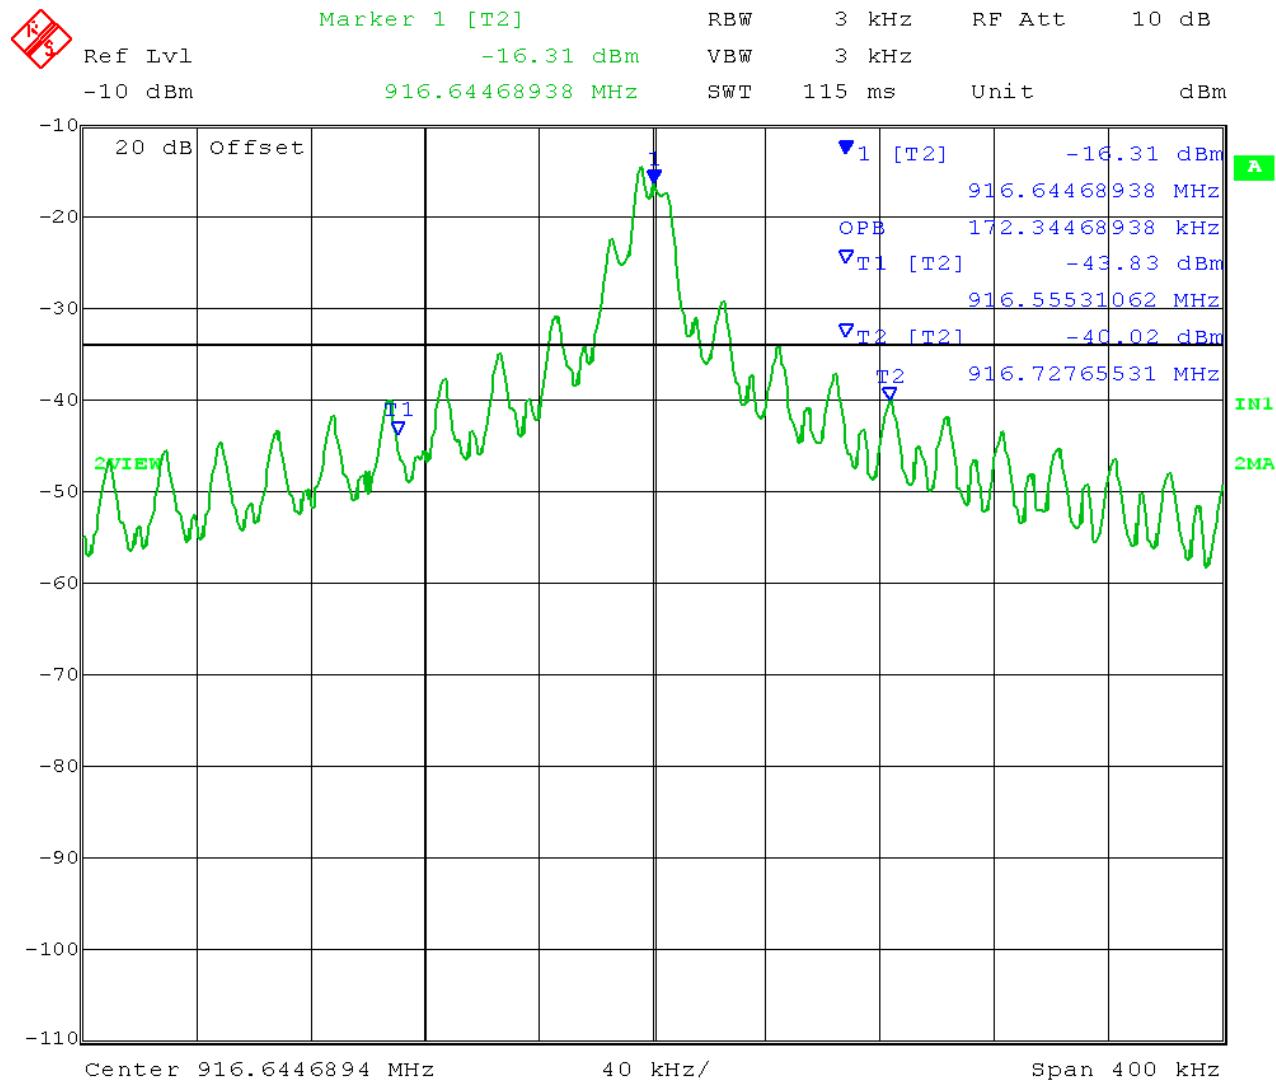

Date: 6.FEB.2013 08:59:56

## 20dB OCCUPIED BANDWIDTH

APPLICANT: ENERNET CORPORATION

FCC ID: TGD14800

REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc



## **BAND EDGE COMPLIANCE**

**Rules Part No.:** 15.249 (d)


**Requirements:** 40 dBc or in the case of restricted bands 54 dB $\mu$ V/m.

**Test Data:**

NA - THERE IS ONLY ONE CHANNEL FREQUENCY AT 916.5 MHz.

APPLICANT: ENERNET CORPORATION  
FCC ID: TGD14800  
REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc

## DUTY CYCLE

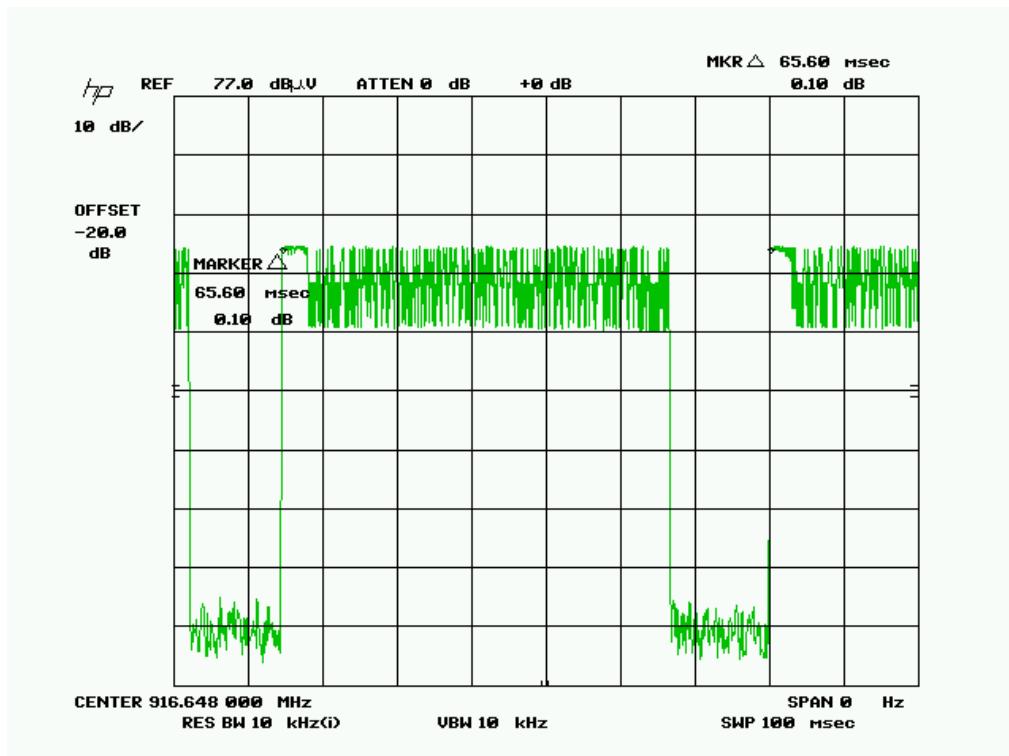

**Total # of pulses:** 1 in 65.6 ms


**Duration of pulse:** 52.2 ms is the maximum duration of pulse.

$$20 \log ((52.2 \times 65.6) / 100) = 20 \log (0.15) = 1.92 \text{ dB}$$

APPLICANT: ENERNET CORPORATION

FCC ID: TGD14800

REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc

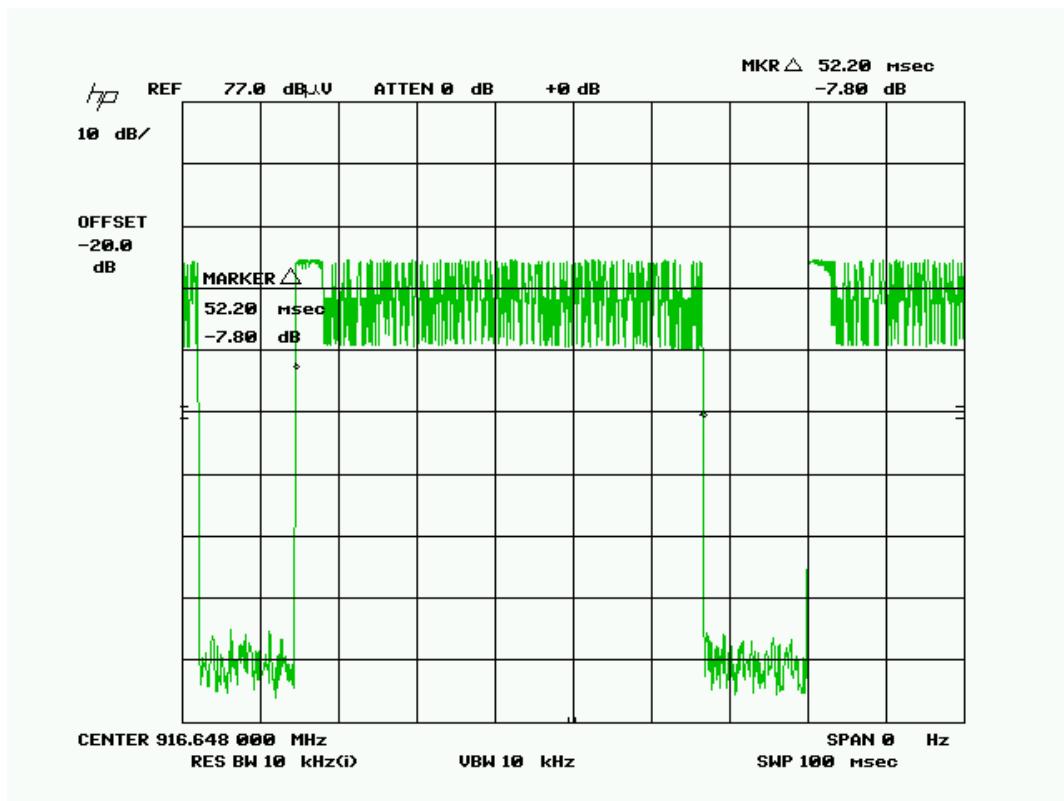

APPLICANT: ENERNET CORPORATION  
 FCC ID: TGD14800  
 REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc



## POWER LINE CONDUCTED INTERFERENCE

**Rules Part No.:** 15.207

**Requirements:**

Frequency (MHz)	Quasi Peak Limits (dB $\mu$ V)	Average Limits (dB $\mu$ V)
0.15 – 0.5	66 – 56	56 – 46
0.5 – 5.0	56	46
5.0 – 30	60	50

**Test Data:** The attached graphs represent the emissions read for power line conducted for this device. Both lines were observed.

N/A  
Battery or vehicle powered DUT.

APPLICANT: ENERNET CORPORATION  
FCC ID: TGD14800  
REPORT #: E\ENERNET\_TGD\202AUT13\202AUT13TestReport.doc