

Model information label

Bellman Visit Smoke Alarm Transmitter Unit

Model BE1282, 433,92 MHz

BE1282_014PLB004

FCC/CE approvals, see manual

FCC ID:WMSBETX1


IC:6693A-BETX1



Serial number label

Serial number text

Serial number in Bar Code

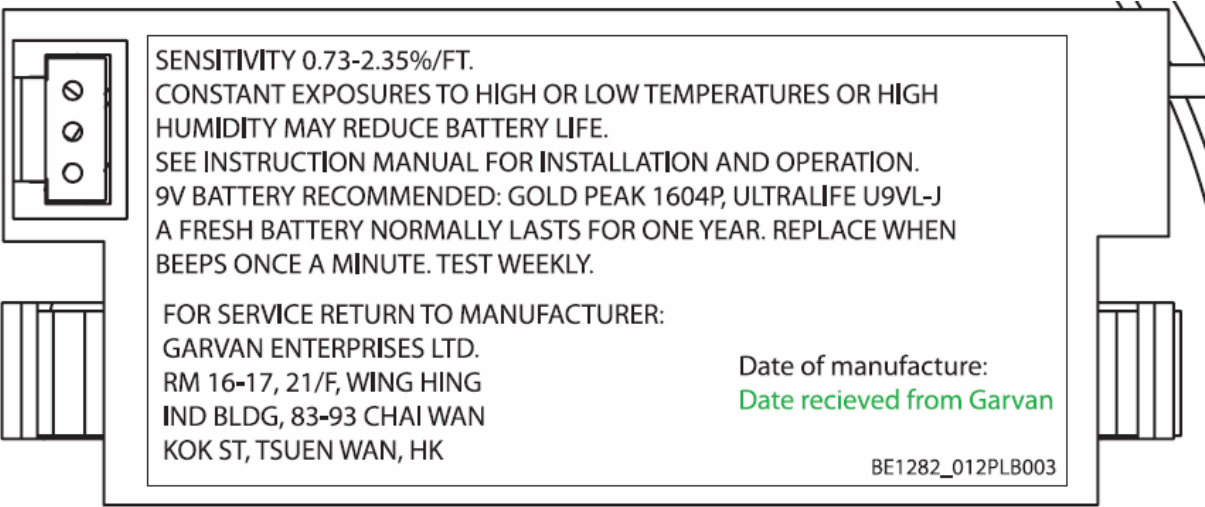

SENSITIVITY 0.73-2.35%/FT.
CONSTANT EXPOSURES TO HIGH OR LOW TEMPERATURES OR HIGH HUMIDITY MAY REDUCE BATTERY LIFE.
SEE INSTRUCTION MANUAL FOR INSTALLATION AND OPERATION.
9V BATTERY RECOMMENDED: GOLD PEAK 1604P, ULTRALIFE U9VL-J
A FRESH BATTERY NORMALLY LASTS FOR ONE YEAR. REPLACE WHEN BEEPS ONCE A MINUTE. TEST WEEKLY.

FOR SERVICE RETURN TO MANUFACTURER:
GARVAN ENTERPRISES LTD.
RM 16-17, 21/F, WING HING
IND BLDG, 83-93 CHAI WAN
KOK ST, TSUEN WAN, HK

Date of manufacture:
Date recieved from Garvan

BE1282_012PLB003