SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2020/4000805

Appendix D

Photographs


- 1. SAR measurement System
- 2. Photographs of Tissue Simulate Liquid
- 3. Photographs of EUT test position
- 4. EUT Constructional Details



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2020/4000805

1. SAR measurement System

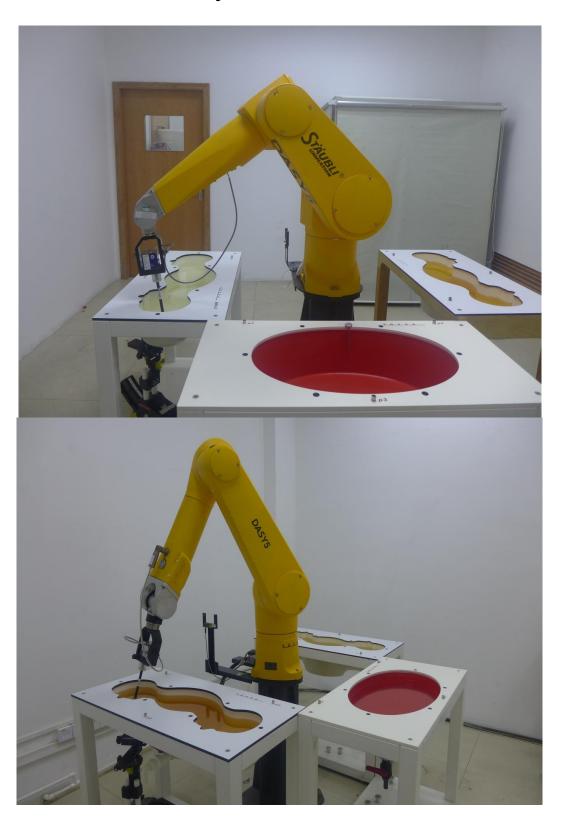




SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2020/4000805

2. Photographs of Tissue Simulate Liquid

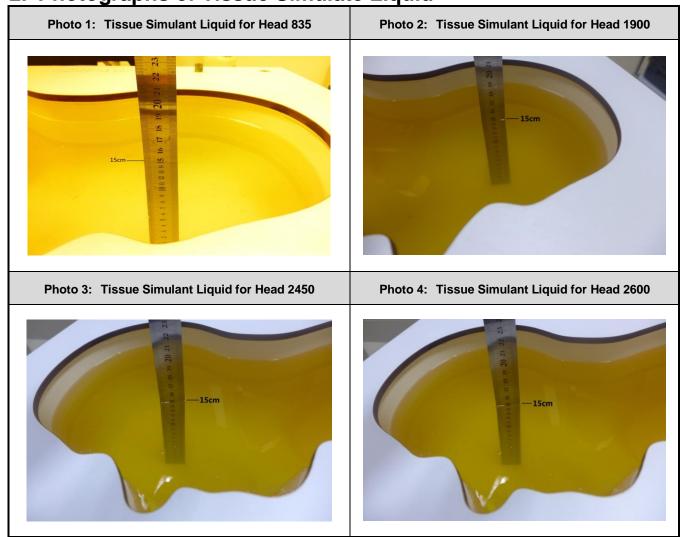



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2020/4000805

3. Photographs of EUT test position

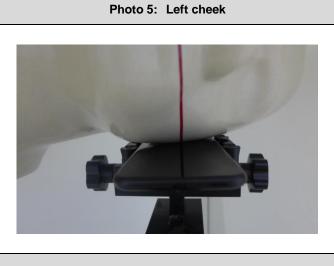
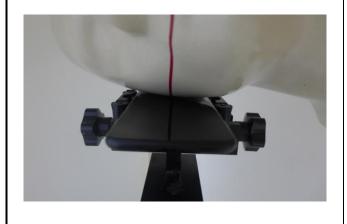


Photo 6: Left tilted



Photo 7: Right cheek

Photo 8: Right tilted



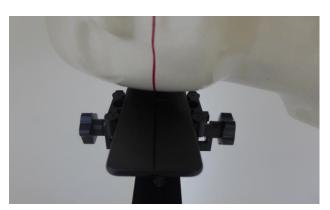


Photo 9: Front side 10mm

Photo 10: Back side 10mm







SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2020/4000805

Photo 12: Right side 10mm Photo 11: Left side 10mm Photo 13: Top side 10mm Photo 14: Bottom side 10mm Photo 15: Front side 15mm Photo 16: Back side 15mm



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2020/4000805

4. EUT Constructional Details

